


COMPUTER AIDED PERFORMANCE STUDY & COST ANALYSIS OF A DOUBLE-STAGE-VAPOUR ABSORPTION SYSTEM

By

ARUN MEHTA



DEPARTMENT OF MECHANICAL ENGINEERING

INDIAN INSTITUTE OF TECHNOLOGY, KANPUR

AUGUST, 1987

ME

1987

M

MEH

COM

COMPUTER AIDED PERFORMANCE STUDY & COST ANALYSIS OF A DOUBLE-STAGE-VAPOUR ABSORPTION SYSTEM

A Thesis Submitted
In Partial Fulfilment of the Requirements
for the Degree of

MASTER OF TECHNOLOGY

By

ARUN MEHTA

to the

DEPARTMENT OF MECHANICAL ENGINEERING

INDIAN INSTITUTE OF TECHNOLOGY, KANPUR


AUGUST, 1987

CHE-1987-M-MEH-COM

21 SEP 1987
CENTRAL LIBRARY

Acc. No. A 97962

CERTIFICATE

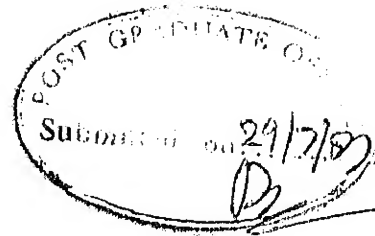

This is to certify that this work on Computer Aided Performance Study and Cost Analysis of a Double-Stage-Vapour-Absorption-System has been carried out under my supervision and it has not been submitted elsewhere for a degree.

A handwritten signature in cursive script, which appears to read "H.C. Agrawal".

(H.C. AGRAWAL)

Professor

Department of Mechanical Engineering,
Indian Institute of Technology, Kanpur

July, 1987

ACKNOWLEDGEMENT


With immense pleasure, I express my deep sense of gratitude and regards to Professor H.C. Agrawal, for inspiring me to take up this problem and providing his inspiring guidance and constructive criticism to overcome all difficulties encountered during this period. His intense interest and unflinching assistance have been the main factors responsible for the completion of this work in time.

I am very grateful to the members of the faculty at the Department of Mechanical Engineering for their valuable contribution in my education.

The work would have been very difficult without the extremely helpful and valuable assistance given by Mr. N.K. Patnaik, my colleague and friend. I am highly grateful and thankful to him. I wish to express my thanks, also to Mr. Amar J. Borathakur who made my stay at this place unforgettable.

I am deeply beholden to the members of my family for their abiding inspiration and loving patronage.

The get up of the thesis reflects sincere and painstaking efforts of several peoples. I am thankful in particular to Mr. H.V.C. Srivastava for excellent typing.


Arun Mehta

CONTENTS

	Page
CERTIFICATE	i
ACKNOWLEDGEMENT	ii
LIST OF FIGURES	vi
LIST OF TABLES	vii
NOMENCLATURE	ix
ABSTRACT	xi
I VAPOUR ABSORPTION AND COMPRESSION	1
SYSTEMS	
1.1 INTRODUCTION	1
1.2 LITERATURE-SURVEY	8
1.3 PRESENT WORK	11
II SINGLE-STAGE-VAPOUR-ABSORPTION-SYSTEM	16
2.1 DESCRIPTION OF THE SYSTEM	16
2.2 THERMODYNAMIC ANALYSIS OF THE SYSTEM	17
2.3 COMPUTER PROGRAMME PACKAGE	26
III ANALYSIS AND COMPUTER MODELLING OF DOUBLE-	28
STAGE-VAPOUR-ABSORPTION-SYSTEM	
3.1 DESCRIPTION OF THE SYSTEM	28
3.2 THERMODYNAMIC ANALYSIS OF THE SYSTEM	30
3.3 COMPUTER MODELLING	38

3.3.1	Subroutine for Solving State Equations	39
3.3.2	Algorithm, Newton-Raphson Technique	40
IV	ECONOMICS OF VAPOUR-ABSORPTION AND VAPOUR-COMPRESSSION SYSTEMS	42
V	RESULTS AND DISCUSSION	54
	REFERENCES	84
	APPENDICES	87

LIST OF FIGURES

<u>Fig. No.</u>	<u>Description</u>	<u>Page No.</u>
1.1	Flow Diagram of a Vapour-Compression-System	3
1.2	One-Stage Absorption System with Heat Exchanger	4
1.3	Double-Effect Absorption Unit (The Trane Company)	12
1.4	Schematic Diagram of Double-Stage-Vapour-Absorption-System	13
2.1	Heat-Operated Refrigeration Cycle	25
2.2	Flow-Chart for Single-Stage-Absorption-System	27
3.1	Flow-Chart for Computer Modelling of a Double-Stage-Vapour-Absorption-System	41
5.1	Variation of C.O.P. with Generator-I Temperature ($T_c=20^{\circ}\text{C}$, 25°C ; $T_a=20^{\circ}\text{C}$, $T_e=5^{\circ}\text{C}$)	65
5.2	Variation of C.O.P. with Generator-I Temperature ($T_c=30^{\circ}\text{C}$, $T_a=25^{\circ}\text{C}$, $T_e=5^{\circ}\text{C}$)	66
5.3	Variation of C.O.P. with Generator-I Temperature ($T_c=30^{\circ}\text{C}$, $T_a=30^{\circ}\text{C}$, $T_e=5^{\circ}\text{C}$)	67

5.4	Variation of C.O.P. with Generator-I Temperature ($T_c=35^{\circ}\text{C}$, $T_a=30^{\circ}\text{C}$, $T_e=8^{\circ}\text{C}$)	68
5.5	Variation of C.O.P. with condenser- Temperature ($T_g=90^{\circ}\text{C}$, $T_a=25^{\circ}\text{C}$, $T_e=8^{\circ}\text{C}$)	71
5.6	Variation of C.O.P. with Condenser- Temperature ($T_g=95^{\circ}\text{C}$, $T_a=25^{\circ}\text{C}$, $T_e=8^{\circ}\text{C}$)	72
5.7	Variation of C.O.P. with Evaporator- Temperature (Double-Stage, $T_c=25^{\circ}\text{C}$, $T_a=20^{\circ}\text{C}$)	75
5.8	Variation of C.O.P. with Absorber- Temperature (Double-Stage, $T_e=5^{\circ}\text{C}$, 8°C ; $T_g=90^{\circ}\text{C}$, $T_c=30^{\circ}\text{C}$)	77
5.9	Variation of Generator-II Temperature with Generator-I Temperature	79
5.10	Variation of Generator's Load with Generator-I Temperature	80
5.11	Variation of C.O.P. with Heat Exchanger Effectiveness	81

LIST OF TABLES

<u>TABLE NO.</u>	<u>DESCRIPTION</u>	<u>PAGE NO</u>
1	Effect of Generator-I Temperature on operating parameters ($T_c = 20^\circ\text{C}$, $T_a = 20^\circ\text{C}$, $T_e = 5^\circ\text{C}$, $\eta_1 = \eta_2 = 0.90$)	61
2	Effect of Generator-I Temperature on operating parameters ($T_c = 25^\circ\text{C}$, $T_a = 20^\circ\text{C}$, $T_e = 5^\circ\text{C}$, $\eta_1 = \eta_2 = 0.90$)	62
3	Effect of Generator-I Temperature on operating parameters ($T_c = 30^\circ\text{C}$, $T_a = 25^\circ\text{C}$, $T_e = 5^\circ\text{C}$, $\eta_1 = \eta_2 = 0.90$)	63
4	Effect of Generator-I Temperature on operating parameters ($T_c = 35^\circ\text{C}$, $T_a = 30^\circ\text{C}$, $T_e = 8^\circ\text{C}$, $\eta_1 = \eta_2 = 0.90$)	64
5	Effect of Condenser-Temperature on C.O.P. ($T_g = 90^\circ\text{C}$, $T_a = 25^\circ\text{C}$, $T_e = 8^\circ\text{C}$, $\eta_1 = \eta_2 = 0.90$)	69
6	Effect of Condenser-Temperature on C.O.P. ($T_g = 95^\circ\text{C}$, $T_a = 25^\circ\text{C}$, $T_e = 8^\circ\text{C}$, $\eta_1 = \eta_2 = 0.90$)	70

- 7 Effect of Evaporator-Temperature on C.O.P. 73
 $(T_g = 85\text{ }^{\circ}\text{C}, T_c = 25\text{ }^{\circ}\text{C}, T_a = 20\text{ }^{\circ}\text{C}, \eta_1 = \eta_2 = 0.90)$
- 8 Effect of Evaporator-Temperature on C.O.P. 74
 $(T_g = 95\text{ }^{\circ}\text{C}, T_c = 25\text{ }^{\circ}\text{C}, T_a = 20\text{ }^{\circ}\text{C}, \eta_1 = \eta_2 = 0.90)$
- 9 Effect of Evaporator-Temperature on C.O.P. 74
 $(T_g = 90\text{ }^{\circ}\text{C}, T_c = 30\text{ }^{\circ}\text{C}, T_a = 25\text{ }^{\circ}\text{C}, \eta_1 = \eta_2 = 0.90)$
- 10 Effect of Absorber-Temperature on the C.O.P. 76
 $(T_g = 90\text{ }^{\circ}\text{C}, T_c = 30\text{ }^{\circ}\text{C}, T_e = 50\text{ }^{\circ}\text{C}, \eta_1 = \eta_2 = 0.90)$
- 11 Effect of Absorber-Temperature on the C.O.P. 78
 $(T_g = 90\text{ }^{\circ}\text{C}, T_c = 30\text{ }^{\circ}\text{C}, T_e = 8\text{ }^{\circ}\text{C}, \eta_1 = \eta_2 = 0.90)$
- 12 Effect of Heat-Exchanger effectiveness on C.O.P. 78
 $(T_g = 90\text{ }^{\circ}\text{C}, T_c = 25\text{ }^{\circ}\text{C}, T_a = 20\text{ }^{\circ}\text{C}, T_e = 5\text{ }^{\circ}\text{C})$

NOMENCLATURE

A	Surface area	[m ²]
C _P	Specific heat	[kJ/kg. K]
d	Diameter of tube	[m]
f	Friction factor	
g	Acceleration due to gravity	[m/s ²]
H	Enthalpy	[kJ/kg]
h	Heat transfer coefficient	[W/m ² .K]
K	Thermal conductivity	[W/m.K]
\dot{m}	Mass flow rate	[kg/s]
N	Number of tubes per pass	
P	Pressure	[k Pa]
Q	Volume flow rate	[m ³ /s]
q	Heat load	[kW]
R	Thermal resistance	[m ² .K/W]
t	Temperature	[°C]
t _f	Temperature	[°F]
TR	Refrigerant temperature	[°C]
TS	Solution temperature	[°C]
U	Overall heat transfer coefficient	[W/m ² .K]

V	Velocity	[m/s]
X	Lithium bromide concentration %.	[kg/kg of sol.]

Subscripts

a	Referred to absorber
c	Referred to condenser condition
e	Referred to evaporator condition
ff	Fouling condition
g ₁	Referred to first stage generator
g ₂	Referred to second stage generator
i	Referred to inlet condition
m	Mean
o	Referred to outlet condition
t	Tube side
w	Water side
1,2,3,...,7	State points referred to Fig. (1.3) for single-stage
1,2,3,...,18	Stage points referred to Fig. (1.4) for double-stage
I,II	First and second heat exchanger

Greek Symbols :

μ	Dynamic Viscosity	[Pa.s]
ϵ	Absolute roughness	[mm]
ρ	Density of fluid	[kg/m ³]
ν	Specific volume	[m ³ /kg]
η	Heat exchanger effectiveness	

ABSTRACT

The escalating cost of energy and the fast depleting sources of conventional-energy have sounded an alarm to the world, urging us to be meticulous in using any form of energy, at our disposal. Using waste heat energy from various industrial processes and the use of non-conventional energy sources, such as : solar, geothermal, bio-gas, wind, tidal etc., are vitally important propositions in this context. A double-stage-vapour-absorption-system to produce refrigeration, attempts to fulfil the efficient use of the above energy resources.

Keeping the above fact in mind, the present work is devoted to the analysis of a double-stage-vapour-absorption-system. The complete performance-study of the system is carried out to determine the variation of C.O.P. (the index of performance of the system) with various operating parameters. The optimum values of these parameters are also evaluated for maximum C.O.P. This C.O.P. is compared with the C.O.P. of the corresponding single-stage-vapour-absorption-system.

The most conventional method of producing refrigeration is by using vapour-compression-system, which uses the valuable mechanical energy for its operation. Therefore, is the major

competitor to the proposed system, presented in the thesis. Hence, a comparative cost-analysis is also undertaken in the present study to evaluate the relative economics of operation for the two systems.

A digital computer DEC-1090 has been used to help in carrying out the analysis. Required computer programmes have been developed to perform this analysis, which are made very general to encompass a class of similar problems. Results have been discussed and the following conclusions drawn :

1. The C.O.P. obtained in a double stage-system is quite high (1.785 maximum) as compared to single stage (0.84 maximum). However, very high input source-temperature is required for system's operation.
2. This system has very high values of C.O.P., almost approaching the ideal value at high condenser temperatures. The practicability of using high condenser-temperatures obviates the necessity of using a cooling tower along with the condenser and an air cooled condenser may be used for the purpose. This helps in a reduction in total cost of the system.
3. A double-stage-vapour-absorption-system is more economical than a vapour-compression-system in terms of the annual running cost as it does not require compressor for its operation, which consumes most of the energy required for the operation of a vapour-compression-system.

CHAPTER-I

VAPOUR ABSORPTION AND COMPRESSION SYSTEMS

1.1 INTRODUCTION :

Vapour compression system is invariably used in most of the refrigeration and air conditioning industries. The outline of such a system along with all its basic components ^{is} ~~are~~ shown in Fig. 1.1. However, it uses the costly mechanical energy in the form of compressor work and the ever-rising costs of this energy due to continuous depleting energy resources have demanded that this valuable energy should be conserved, as much and as far as possible. There are broadly two ways which can assist in conserving the conventional energy :

- (i) using non-conventional energy sources like solar, tidal, bio-gas, geothermal and wind energy, economically and
- (ii) using waste energy to recover some heat out of it, which otherwise would be wasted. Waste heat in the form of air and hot water from industries such as steel, chemical, textile, foundaries etc. can be considered as practical examples.

Vapour absorption system, which can work using either of the above two alternative energy sources or their

combination, is one of the very old methods to produce cold. Single-stage-vapour-absorption-system was first used in U.S.A. during the civil war after the supply of natural ice had been cut off from North. Many improvements have been incorporated in the system over the years. The skeleton diagram of such an improved version of single-stage-vapour-absorption system is shown in Fig. 1.2. Since, the thesis work is devoted to the vapour-absorption system, we describe below the various components of this system:

(i) Generator

It is basically a heating vessel, which receives heat from the heat source and transfers it to the solution flowing inside the tubes. The source of heat can be steam, solar-heat, bio-gas, hot-water, hot-air etc.

(ii) Condenser

It is a shell and tube type heat exchanger located after the generator. Cooling water to cool refrigerant flows inside the tubes, whereas, refrigerant condenses in the shell.

(iii) Absorber

It is a heat-rejecting vessel. The strong absorbent solution in the absorber is sprayed to absorb the low pressure and temperature refrigerant vapour, coming out of the evaporator. Heat of absorption, which is generated due to exothermic

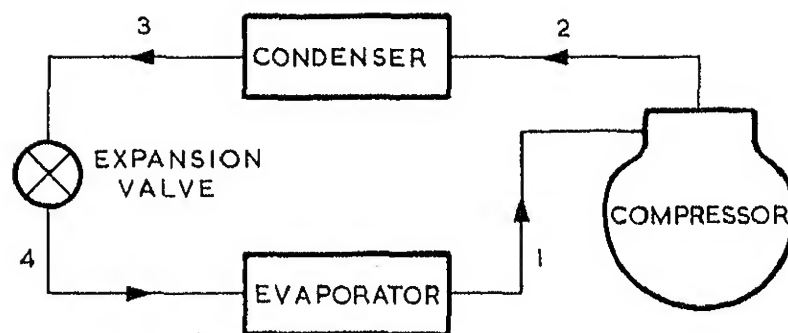


FIG.1.1 FLOW DIAGRAM OF VAPOUR COMPRESSION SYSTEM.

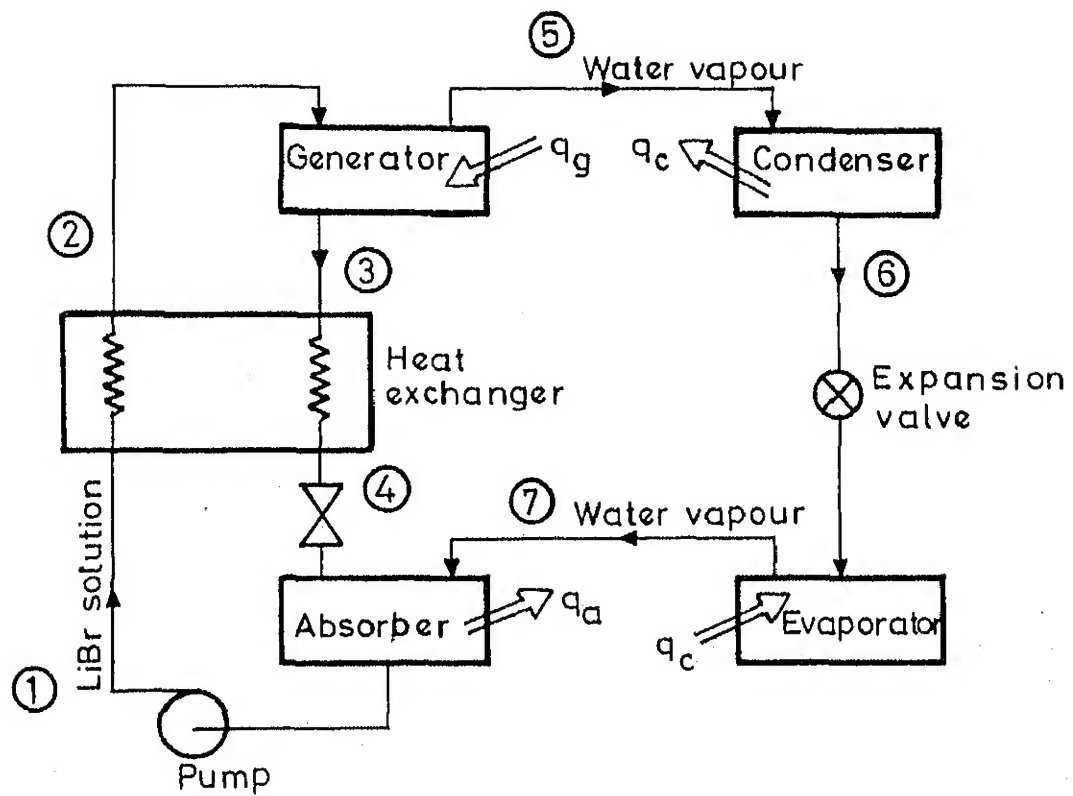


FIG. 1.2 ONE-STAGE ABSORPTION SYSTEM WITH HEAT EXCHANGER.

reaction, is rejected to the atmosphere, through the cooling water which flows inside the tubes.

(iv) Evaporator

Evaporator, sometimes also known as the Chiller, gives the desired cooling effect. Refrigerant flows inside the tubes, whereas liquid to be cooled flows over the tubes. Like condenser, it also has a shell and tube type construction.

(v) Solution-Heat-Exchanger

Solution-heat-exchanger is of shell and tube type construction. It heats the weak solution on its path from the absorber to the generator by extracting heat from the relatively hotter strong solution returning from the generator. This reduces the amount of heat to be added to the solution in the generator.

(vi) Expansion-Device

Expansion-device i.e. expansion valve is used for the reduction of pressure and temperature of the refrigerant liquid, while flowing from the condenser to evaporator. The valve used is generally an orifice or other fixed restriction / $\sqrt{11}$ type.

(vii) Solution Pump

It is generally electrical motor-driven centrifugal-pump of hermetic design, which circulates the solution in the absorption system.

The index of performance of a refrigeration system is represented by a dimensionless parameter termed as 'Coefficient of Performance', abbreviated as C.O.P.

For a vapour compression system, C.O.P. is defined as :

$$\text{C.O.P.} = \frac{\text{Useful refrigerating effect}}{\text{Net work done by the compressor}}$$

For a vapour absorption system, on the other hand, the C.O.P. is expressed as :

$$\text{C.O.P.} = \frac{\text{Useful refrigerating effect}}{\text{Rate of heat addition in the generator}}$$

An absorption cycle has an appreciably lower value of C.O.P, than that of a compression cycle (0.8 versus 3.5). Vapour compression cycle is ^a work operated cycle (mechanical work in compressor), whereas, absorption cycle is ^a heat operated cycle (heat addition in generator) and energy in the form of work is normally much more valuable and expensive than energy in the form of heat. It is, therefore, obvious that, the two systems cannot be measured on the same scale. The vapour compression system pushed absorption system as ^{obsolete} ~~obsolete~~ because of its being more reliable in operation and having ^a better C.O.P. However, with the advent of worldwide concern over energy conservation, the vapour absorption system has again gained importance as it saves lot of

conventional, valuable, mechanical energy. This system has been found quite attractive in the space-conditioning applications, producing chilled water for various application and for preserving perishable commodities.

Two types of vapour absorption systems can be practised:

- (i) using Lithium Bromide as the absorbent and water as the refrigerant and
- (ii) using water as the absorbent and Ammonia as the refrigerant.

The combination adopted in the second type is called aqua-ammonia and was used in absorption systems, years before the $\text{LiBr-H}_2\text{O}$ combination became popular, which has now almost completely replaced the aqua-ammonia system due to some of its following distinct advantages :

- (i) this combination yields higher C.O.P. at most operating temperatures.
- (ii) it operates at lower system pressures, thereby, requiring low pumping power.
- (iii) it can be used in commercial and residential buildings without any restriction from safety consideration.
- (iv) lower first cost due to the absence of parts like rectifier and analyzer.

Various improvements and refinements in conventional old Single-stage-absorption-system have been introduced from time to time to make vapour absorption system more efficient. It includes the reducing the generator temperature for system operation, increasing the allowable cooling water temperature and increasing the coefficient of performance, which, in turn, improves the efficiency of the system and conserves the energy.

The practicability of increasing the cooling water temperature is of special importance, because a sufficient reduction in the cost of the system may be achieved by using an air-cooled heat exchanger for heat rejection from the sinks of the absorption system and the requirement of a cooling tower may be eliminated.

1.2 LITERATURE-SURVEY

According to available literature tests for proving feasibility of solar air conditioning appeared in 1960 [1]. Design of one ton solar operated LiBr-H₂O air conditioning system was presented at National Solar Energy Convection at Bhavnagar [2] and performance prediction of LiBr-H₂O absorption air conditioning system, utilizing the solar energy was put forward at International Solar Energy Congress at New Delhi [3].

Design and optimization of an absorption cycle with $\text{LiBr-H}_2\text{O}$ and $\text{H}_2\text{O-NH}_3$ combination was studied by Alizadeh et.al. [4]. This study shows that, in general, for fixed initial conditions and given system-refrigeration-capacity, higher generator temperature causes higher cooling ratio with smaller heat exchange surfaces and, consequently, lower cost. A comparison of the two cycles also indicates that $\text{LiBr-H}_2\text{O}$ system is much simpler than $\text{NH}_3\text{-H}_2\text{O}$ system and operates at a higher cooling ratio and for smaller heat exchange surfaces for the same conditions.

Design aspects of an air-cooled Lithium-Bromide-Water absorption air conditioning system have been discussed by W.W.S. Charters et.al. [5], which include information on relative circulation rate of the solution and heat-exchanger effectiveness. Details are also provided for alternative design aspects in case crystallization of the solution occurs.

An economic evaluation of the use of Bio-gas to run a $\text{LiBr-H}_2\text{O}$ absorption system has been carried out by Siddiqui et.al. [6]. Coefficient of Performance of the system has been studied for various values of generator-temperature, pressure, evaporator-temperature, precooler and preheater effectiveness.

A dynamic model of solar air conditioning, including the solar collector and cooling tower, in terms of design parameters, is described by S.L. Grassie [7]. It has the special feature that it provides a refrigerant storage tank associated with the generator to stabilize the flow.

All the work listed above relates to single-stage-absorption-system. Due to escalating energy cost, in recent times, more attention, however, is being paid towards the energy conservation and its effective utilization. This has necessitated the study of a more efficient and improved system. Double-stage-vapour-absorption-system is such an improvement, which is supposed to work on higher C.O.P. than a single stage with certain other advantages like reduced condenser load, material saving in the tubes etc.

One of the recent works on the study of a double-stage-vapour-absorption-system is done by Kaushik and Kumar in the year 1985 [8], in which they have considered the refrigerant-absorbent combination of $\text{NH}_3\text{-H}_2\text{O}$ and $\text{NH}_3\text{-LiNO}_3$. The system consists of coupling of two conventional absorption cycles, so that the first stage evaporator produces cooling water to be circulated in the absorber of the second stage. The effect of operating variables, such as generator-temperature, evaporator-temperature and condenser-temperature on the C.O.P., heat transfer rates and relative circulation rates, has been

studied. Reference has been made by Stoecker and Jones [9] to the design of a double-stage-vapour-absorption-system proposed by the Trane Company of U.S.A.. LiBr-H₂O combination has been used as the working fluid for the system. A circuit diagram is presented (Fig. 1.3). C.O.P., of the order of 1.0 to 1.4 has been reported for such a system.

1.3 PRESENT WORK

The present work is an extension of the design concept for the double-stage-vapour-absorption-system, enunciated by the Trane Company [9]. The same working fluid i.e. LiBr-H₂O combination is used. An improved design of the system has been proposed. The detailed circuit diagram for the same is shown in (Fig. 1.4). This design has the following merits in comparison with the one, given by the Trane Company.

- (i) The solution entering the generator-II is heated by the steam from generator-I, which drives off some water vapour from the LiBr-H₂O solution. Hence, the solution leaving generator-II, is a two-phase mixture. This two-phase mixture is then throttled to the condenser pressure in throttling-valve-I. Since, the throttling valves are not designed to handle two phase mixture, this operation is inefficient. On the other hand, in the improved system, presented in Fig.(1.4), no throttling of LiBr-H₂O solution is necessary, as generator-II is already maintained at condenser pressure.

- (ii) In the system, developed by the Trane Company, generators-I and II are put in the same vessel. The thermodynamic properties of the $\text{LiBr-H}_2\text{O}$ solution are such that, they impose a restriction on the heat exchanger-II. The level of cooling to be achieved in this heat exchanger for the $\text{LiBr-H}_2\text{O}$ solution, entering the generator-II should be sufficient to accept heat from the steam, given off from generator-I. But in the system, proposed in the present work Fig. 1.4), generator-II is uncoupled from generator-I and, therefore, no restriction on the cooling capacity of the heat exchanger need be imposed.

The performance characteristics of the improved system are studied by the use of numerical modelling of the system which is based on the corresponding mass, energy and material balance equations of each component of the system. Effect of various component's temperature viz generator, absorber, condenser and evaporator on the performance of the system has been studied. Optimization of generator-I temperature for maximum C.O.P. along with minimum generator-temperature required to carry out system operation have been determined. Effect of heat-exchanger effectiveness on the system performance has also been studied.

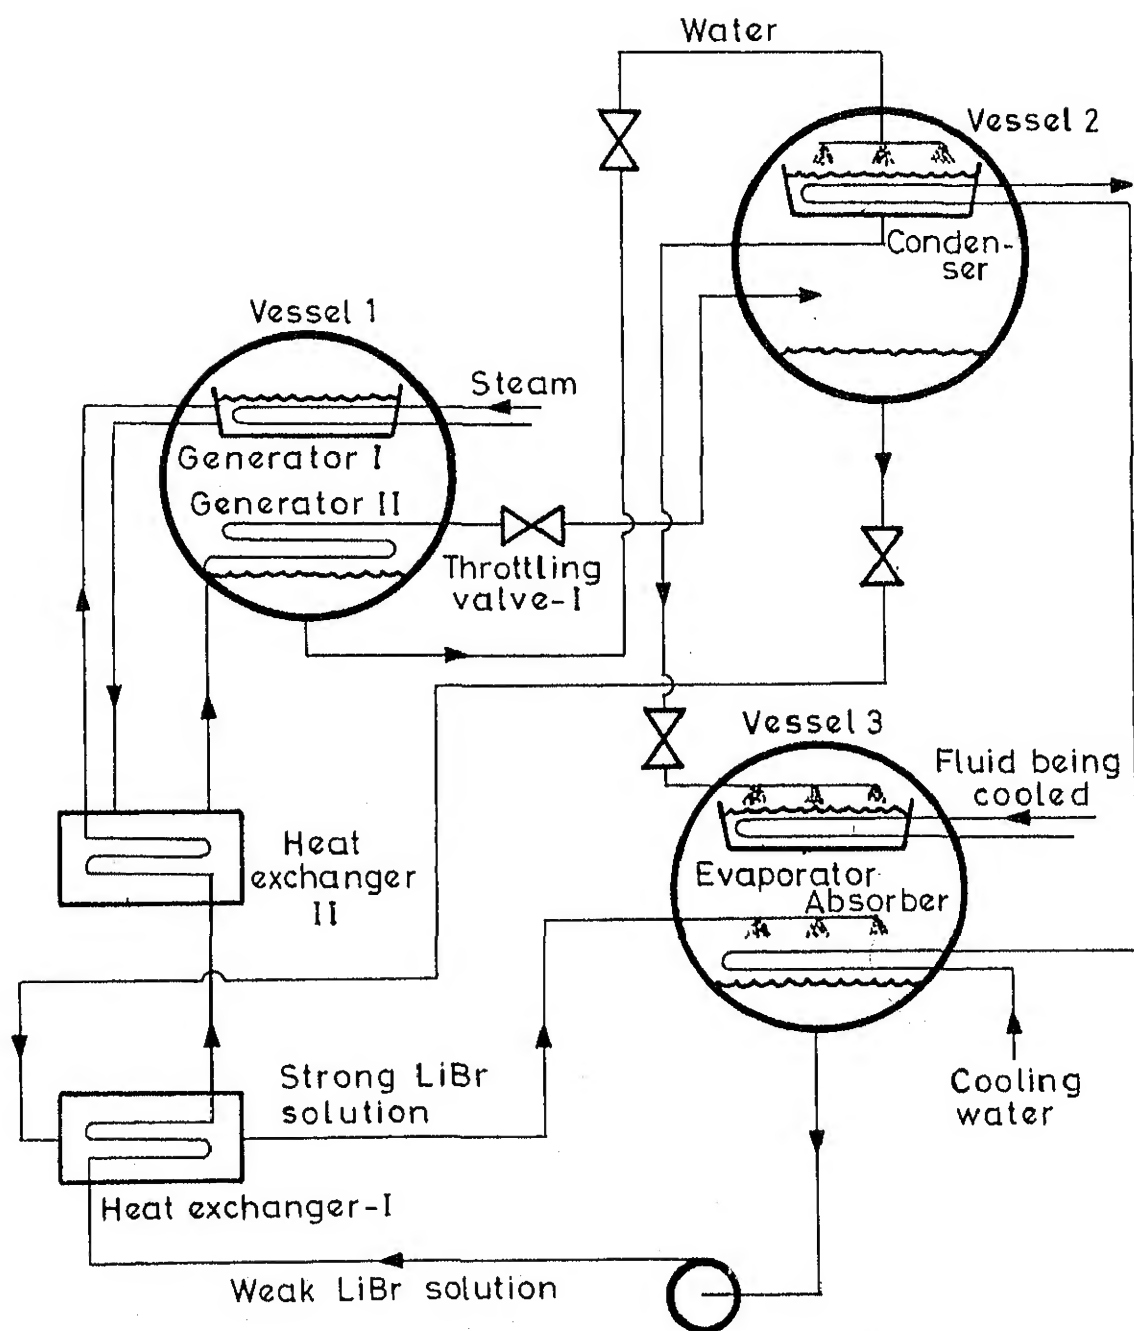


FIG.1.3 DOUBLE-EFFECT ABSORPTION UNIT (THE TRANE COMPANY).

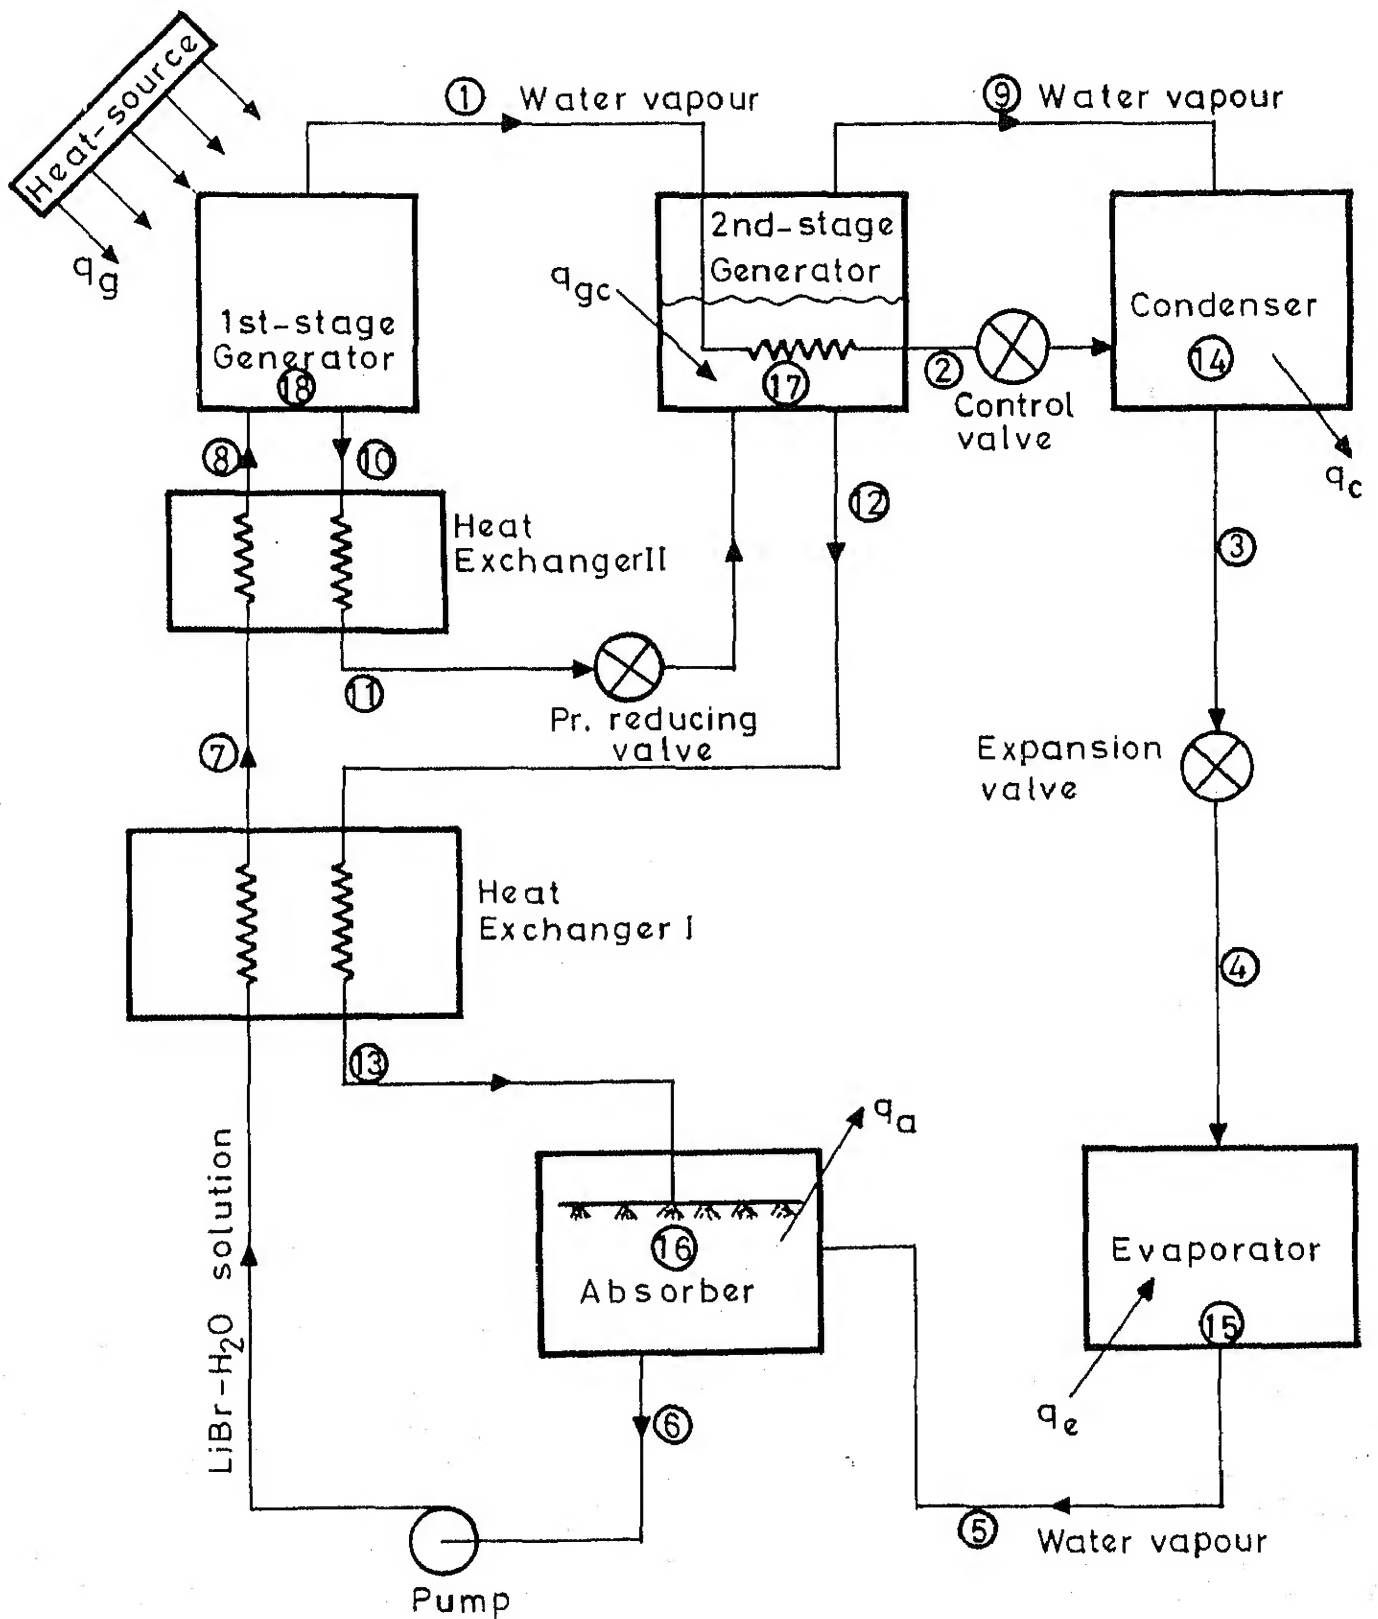


FIG. 1.4 SCHEMATIC DIAGRAM OF A DOUBLE-STAGE VAPOUR ABSORPTION SYSTEM (PRESENT WORK).

Comparison of the performance of this system is carried out with that of corresponding single-stage-vapour-absorption-system.

General computer programmes in FORTRAN language have been developed for both the single-stage and double-stage systems to evaluate the operational parameters (pressure, temperature, concentration, heat flow rates, mass flow rates of solution, refrigerant etc.), where-ever needed.

To emphasize the economic advantages of the double-stage LiBr-H₂O vapour absorption system, it's yearly operating cost has been compared with that of the vapour-compression-system of the same capacity. Suitable computer programme has been developed for this purpose. Operating cost includes the cost of power used in pumping the LiBr-H₂O solution and cooling water and also in raising the pressure level of the LiBr-H₂O solution from the absorber to the generator-I (Fig. 1.4).

For drawing graphs, 'LOTUS' subroutine in IBM personal computer has been used.

CHAPTER-II

SINGLE-STAGE-VAPOUR-ABSORPTION SYSTEM

2.1 DESCRIPTION OF THE SYSTEM:

The basic cycle of single-stage LiBr-H₂O vapour-absorption-system (Fig.1.2) consists of four temperature levels and two pressure level-zones.

Temperature level zones are :

- (i) Generator (T_g)
- (ii) Condenser (T_c)
- (iii) Absorber (T_a)
- (iv) Evaporator (T_e)

Pressure level zones are :

- (i) the low pressure prevailing in the evaporator and absorber.
- (ii) the high pressure prevailing in the generator and condenser.

In the system operation, the weak solution of LiBr-H₂O is pumped from the absorber to generator through a solution heat exchanger. In the generator, the solution is heated at high temperature (60-90°C), so that, some of the refrigerant i.e. water is vaporised from the LiBr-H₂O solution. The remaining solution, which is strong solution (due to lower percentage of water) returns back to the absorber through

the heat exchanger. In the heat exchanger, this solution transfers some of its heat to the weak solution, pumped from the absorber. A throttling valve is also provided to develop a pressure drop between generator and absorber ($p_g > p_a$).

The refrigerant vapour leaving the generator, passes to the condenser and is condensed, rejecting the heat of condensation to the circulating cooling water. The refrigerant-liquid in the condenser passes through the expansion valve and evaporates in the evaporator at very low pressure and temperature, extracting latent heat of vaporisation from the surroundings. It causes the cooling effect in the surrounding space. This vapour is then dissolved in the strong solution, returning back from the generator to absorber. This process produces heat of solution, which is carried away by the cooling water. After absorption, the weak solution is again pumped back to the generator. This completes the cycle of operation.

2.2 THERMODYNAMIC ANALYSIS OF THE SYSTEM :

A detailed thermodynamic analysis of the single-stage-absorption cycle has been carried out to evaluate the C.O.P. of the system. The following assumptions have been made :

- (i) the system is in a steady-state.
- (ii) the properties of the solution leaving a component are representative of the corresponding solution-properties in the component.

- (iii) pressure loss in the heat exchanger is neglected.
- (iv) minimum terminal temperature difference is 5°C in the heat exchanging components of the system.
- (v) pressures in the evaporator and condenser are equal to the vapour pressure of the refrigerant i.e. water, at the corresponding evaporator and condenser temperatures.

Thermodynamic Analysis :

- (1) The absorber-temperature and the condenser-temperature are fixed by the available cooling water temperature. The requirements of the conditioned space fixes the evaporator-temperature. Heat exchanger effectiveness is assumed to be 0.9 which is in the commonly used range of its value $\sqrt{10}$. The available heat-source-temperature determines the generator-temperature.
- (2) The generator and the condenser, being directly connected to each other, exhibit the same pressure in them, i.e. $p_g = p_c$. For similar reason, pressures in the evaporator and the absorber are also equal i.e. $p_e = p_a$.

The condenser pressure ' p_c ' as a function of condenser temperature ' T_c ' is given in expression (A-2) of Appendix-1 which describes the state equations

for aqueous LiBr solution. Since ' T_c ' is already known, ' P_c ' can be evaluated using (A-2). Similarly, from the prior knowledge of ' T_e ', ' P_e ' can be determined.

- (3) Using the already known values of absorber pressure and temperature, the concentration of LiBr-H₂O solution, leaving the absorber ' X_1 ' can be read from the graphs given in Appendix-2. Similarly, ' X_3 ', the concentration of the LiBr-H₂O solution, leaving the generator is obtained from the knowledge of generator pressure and temperature. Further as there is no change of concentration in the heat exchanger, we must have $X_1 = X_2$ and $X_3 = X_4$.

- (4) The conservation of mass for the working fluid in the generator is given by ;

$$\begin{aligned} &\text{rate of inflow of total mass to the generator } (\dot{m}_2) \\ &= \text{rate of outflow of total mass from the generator} \\ &\quad (\dot{m}_3 + \dot{m}_5) \end{aligned}$$

or,

$$\dot{m}_2 = \dot{m}_3 + \dot{m}_5 \quad (2.1)$$

Similarly, conservation of LiBr in the generator requires,

$$\dot{m}_2 X_2 = \dot{m}_3 X_3 \quad (2.2)$$

At this stage, a term, called the Absorption-Recirculation-Ratio (ARR) is defined. 'ARR' is the mass of solution, pumped to the generator per unit mass of water vapour, supplied to the condenser. The 'ARR' is represented in terms of mathematical expression as :

$$ARR = \frac{\dot{m}_2}{\dot{m}_5} \quad (2.3)$$

Using (2.1) and (2.2), the expression for ARR reduces to,

$$ARR = \frac{x_3}{x_3 - x_2} \quad (2.4)$$

(5) The conservation of total mass in the absorber gives,

$$\dot{m}_1 = \dot{m}_4 + \dot{m}_7 \quad (2.5)$$

Also, the conservation of LiBr in the absorber yields,

$$\dot{m}_1 x_1 = \dot{m}_4 x_4 \quad (2.6)$$

Another term, called the Generator-Recirculation-Ratio (GRR) is defined. 'GRR' is the ratio of mass of LiBr-H₂O solution, leaving the generator to the mass of water-vapour driven off from the generator.

Mathematically, 'GRR' is given by,

$$GRR = \frac{\dot{m}_3}{\dot{m}_5} = \frac{\dot{m}_4}{\dot{m}_7} \quad (2.7)$$

Using relations (2.5) and (2.6), the expression (2.7) reduces to ,

$$GRR = \frac{X_1}{X_4 - X_1} \quad (2.8)$$

- (6) The enthalpies of the fluid at various state points are to be determined in order to determine the heat loads on the various components in the system. In this context, enthalpies for LiBr-H₂O solution are obtained from the graph in Appendix-3 and the steam table [9] is used to get the enthalpy values for the refrigerant. Adopting this method, enthalpies at state points '1', '3', '5', '6' and '7' (Fig. 1.2) can be directly obtained. The corresponding enthalpies at state points '4', '2' are determined as following using the enthalpy values obtained above :

(a) Determination of H₄:

Heat-exchanger effectiveness is defined as :

$$\eta = \frac{\text{Enthalpy drop in the heat exchanger}}{\text{Maximum possible enthalpy drop in the same}}$$

or,

$$\eta = \frac{H_3 - H_4}{H_3 - H_1} \quad (2.9)$$

In the above expression, all the parameters are known, except H₄. Hence, H₄ can be evaluated by the relation :

$$H_4 = H_3 - \eta (H_3 - H_1) \quad (2.10)$$

(b) Determination of H_2 :

Energy-balance in the heat exchanger gives,

$$\dot{m}_3(H_3-H_4) = \dot{m}_1(H_1-H_2) \quad (2.11)$$

Since \dot{m}_3 and \dot{m}_1 are not known exclusively, both sides of expression (2.11) are divided by \dot{m}_5 . With this modification, expression (2.11) reduces to ,

$$\frac{\dot{m}_3}{\dot{m}_5} (H_3-H_4) = \frac{\dot{m}_1}{\dot{m}_5} (H_1-H_2) \quad (2.12)$$

Using expression (2.3) and (2.7) in (2.12), we get,

$$GRR (H_3-H_4) = ARR (H_2-H_1)$$

or,

$$H_2 = \frac{GRR}{ARR} (H_3-H_4) + H_1 \quad (2.13)$$

- (7) The heat transfer rates to and from the various system components can now be calculated by performing energy balance for each component :

- (a) The heat flow rate in the evaporator :

$$q_e = H_7-H_6 \quad (2.14)$$

- (b) Heat, to be rejected in the condenser :

$$q_c = H_5-H_6 \quad (2.15)$$

(c) Heat, to be supplied in the generator :

$$q_g = \dot{m}_5 H_5 + \dot{m}_3 H_3 - \dot{m}_2 H_2 \quad (2.16)$$

Assuming \dot{m}_5 as unity and dividing both sides of the expression (2.16) by \dot{m}_5 , we obtain,

$$q_g = H_5 + GRR \times H_3 - ARR \times H_2 \quad (2.17)$$

(d) Heat, to be rejected by the absorber :

$$q_a = \dot{m}_4 H_4 + \dot{m}_7 H_7 - \dot{m}_1 H_1 \quad (2.18)$$

Again, with necessary simplifications, we get,

$$q_a = GRR \times H_4 + H_7 - ARR \times H_1 \quad (2.19)$$

(8) For the total balance of energy in the system,

$$\text{Total heat addition} = \text{Total heat rejection}$$

or,

$$q_g + q_e = q_c + q_a \quad (2.20)$$

This condition is very much essential, to be satisfied.

The Coefficient of Performance of the system is

then given by

$$\text{C.O.P.} = \frac{q_e}{q_g} \quad (2.21)$$

The value of C.O.P., obtained by the above procedure is then compared with the C.O.P. of the ideal system to get an idea of how closely the system approaches the ideal cycle. The procedure to obtain C.O.P. of the ideal system is given below :

An ideal vapour-absorption-cycle can be considered as a combination of a power cycle and refrigeration cycle (Fig. 2.1). The power cycle receives energy in the form of heat q_g at an absolute temperature T_g , delivers some energy W in the form of work to the refrigeration cycle and rejects a quantity of energy q_a in the form of heat at a temperature T_a . The refrigeration cycle receives the work W which is pumped along with the heat q_e at the refrigerating temperature of T_e to a temperature T_c , where the quantity q_c is rejected.

The power-cycle, shown in Fig. (2.1), operates between the higher temperature limit T_g and the lower temperature limit T_a . Since, the analysis is carried out for an ideal cycle, the ideal thermal efficiency of this cycle is given by the Carnot's efficiency, which is represented as :

$$\begin{aligned} \eta_{\text{Power-cycle}} &= \frac{W}{q_g} \\ &= \frac{T_g - T_a}{T_g} \end{aligned} \quad (2.22)$$

Similarly, the refrigeration-cycle (Fig. 2.1), operates between sink temperature ' T_e ' and source temperature ' T_c '. For an ideal cycle, the C.O.P. is given by Carnot's C.O.P., represented as :

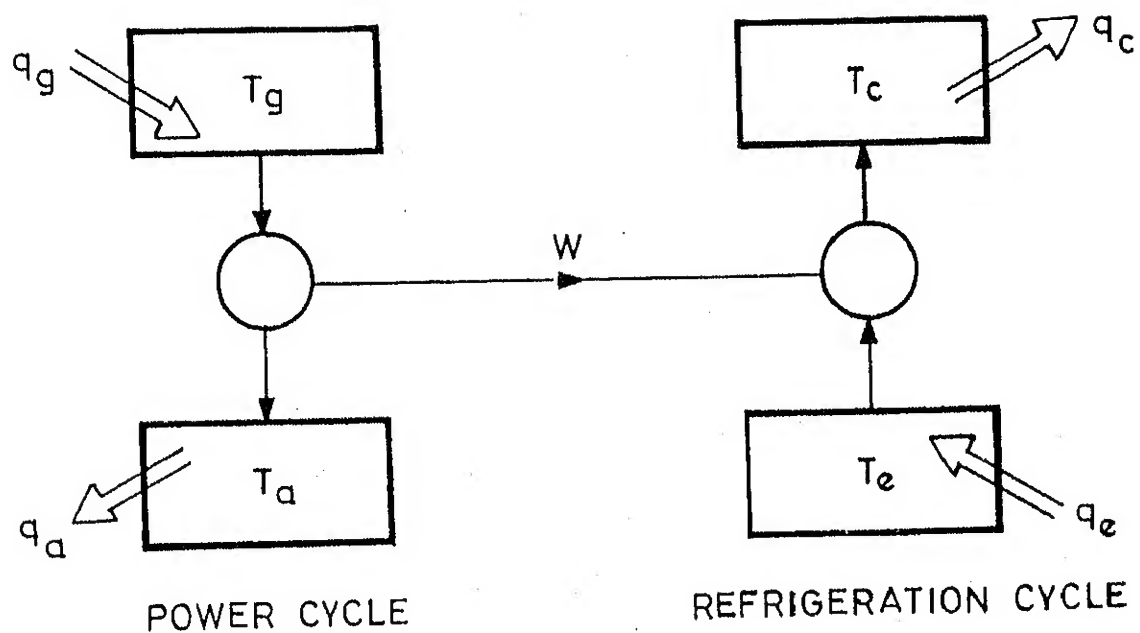


FIG. 2.1 HEAT-OPERATED REFRIGERATION CYCLE AS A COMBINATION OF A POWER CYCLE AND REFRIGERATION CYCLE.

$$\begin{aligned}
 \text{C.O.P.}_{\text{Ref}} &= \frac{q_e}{W} \\
 &= \frac{T_e}{T_c - T_e} \quad (2.23)
 \end{aligned}$$

The C.O.P. of the entire cycle is the multiple of $\eta_{\text{Power-cycle}}$ and $\text{C.O.P.}_{\text{Ref}}$ and is given by

$$\begin{aligned}
 \text{C.O.P.}_{\text{Ideal}} &= \eta_{\text{Power-cycle}} \times \text{C.O.P.}_{\text{Ref}} \\
 &= \frac{W}{q_g} \times \frac{q_e}{W} \\
 &= \frac{q_e}{q_g} \\
 &= \frac{T_e}{(T_c - T_e)} \cdot \frac{(T_g - T_a)}{T_g} \quad (2.24)
 \end{aligned}$$

2.3 COMPUTER PROGRAMME PACKAGE :

A computer programme has been developed to evaluate the C.O.P. of the single-stage-vapour-absorption-system, based on the thermodynamic analysis of the system described in section 2.2. Complete listing of this computer programme along with the description of the various input parameters and the execution commands on DECSYSTEM-1090 is given in Appendix-4.

The programme also includes the evaluation of pressure, temperature, concentration of LiBr-H₂O solution, enthalpy, mass flow rates of refrigerant and solution along with heat flow rates at various state points. The flow chart for the analysis is given in Fig. (2.2).

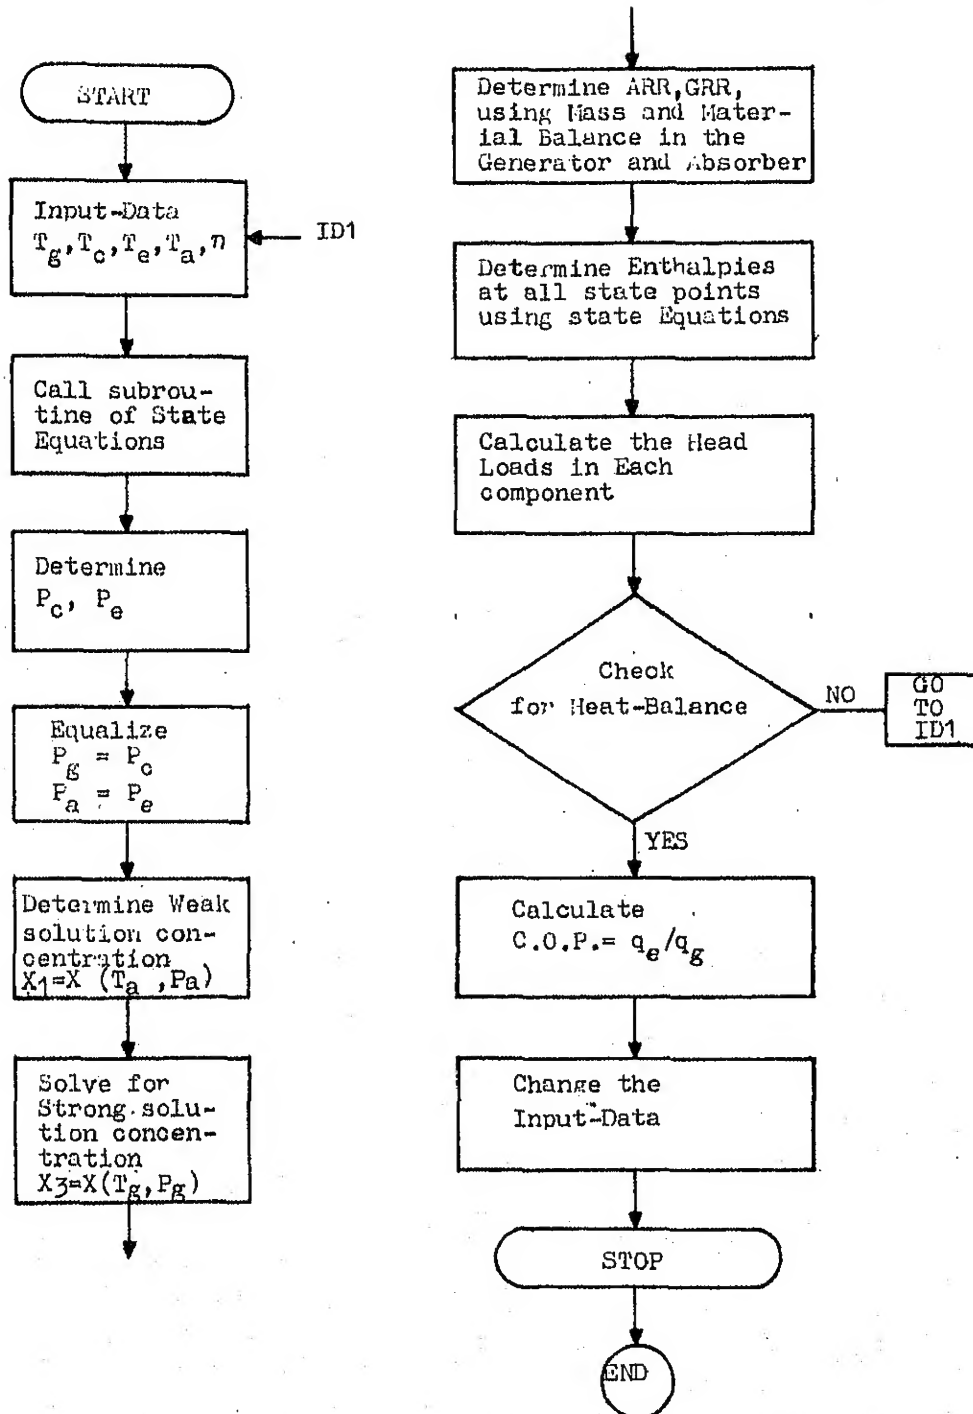


FIG.2.2 FLOW CHART FOR A SINGLE-STAGE-VAPOUR-ABSORPTION-SYSTEM.

CHAPTER-III

ANALYSIS AND COMPUTER MODELLING OF DOUBLE-STAGE-VAPOUR-ABSORPTION-SYSTEM

3.1 DESCRIPTION OF THE SYSTEM :

Fig. (1.4) shows schematic diagram of the proposed double-stage-vapour-absorption-system. It operates with five different temperature level zones and three distinct pressure zones, as following :

The temperature levels are those of

- (i) generator-I , (ii) generator-II, (iii) condenser,
- (iv) evaporator, (v) absorber

The pressure zones are :

- (i) the high pressure in the generator-I, determined by the saturation pressure corresponding to the refrigerant temperature in the generator-II. The zone indicates a pressure range of 50-70 KPa.
- (ii) the medium pressure in the condenser and generator-II, in the range of 3-5 KPa. It is the saturation pressure corresponding to the condenser-temperature.
- (iii) the low pressure prevailing in the evaporator and absorber, is determined by the saturation pressure corresponding to the evaporator-temperature. It ranges from 0.7 to 1 KPa.

Heat is supplied from the heat source (solar, bio-gas, hot-water, hot-air, industrial waste-heat etc.) to the generator-I for the system operation. This heats the weak solution of $\text{LiBr-H}_2\text{O}$, pumped from the absorber into the generator-I, through heat exchangers-I and II. A percentage of the refrigerant i.e. water evaporates out of this weak solution and gets condensed in the generator-II. The remaining $\text{LiBr-H}_2\text{O}$ solution in generator-I passes through heat exchanger-II and a pressure-reducing valve into the generator-II, where it receives latent heat from the refrigerant vapour evaporated out from generator-I. Some more percentage of refrigerant water from $\text{LiBr-H}_2\text{O}$ solution evaporates out and passes through the condenser. This evaporated water mixes with already condensed water coming out of the generator-II. Thus, the total amount of liquid refrigerant i.e. water leaving the condenser is the sum of the refrigerant originating from generators-I and II.

The refrigerant liquid from the condenser passes through an expansion valve, where its temperature and pressure lower down to the evaporator-temperature and pressure. In the evaporator, the refrigerant gets evaporated due to the latent heat of vaporisation, absorbed from the surroundings. This causes the cooling of space.

The cold vapours of the refrigerant, coming out of the evaporator are then dissolved in the strong solution of $\text{LiBr-H}_2\text{O}$,

collected in the absorber from the generator-II through the heat exchanger-I. A part of the heat of the strong solution of $\text{LiBr-H}_2\text{O}$ coming out of generator-II is transferred to the weak solution of $\text{LiBr-H}_2\text{O}$, pumped from the absorber. Also, when the strong solution of $\text{LiBr-H}_2\text{O}$ coming out of generator-II, mixes in the absorber with the low temperature and pressure water-vapour, coming out of the evaporator, it causes exothermic reaction and the heat so generated has to be rejected to the atmosphere by cooling the absorber. If the process of mixing is allowed to take place adiabatically (i.e. without rejecting the heat of absorption to the atmosphere), the temperature of the $\text{LiBr-H}_2\text{O}$ solution will rise in the absorber and, eventually, the absorption of low temperature and pressure water-vapour would not take place.

Once the strong $\text{LiBr-H}_2\text{O}$ solution mixes with the low temperature and pressure water-vapour in the absorber, the solution becomes weak and it is pumped out into the generator-I, as mentioned earlier. The pumping process elevates the pressure of the solution. Thus, the double-stage-vapour-absorption-cycle is completed.

3.2 THERMODYNAMIC ANALYSIS OF THE SYSTEM :

The thermodynamic analysis of the double-stage-vapour-absorption system is carried out to evaluate the system performance and other related parameters, such as pressure, temperature, concentration of solution, enthalpy, mass flow rate,

heat flow rate at various state points. The assumptions for the analysis are the same as those for the single-stage-absorption-system given in Sec.(2.2). The details of this analysis are as following :

Condenser pressure ' P_c ', evaporator pressure ' P_e ', generator-II pressure ' P_{g2} ', absorber pressure ' P_a ' and the concentration of LiBr-H₂O solution, leaving the absorber ' x_6 ' are the parameters which can be determined by using the same procedures as were adopted for the single-stage-vapour-absorption-system, described in Section (2.2).

In generator-II, the pressure ' P_{g2} ' is now known. Also, the source-temperature for heating the solution in generator-I and the solution temperature in this generator ' T_{g1} ' are known. Hence, in both the components viz generator-I and generator-II, one property only is known for the solution in each component. The thermodynamic principles, however, require the prior knowledge of two independent properties, in order to define the state of solution uniquely. But the determination of second property for the solution in both generator-I and generator-II, presents a problem, which is solved by adopting the following procedure :

First of all, the concentration of LiBr-H₂O solution ' x_{12} ' leaving the generator-II is assumed. Since, the ' P_{g2} '

in the generator-II is already known, ' P_{g2} ' and ' X_{g2} ' i.e. ' X_{12} ' are the two properties which fix the thermodynamic state of the solution. Therefore, the solution temperature leaving generator-II can be determined by using Appendix-2. Assuming a terminal temperature difference of 5°C between the refrigerant vapour coming from generator-I ' T_{r1} ' and the solution temperature ' T_{g2} ', for heat-transfer between the two fluids, ' T_{r1} ' can also be determined. Using Appendix-2, the vapour pressure of the refrigerant corresponding to temperature ' T_{r1} ' can be directly read. This pressure ' P_{g1} ' corresponds to the pressure in generator-I. Since ' T_{g1} ' is already known, the concentration of the LiBr- H_2O solution ' X_{10} ', leaving generator-I can be evaluated with the help of Appendix-2.

We now use the mass, material (LiBr), heat and energy balances in the following components of the system. The details of which are presented below :

(a) Generator-I

Mass balance :

$$\dot{m}_8 = \dot{m}_1 + \dot{m}_{10} \quad (3.1)$$

Material balance (LiBr Conservation) :

$$\dot{m}_8 X_8 = \dot{m}_{10} X_{10} \quad (3.2)$$

(b) Generator-II

Mass balance :

$$\dot{m}_{11} = \dot{m}_{12} + \dot{m}_9 \quad (3.3)$$

Material balance :

$$\dot{m}_{11} X_{11} = \dot{m}_{12} X_{12} \quad (3.4)$$

Energy balance :

$$\dot{m}_1 (H_1 - H_2) = \dot{m}_{12} H_{12} + \dot{m}_9 H_9 - \dot{m}_{11} H_{11} \quad (3.5)$$

(c) Heat-Exchanger-I

Heat balance :

$$\dot{m}_6 (H_7 - H_6) = \dot{m}_{12} (H_{12} - H_{13}) \quad (3.6)$$

Heat exchanger effectiveness :

$$\begin{aligned} \eta_1 &= \frac{\text{Useful enthalpy drop}}{\text{Maximum possible enthalpy drop}} \\ &= \frac{H_{12} - H_{13}}{H_{12} - H_6} \end{aligned} \quad (3.7)$$

(d) Heat-Exchanger-II

Heat balance :

$$\dot{m}_7 (H_8 - H_7) = \dot{m}_{10} (H_{10} - H_{11}) \quad (3.8)$$

Heat exchanger effectiveness

$$\eta_2 = \frac{H_{10} - H_{11}}{H_{10} - H_7} \quad (3.9)$$

(e) Absorber

Mass balance :

$$\dot{m}_6 = \dot{m}_5 + \dot{m}_{13} \quad (3.10)$$

Material balance :

$$\dot{m}_6 X_6 = \dot{m}_{13} X_{13} \quad (3.11)$$

(f) Condenser

Mass balance :

$$\dot{m}_9 + \dot{m}_2 = \dot{m}_3 \quad (3.12)$$

In expressions (3.1) to (3.12), the parameters

' H_1 ', ' H_2 ', ' H_5 ', ' H_6 ', ' H_9 ', ' H_{10} ', ' H_{12} ', ' X_6 ', ' η_1 ' and ' η_2 ' are known.

When these known parameters are substituted in the above expressions, they generate a set of six independent equations in six unknown variables, which are as following :

$$\dot{m}_1 (H_1 - H_2) = \dot{m}_{12} H_{12} + \dot{m}_9 H_9 - \dot{m}_{11} H_{11} \quad (3.13)$$

$$\dot{m}_7 (H_8 - H_7) = \dot{m}_{10} (H_{10} - H_{11}) \quad (3.14)$$

$$\dot{m}_{12} (H_{12} - H_{13}) = \dot{m}_7 (H_7 - H_6) \quad (3.15)$$

$$\dot{m}_{11} = \dot{m}_9 + \dot{m}_{12} \quad (3.16)$$

$$\dot{m}_3 = \dot{m}_1 + \dot{m}_9 \quad (3.17)$$

$$H_{10} - H_{11} = \eta_2 (H_{10} - H_7) \quad (3.18)$$

The unknown variables in the expressions (3.13) to (3.18) are :

' \dot{m}_1 ', ' \dot{m}_9 ', ' \dot{m}_{12} ', ' H_7 ', ' H_8 ' and ' H_{11} '

Simultaneous solution of equations (3.13) to (3.18) is then obtained with the help of MATRIX INVERSION METHOD . This solution yields all the unknown parameters.

Using expressions (3.1) and (3.2), the Generator-Recirculation-Ratio, 'GRR' defined in Section (2.2), for the present system is given by ,

$$\begin{aligned} \text{GRR} &= \frac{\text{Mass of LiBr-H}_2\text{O solution, leaving the generator-I}}{\text{Mass of water-vapour driven off from the generator-I}} \\ &= \frac{\dot{m}_{10}}{\dot{m}_1} \\ X &= \frac{x_8}{x_{10} - x_8} \\ \therefore \frac{\dot{m}_{10}}{\dot{m}_1} &= \frac{x_8}{x_{10} - x_8} \quad (3.19) \end{aligned}$$

All the variables in the above expression are known except \dot{m}_{10} , which can be easily determined.

Expression (3.4) for LiBr balance in generator-II is represented as :

$$\dot{m}_{11} X_{11} = \dot{m}_{12} X_{12} \quad (3.20)$$

Since,

$$\dot{m}_{11} = \dot{m}_{10} ,$$

and ,

$X_{11} = X_{10}$, the expression (3.20) reduces to ,

$$\dot{m}_{10} X_{10} = \dot{m}_{12} X_{12}$$

or,

The concentration X_{12} of the LiBr-H₂O solution is given by,

$$X_{12} = \frac{\dot{m}_{10} X_{10}}{\dot{m}_{12}} \quad (3.21)$$

All the parameters on the R.H.S. of the above expression are known and, hence, using (3.21), X_{12} can be determined.

This calculated value of ' X_{12} ' is then compared with the value of this parameter, assumed to be known initially. If they are not in close agreement with each other, then a different value of ' X_{12} ' is assumed and the above procedure is repeated, till the difference between the assumed and calculate value of ' X_{12} ' becomes negligible.

The system performance, represented by C.O.P. is then obtained as :

$$\begin{aligned} \text{C.O.P.} &= \frac{\text{Refrigerating effect in the evaporator}}{\text{Heat supplied in the generator-I}} \\ &= \frac{\dot{m}_4 (H_5 - H_4)}{\dot{m}_{10} H_{10} + \dot{m}_1 H_1 - \dot{m}_8 H_8} \end{aligned} \quad (3.22)$$

The overall heat-balance of the complete system is performed, which corroborates the correctness of the solution-method presented above. The heat balance equations for various components are :

(i) Heat addition in generator-I :

$$q_{g1} = \dot{m}_{10} H_{10} + \dot{m}_1 H_1 - \dot{m}_8 H_8 \quad (3.23)$$

(ii) Heat transfer in generator-II :

$$\begin{aligned} q_{g2} &= \dot{m}_1 (H_1 - H_2) \\ &= \dot{m}_{12} H_{12} + \dot{m}_9 H_9 - \dot{m}_{11} H_{11} \end{aligned} \quad (3.24)$$

(iii) Heat rejection in condenser :

$$q_c = \dot{m}_9 H_9 + \dot{m}_2 H_2 - \dot{m}_3 H_3 \quad (3.25)$$

(iv) Heat extracted in the evaporator:

$$q_e = \dot{m}_4 (H_5 - H_4) \quad (3.26)$$

(v) Heat rejection in the absorber :

$$q_a = \dot{m}_{13} H_{13} + \dot{m}_5 H_5 - \dot{m}_6 H_6 \quad (3.27)$$

The final heat balance is given by,

Total heat inflow into the system

= Total heat outflow from the system

or,

$$q_e + q_{g1} = q_c + q_a \quad (3.28)$$

This completes the thermodynamic analysis of the proposed double-stage-vapour-absorption-system.

3.3 COMPUTER MODELLING :

A computer programme package given in Appendix-5 has been developed on the basis of the thermodynamic analysis given above. The complete logic, which forms the basis for the development of the programme has been mentioned in the flow-chart, given in Fig. (3.1). Various subroutines developed to solve state equations of LiBr-H₂O solution and refrigerant along with other parameters are given in Section (3.3.1).

Newton-Raphson's Numerical Technique (Sec. 3.3.2) has been used to solve the non-linear algebraic equations in the problem. Subroutines, given by Numerical Algorithm Group (NAG), are employed to solve the simultaneous linear equations. The programme has been made very general to encompass a class of similar problems, which can be solved by simply changing input variables in the parent programme.

3.3.1 Subroutines for solving state equations :

The various subroutines developed for solving the thermodynamic state equations (Appendix-1) for the LiBr-H₂O solution and refrigerant are given below :

- (i) subroutine for the pressure of saturated refrigerant vapour when its temperature is known :

$$P = P (TR) \quad (3.29)$$

- (ii) subroutine for the concentration of the solution when its temperature and refrigerant temperatures are known :

$$X = X (TS, TR) \quad (3.30)$$

- (iii) subroutines for the concentration of the solution when refrigerant temperature and pressure are known :

$$X = X (P, TR) \quad (3.31)$$

- (iv) subroutine for enthalpy of solution, when solution temperature and concentration are known.

$$H = H (TS, X) \quad (3.32)$$

- (v) subroutine for the solution temperature when its enthalpy and concentration are known.

$$TS = TS (H, X) \quad (3.33)$$

3.3.2 Algorithm, Newton-Raphson Technique :

The Newton-Raphson iterative technique is used for solving higher-order, non-linear algebraic equations, as follows :

A function $f(X)$, which is continuous and has a continuous derivative is given. Also given is a starting value X_0 (the concentration of LiBr-H₂O solution in the present case).

For $n = 1, 2, \dots$ until termination, do :

compute $f'(X_n)$

If $f'(X_n) = 0$, signal and stop.

Else, compute

$$X_{n+1} = X_n - \frac{f(X_n)}{f'(X_n)} \quad (3.34)$$

till difference between the values X_{n+1} and X_n tends to zero.

The termination criterion used for iteration :

After N steps (N assumed, fixed)

or,

$$|X_{n+1} - X_n| \leq \varepsilon \quad (\varepsilon > 0, \text{ given})$$

or,

$$|f(X_n)| \leq \alpha \quad (\alpha > 0 \text{ given})$$

Stop.

The flow-chart for the analysis is given in Fig. (3.1).

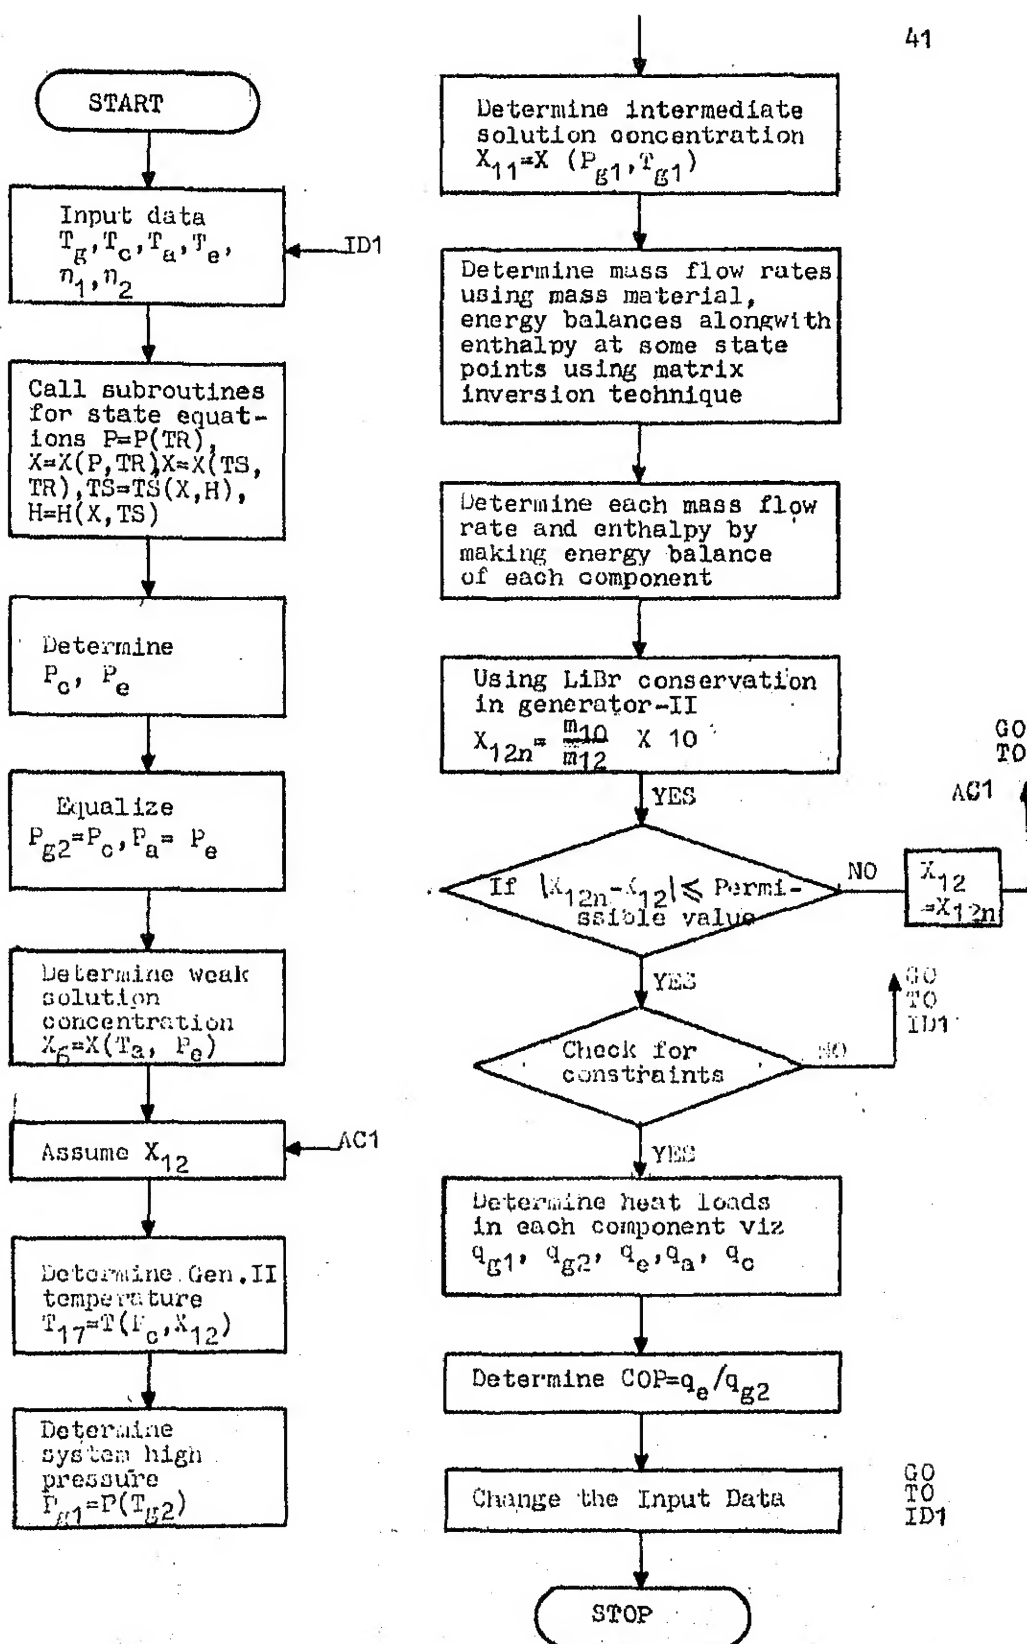


FIG.3.1 FLOW-CHART FOR COMPUTER MODELLING OF
A DOUBLE-STAGE-VAPOUR-ABSORPTION-SYSTEM

CHAPTER- IV

ECONOMICS OF VAPOUR ABSORPTION AND VAPOUR-COMPRESSION SYSTEMS

OPERATIONAL COST :

A comparative cost-analysis is carried out to study the relative economics of the present system with its most competing alternative i.e. the-vapour-compression-system. As a case-study, the air-conditioning unit, installed at I.I.T. Kanpur which operates on a vapour-compression -cycle having R-22 as refrigerating fluid has been considered. The detailed data for the air-conditioning unit are presented in Appendix 6. The total cost of any of the above two system involves the following two costs :

- (i) first cost,
- (ii) running or operational cost.

It has been reported.in Reference [20] that the first cost of the two system is almost the same. We shall, therefore, compare only the running cost of the two systems.

The running cost of the vapour-compression-system consists of the following :

- (a) Cost of the electrical energy used for pumping cooling-water in the condenser.

Since, the condenser heat load in both the systems vary, the electrical energy used will also be different for the two systems. This has been discussed in detail later.

- (b) Cost of the electrical energy, required for circulating the chilled water in the evaporator.

As the cooling capacity of the evaporator in both the system is taken as the same, the electrical energy used for the purpose, will be the same for both the systems. Hence its contribution has not been considered.

- (c) Cost of the electrical-energy consumed in the compressor.

Contribution of this cost is maximum in running the compression-system. Its inclusion for evaluating the total running cost of the system is, therefore a must.

Details of the method for obtaining the total running cost of the vapour-compression-system is presented as follows :

Capacities of the condenser pumps and compressors, used in the system and considered for the case study are reported in (Appendix-6).

Suppose,

PWR_P = Total power of the condenser-pumps [KW]

$$PWR_c = \text{Total power of the compressors [KW]}$$

Hence,

Total power requirement of the complete system will be given by,

$$\text{Total power} = PWR_T = PWR_P + PWR_c \quad (4.1)$$

Annual electrical energy consumption, considering continuous running of the system is then represented as ,

$$(AEC)_{VCS} = PWR_T \times 24 \times 365 \text{ [KW-hr]} \quad (4.2)$$

In the above expression, 'AEC' represents the 'ANNUAL ENERGY CONSUMPTION' and the subscript 'VCS' stands for the vapour-compression-system.

Let the cost of electrical energy be denoted by 'Cen' in [Rs/KW.hr].

The total cost involved in meeting the running cost of the system annually is, then, given by ,

$$(TRC)_{VCS} = (AEC)_{VCS} \times Cen \quad (4.3)$$

where,

TRC represents the total running cost involved.

The total running-cost of the double-stage-vapour-absorption-system (DSVAS) is then obtained as following :

Factors, affecting the running cost of the system are :

- (1) Cost of the electrical energy, consumed for pumping cooling-water in the condenser.
- (2) Cost of the electrical energy, required for the solution-pump to raise the pressure of the LiBr-H₂O solution from the absorber pressure to generator pressure.

The cost-element, given in (1) is determined as follows :

The mass flow rate of the cooling-water is determined by using the relation :

$$q_c = \dot{m}_w \times C_{PW} \Delta T \quad (4.4)$$

In the above expression, ' q_c ', ' C_{PW} ' and ' ΔT ' are known parameters. ' q_c ' is condenser heat load obtained numerically using the computer programme given in Appendix -5; C_{PW} the specific heat of water, is taken from the table given in [18_7]; ΔT is the allowable temperature rise in the condenser which has been assumed as 6°C in our case (Appendix-6). Hence the unknown parameter \dot{m}_w is determined from the expression (4.4).

The volume flow rate of cooling-water i.e. Q through the condenser is then given by,

$$Q = \frac{\dot{m}_w}{\rho_w} \quad (4.5)$$

The pressure-drop ' ΔP ' through the condenser tube is calculated as following :

$$p = \frac{fL V_w^2}{2 d_i} \rho_w \quad (4.6)$$

In the above expression, ' L ', ' V_w ' and ' f ' represent the length of tubes, velocity of water and the friction factor respectively. Details of the methods for their determination are discussed below:

Length of condenser tubes :

The condenser heat load q_c is given by the relation,

$$q_c = U_o \times A_o \times \text{LMTD}$$

$$\therefore A_o = \frac{q_c}{U_o \times \text{LMTD}} \quad (4.7)$$

$$\text{LMTD} = \frac{\Delta T_i - \Delta T_o}{\ln \frac{\Delta T_i}{\Delta T_o}} \quad (4.8)$$

The overall heat transfer coefficient U_o is given by

$$\begin{aligned} U_o &= \frac{1}{R_o + R_t + R_{ff} + R_i} \\ &= \frac{1}{\frac{1}{h_{con}} + \frac{b}{k d_m} + \frac{d_o}{h_{ff} d_i} + \frac{1}{h_w} \frac{d_o}{d_i}} \end{aligned} \quad (4.9)$$

Where,

h_{con} = the mean condensing coefficient for vapour
condensing on the outside of horizontal tube is

$$= 0.725 \left(\frac{g \rho_w^2 H_{fg} K_w^3}{\mu t N d_o} \right)^{0.25} \quad [9_7] \quad (4.10)$$

K_w = conductivity of water

μ = viscosity of water

N = number of tubes in one vertical row, assumed
to be 3 as explained in [9_7]

d_o = outer dia of tube, assumed to be 18 mm (Appendix-6)

H_{fg} = Latent heat of vaporisation of water

t = temperature difference between the vapour and
surface of the tube (initially assumed for
iteration purpose as 5°C)

h_{ff} = fouling factor taken

$$= 0.00176 \text{ (m}^2\text{K/W) , [Reference-19_7]}$$

d_i = inner dia of tube, assumed to be 16 mm (Appendix-6)

d_m = mean diameter

$$= \frac{d_o + d_i}{2}$$

b = thickness of tube

$$= \frac{d_o - d_i}{2}$$

K_m = conductivity of tube material

h_w = water-side heat transfer coefficient *

After substituting all the parameters in expression (4.9), the overall heat transfer coefficient U_o is obtained.

Now all the terms on the R.H.S. of expression (4.7) are known. Hence A_o can be determined from the above expression.

Also, the condenser load is given by ,

$$q_c = h_{con} \times A_o \times \Delta t \quad (4.11)$$

$$\therefore \Delta t = \frac{q_c}{h_{con} \times A_o} \quad (4.12)$$

If the calculated value of t does not match with its assumed value in expression (4.10), new value of Δt is assumed and the entire procedure to calculate A_o is repeated. The calculations are terminated, when the difference between the assumed and the calculated value of t is negligible.

* The expression for the heat transfer coefficient for fluids flowing inside tubes, i.e. water in this case, is of the form

$$Nu = C (Re)^n (Pr)^m$$

where, n and m are exponents. The constant C and exponents in the above expression are given by,

$$\frac{h_w d_i}{K_w} = 0.023 \left(\frac{V d_i \rho_w}{\mu} \right)^{0.8} \times \left(\frac{C_p}{K} \right)^{0.8} \quad \text{[Reference-9_7]}$$

The total outer area of tubes, is also given by,

$$A_o = \pi \times d_o \times L \quad (4.13)$$

where,

L is the total length of tubes.

$$\therefore L = \frac{A_o}{\pi d_o} \quad (4.14)$$

Thus, the required total length of the tubes, used in the condenser, is known.

Velocity of water in tube :

The velocity of water V_w is obtained from the relation

$$V_w = \frac{Q}{\frac{\pi}{4} \times d_i^2} \quad (4.15)$$

where, Q is the volume flow rate of water, obtained in expression (4.5).

Friction-factor :

The friction-factor is given by [17],

$$f = \frac{1}{1.14 + 2 \log \frac{d_i}{\epsilon} - 2 \log \left[1 + \frac{9.3}{\text{Re}(\epsilon/d_i) \sqrt{f}} \right]}^2 \quad (4.16)$$

where,

' ϵ ' is absolute roughness of pipe material
given in Appendix -7.

Re is given by

$$Re = \frac{V_w d_i \rho_w}{\mu} \quad (4.17)$$

Since, the equation (4.16) is implicit in ' f ', Newton-Raphson numerical technique (Sec. 3.4) is adopted to solve this equation and to obtain the value of ' f '.

The pressure drop ' Δp ' can then be easily obtained, using expression (4.6).

The power required for pumping is then given by,

$$(PWR)_{cond} = \Delta p \times Q \quad (4.18)$$

In the above expression, the subscript $cond$ stands for condenser .

The annual cost of the electrical energy represented as $(TRC)_{cond}$ is then expressed as :

$$(TRC)_{cond} = (PWR)_{cond} \times 24 \times 365 \times C_{en} \quad (4.20)$$

where,

' C_{en} ' is the cost of electrical energy in Rs./KW-hr.

The second running cost-element i.e. the cost of electrical energy required for the solution pump to raise the pressure. Referring to Fig. (1.4), the pressure against which

the the solution pump has to work, comprises of the following pressure drops :

- (i) pressure difference between the generator and absorber (Δp_1),
- (ii) pressure drop in solution heat-exchanger-I (Δp_2) and
- (iii) pressure drop in solution heat-exchanger-II (Δp_3)
- (iv) pressure drop in pipe length (Δp_4)

P_1 is determined by using the relation

$$P_1 = P_{g1} - P_a \quad (4.21)$$

where,

P_{g1} = generator-I pressure,

P_a = absorber pressure

P_{g1} and P_a are known from Appendix -5

Δp_2 and Δp_3 are evaluated by following the same procedure as adopted for obtaining Δp of expression (4.1) for condenser cooling-water. The properties of LiBr-H₂O solution, given in Reference [26], are however used now, instead of the properties of water.

The pressure drop Δp_4 in pipe length can be neglected as it is negligible as compared to above pressure drops.

CENTRAL LIBRARY

I. I. T., Kanpur.

Acc. No. A 97962

The total pressure drop which is to be supplied by the solution pump is therefore, given as :

$$\Delta P_T = \Delta P_1 + \Delta P_2 + \Delta P_3 \quad (4.22)$$

From the knowledge of P_T , the power required for solution pump $(PWR)_{SP}$ can be determined as :

$$PWR_{SP} = \Delta P_T \times Q_S \quad (4.23)$$

where,

Q_S = solution flow rate, obtained from Appendix-5.

Total running cost for solution pump can be expressed as :

$$(TRC)_{SP} = (PWR)_{SP} \times 365 \times 24 \times C_{en} \quad (4.24)$$

The total running cost, incurred annually for the complete system operation of double-stage-vapour-absorption-system is given by,

$$(TRC)_{DSVAS} = (TRC)_{cond} + (TRC)_{SP} \quad (4.25)$$

where,

$(TRC)_{DSVAS}$ stands for the total running cost of the double-stage-vapour-absorption-system, incurred annually.

A complete computer-programme on DEC-1090, given in Appendix-8, has been developed to solve the above problem and obtain the total running-cost of the two systems. From the programme, we obtain

$$(a) \quad (TRC)_{DSVAS} = \text{Rs. } 3,73,350.00$$

$$(b) \quad (TRC)_{VCS} = \text{Rs. } 8,08,000.00$$

Therefore the annual saving in running cost with the double-stage-vapour-absorption-system as compared to vapour-compression-system is given by,

$$(c) \quad \begin{aligned} \text{Annual saving} &= (TRC)_{VCS} - (TRC)_{DSVAS} \\ &= \text{Rs. } 4,34,650.00 \end{aligned}$$

or

$$(d) \quad \text{Daily saving} = \text{Rs. } 1,190.00$$

$$(e) \quad \text{Percentage saving} = 53.8 \%$$

CHAPTER-V

RESULTS AND DISCUSSION

Computer modelling of a double-stage-vapour-absorption-system, using thermodynamic equations of state, has been developed to determine the feasibility and economy of its operation. DEC-1090 computer with FORTRAN as coding language has been used for executing the programme. A numerical model of one-stage-vapour-absorption-system has also been developed to compare its relative performance with that of a double-stage-system.

The results of the above analyses have been presented in Tables 1.11. On the basis of the data obtained from these tables, figures (5.1 - 5.11) have been drawn.

Figures (5.2-5.4) show the variation of C.O.P. with generator-I temperature for both the systems. Also, the minimum temperatures at which double-stage-absorption-system starts operating for different cooling water temperatures, have been shown. It is observed that this system starts working at a minimum temperature of 70°C , when cooling water temperature is 20°C and at about 90°C for cooling water-temperature of 35°C .

An interesting result is observed from Fig. (5.3). The crystallization of $\text{LiBr-H}_2\text{O}$ solution begins at around 91°C for a single-stage-system. But, this is the range of temperature, at which a double-stage-vapour-absorption-system starts working. This establishes the fact that when the single-stage-vapour-absorption-system stops functioning, the double-stage-system starts operating. Figs.(5.2-5.4) show that the maximum value of C.O.P. obtained in the double-stage-system is almost twice the value of the corresponding single-stage-system (~ 1.7 as compared to ~ 0.85). This is due to the fact that about 80-90 % of the energy input in the generator-I is recovered as the heat of condensation in generator-II, to further drive off the refrigerant vapour, which otherwise would have been wasted in the condenser.

As C.O.P. is the index of effectiveness of the system, it depicts that a double-stage-vapour-absorption-system has almost half the energy consumption per unit cooling achieved ; in comparison to a single-stage-system.

The variation of generator-I temperature V/S C.O.P. in a double-stage-system shown in Fig. (5.1) reveals that, upto a certain increase in generator-I temperature, C.O.P. also increases and afterwards it starts decreasing. The optimum value of generator-I - temperature for maximum C.O.P. can, therefore, be obtained. The optimum value of generator-I

temperature is different for different condensing and evaporating temperatures. From Figure (5.1), it is obvious that for 20°C as condenser-temperature and 5°C as evaporator temperature, the optimum value of generator-I-temperature is 79°C and for 25°C as condenser temperature and 5°C as evaporator temperature, the optimum generator-I-temperature for maximum C.O.P. is 88°C . Maximum C.O.P. is 1.785 in this case.

C.O.P. of the double-stage-vapour-absorption-system falls with the increase in the absorber-temperature. Reduction in C.O.P. is less, initially, but after a certain value of the absorber-temperature, the curve becomes quite steep. This is due to the fact that at higher absorber-temperature, absorption capacity of $\text{LiBr-H}_2\text{O}$ solution to absorb the refrigerant vapour coming from the evaporator decreases. The reduction in the absorption capacity requires more solution to flow for absorbing a given amount of refrigerant. Therefore, more heat is needed in generator-I to extract the refrigerant from the solution.

Figures (5.5-5.6) show that with the increase in condenser-temperature, C.O.P. decreases. However, the rate of reduction is less than that of reduction in C.O.P. with absorber-temperature Fig. (5.8). It shows that variation in C.O.P. is much more sensitive to the absorber-temperature than the condenser-temperature.

At high condensing temperatures such as at atmospheric temperature of water or air, the double-stage-system performs efficiently (Fig. 5.6). Hence, the cooling of condenser can be performed at atmospheric temperature of water or air. The need of a cooling tower, which is generally used to reduce the cooling-water temperature, can therefore be eliminated.

The effectiveness of the heat exchangers-I and II have a significant effect on the C.O.P. With the increase in the effectiveness, the C.O.P. increases (Fig. 5.10) and varies between 1.325 to 1.778 for the corresponding effectiveness 0.5 to 1.0 of heat exchanger-I and II.

Figure 5.9 shows that generator-I heat load first decreases rapidly with the increase in generator-I-temperature, but afterwards it increases slightly. The inversion point of this curve corresponds to the maximum C.O.P. of the double-stage-system. This amounts to conclude that at the optimum generator-I-temperature, the heat load required to be supplied in generator-I is minimum.

Since the double-stage-system uses low grade heat energy for its operation as compared to high grade mechanical energy used by vapour-compression-system, the former has the potential advantages over the later, as far as the operational costs of the

systems are concerned. For the same system capacity of 550 tons that has been studied in the present work, as an case study, the yearly saving achieved in the running cost of a double-stage-vapour-absorption-system is approximately 4.35 lakhs over the vapour-compression system.

Numbers at top of each column in the tables (1-4) denote the following parameters :

1. Serial No;
2. Generator-I temperature ($^{\circ}\text{C}$) ;
3. Generator-II temperature ($^{\circ}\text{C}$) ;
4. Generator-I load (KW) ;
5. Evaporator load (KW) ;
6. Generator-II load (KW) ;
7. Weak-solution concentration
(Kg LiBr/Kg of solution) ;
8. Intermediate-solution concentration
(Kg LiBr/Kg of solution) ;
9. Strong solution concentration
(Kg LiBr/Kg of solution) ;
10. C.O.P., Double-stage ;
11. C.O.P., Single-stage ;
12. C.O.P., Ideal, absorption cycle
- Cry. Crystallization
- ONP Operation not possible

Number at top of each column in the Tables (5-11) denote the following parameters :

- 1 Serial No.
- 2 Variable indicated in the table column
- 3 Generator-II temperature ($^{\circ}\text{C}$) ;

- 4 C.O.P. (Double-stage)
- 5 C.O.P. (Single-stage)
- 6 C.O.P. (Ideal-cycle)

For the Table. 12 the numbers at the top of column denote;

- 1 Serial No.
- 2 Heat-Exchanger Effectiveness
- 3 C.O.P. (Double-stage)
- 4 C.O.P. (Single-stage)

TABLE -1

Effect of Generator-I Temperature on operating parameters

($T_c = 20^\circ\text{C}$, $T_a = 20^\circ\text{C}$, $T_e = 5^\circ\text{C}$, $\eta_1 = \eta_2 = 0.90$)											
1	2	3	4	5	6	7	8	9	10	11	12
1	52.0									.8395	
2	58.0									.8349	
3	64.0									.8314	
4	70.0	47.1	9.985	17.747	9.064	45.76	48.19	50.60	1.77	.8295	2.702
5	73.0	49.2	9.952	17.747	9.081	45.76	48.73	51.70	1.780	.8276	2.839
6	76.0	51.0	9.942	17.747	9.097	45.76	49.20	52.80	1.785	Cry.	2.974
7	79.0	52.8	9.945	17.747	9.111	45.76	49.76	49.64	53.90	1.786	3.107
8	82.0	55.0	9.946	17.747	9.122	45.76	50.14	54.90	1.785		3.237
9	85.0	57.0	9.954	17.747	9.132	45.76	50.60	55.90	1.781		3.365
10	88.0	59.0	9.966	17.747	9.143	45.76	51.02	56.90	1.779		3.491
11	91.0	60.6	9.975	17.747	9.149	45.76	51.53	57.80	1.778		3.615
12	94.0	62.6	9.994	17.747	9.161	45.76	51.89	58.90	1.776		3.737
13	97.0	64.7	10.008	17.747	9.167	45.76	52.35	59.70	1.772		3.857
14	100.0	66.4	10.025	17.747	9.174	45.76	52.77	60.60	1.770		3.975

TABLE-2

Effect of Generator-I Temperature on operating parameters

($T_e = 25^\circ\text{C}$, $T_a = 20^\circ\text{C}$, $T_e = 5^\circ\text{C}$, $n_1 = n_2 = 0.90$)											
1	2	3	4	5	6	7	8	9	10	11	12
1	52.0									.8277	1.396
2	58.0									.8271	1.483
3	64.0									.8247	1.596
						ONP					
4	70.0	48.8	10.378	17.594	9.067	45.76	47.06	48.20	1.695	.8216	1.706
5	73.0	50.7	10.204	17.594	9.087	45.76	47.60	49.40	1.724	.8210	1.815
6	76.0	52.7	10.109	17.594	9.099	45.76	48.17	50.50	1.740	.8196	1.922
7	79.0	54.5	10.069	17.594	9.109	45.76	48.69	51.60	1.747	.8180	2.026
8	82.0	56.6	10.054	17.594	9.120	45.76	49.16	52.70	1.750	Cry	2.427
9	85.0	58.5	10.041	17.594	9.128	45.76	49.68	53.70	1.752		2.524
10	88.0	60.4	10.040	17.594	9.135	45.76	50.17	54.70	1.752		2.618
11	91.0	62.1	10.047	17.594	9.144	45.76	50.62	55.70	1.751		2.711
12	94.0	64.1	10.059	17.594	9.153	45.76	51.03	56.70	1.749		2.803
13	97.0	66.1	10.074	17.594	9.163	45.76	51.40	57.70	1.746		2.893
14	100.0	68.0	10.086	17.594	9.168	45.76	51.86	58.60	1.742		2.981

TABLE -3

Effect of Generator-I Temperature on operating parameters

		$(T_c = 30^\circ\text{C},$			$T_a = 25^\circ\text{C},$			$T_e = 5^\circ\text{C},$			$\eta_1 = \eta_2 = 0.90)$		
1	2	3	4	5	6	7	8	9	10	11	12		
1	55.0									.7360	1.106		
2	61.0									.7998	1.186		
3	67.0									.8086	1.374		
4	73.0									.8115	1.459		
5	79.0									.8093	1.706		
					ONP								
6	82.0	56.3	12.628	17.442	8.882	49.34	49.56	49.30	0.666	.8080	1.786		
7	85.0	58.0	12.125	17.442	8.940	49.34	49.85	50.40	1.438	.8052	1.864		
8	88.0	59.7	10.901	17.442	9.026	49.34	50.43	51.40	1.600	Cry.	1.941		
9	91.0	61.5	10.558	17.442	9.058	49.34	50.96	52.40	1.652		2.016		
10	94.0	63.4	10.408	17.442	9.079	49.34	51.45	53.40	1.676		2.091		
11	97.0	65.7	10.333	17.442	9.097	49.34	51.90	54.40	1.690		2.164		
12	100.0	67.0	10.271	17.442	9.106	49.34	52.42	55.30	1.698		2.236		
13	103.0	68.8	10.257	17.442	9.122	49.34	52.80	56.30	1.701		2.307		
14	106.0	70.6	10.238	17.442	9.131	49.34	53.25	57.20	1.704		2.412		

TABLE-4

Effect of Generator-I Temperature on operating parameters

		$T_c = 35^{\circ}\text{C}$,			$T_a = 30^{\circ}\text{C}$,			$T_e = 8^{\circ}\text{C}$,			$\eta_1 = \eta_2 = 0.90$)	
1	2	3	4	5	6	7	8	9	10	11	12	
1	54.0									.2897		
2	70.0									.7844		
3	76.0									.7968		
4	82.0									.7986		
5	88.0									.7976	1.525	
ONP												
6	91.0	62.9	17.526	17.328	8.678	50.39	50.20	50.00	0.746	.7967	1.599	
7	94.0	64.1	14.076	17.328	8.762	50.39	50.70	51.00	1.231	Cry.	1.672	
8	97.0	65.6	11.446	17.328	8.964	50.39	51.22	52.00	1.514		1.744	
9	100.0	66.3	10.880	17.328	9.018	50.39	51.70	53.00	1.593		1.815	
10	103.0	70.0	10.589	17.328	9.041	50.39	52.25	53.90	1.536		1.953	
11	106.0	71.9	10.489	17.328	9.064	50.39	52.65	54.90	1.652		2.021	
12	109.0	73.7	10.405	17.328	9.077	50.39	53.13	55.80	1.665		2.087	
13	112.0	75.6	10.359	17.328	9.089	50.39	53.57	56.70	1.673		2.152	

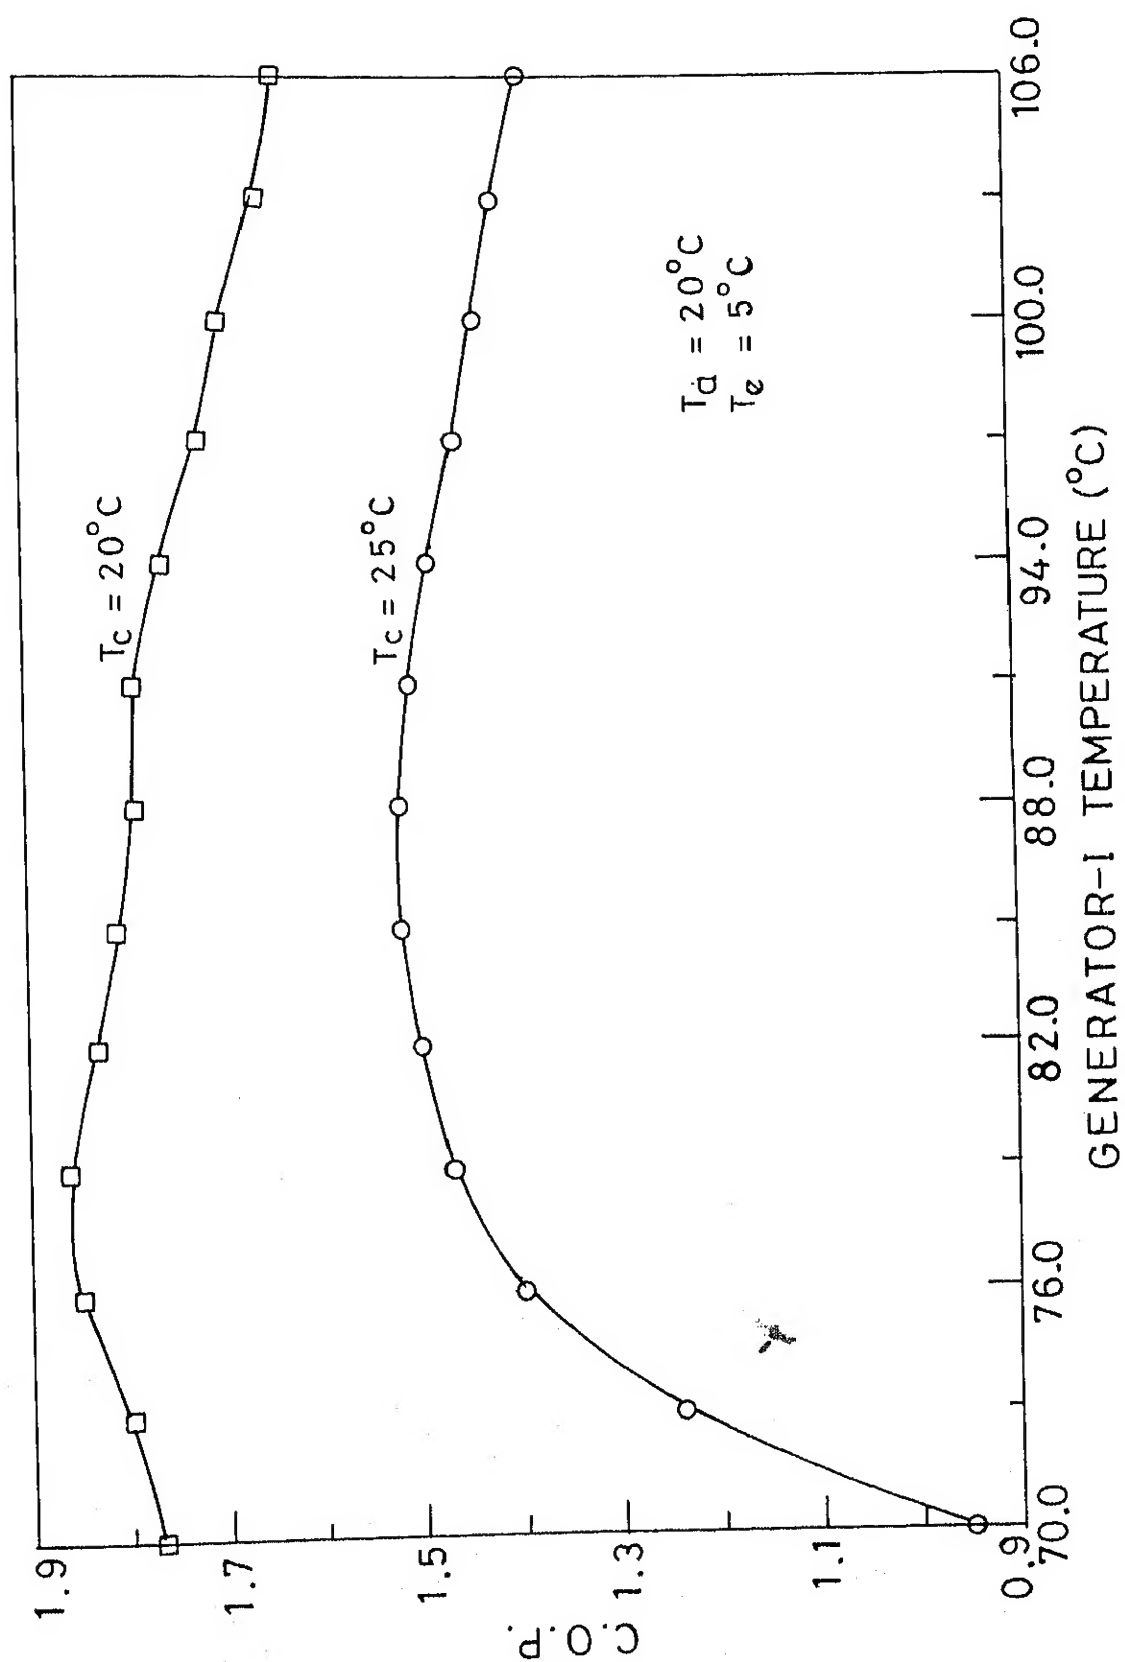


FIG. 5.1 VARIATION OF C.O.P. WITH GENERATOR-I TEMPERATURE.

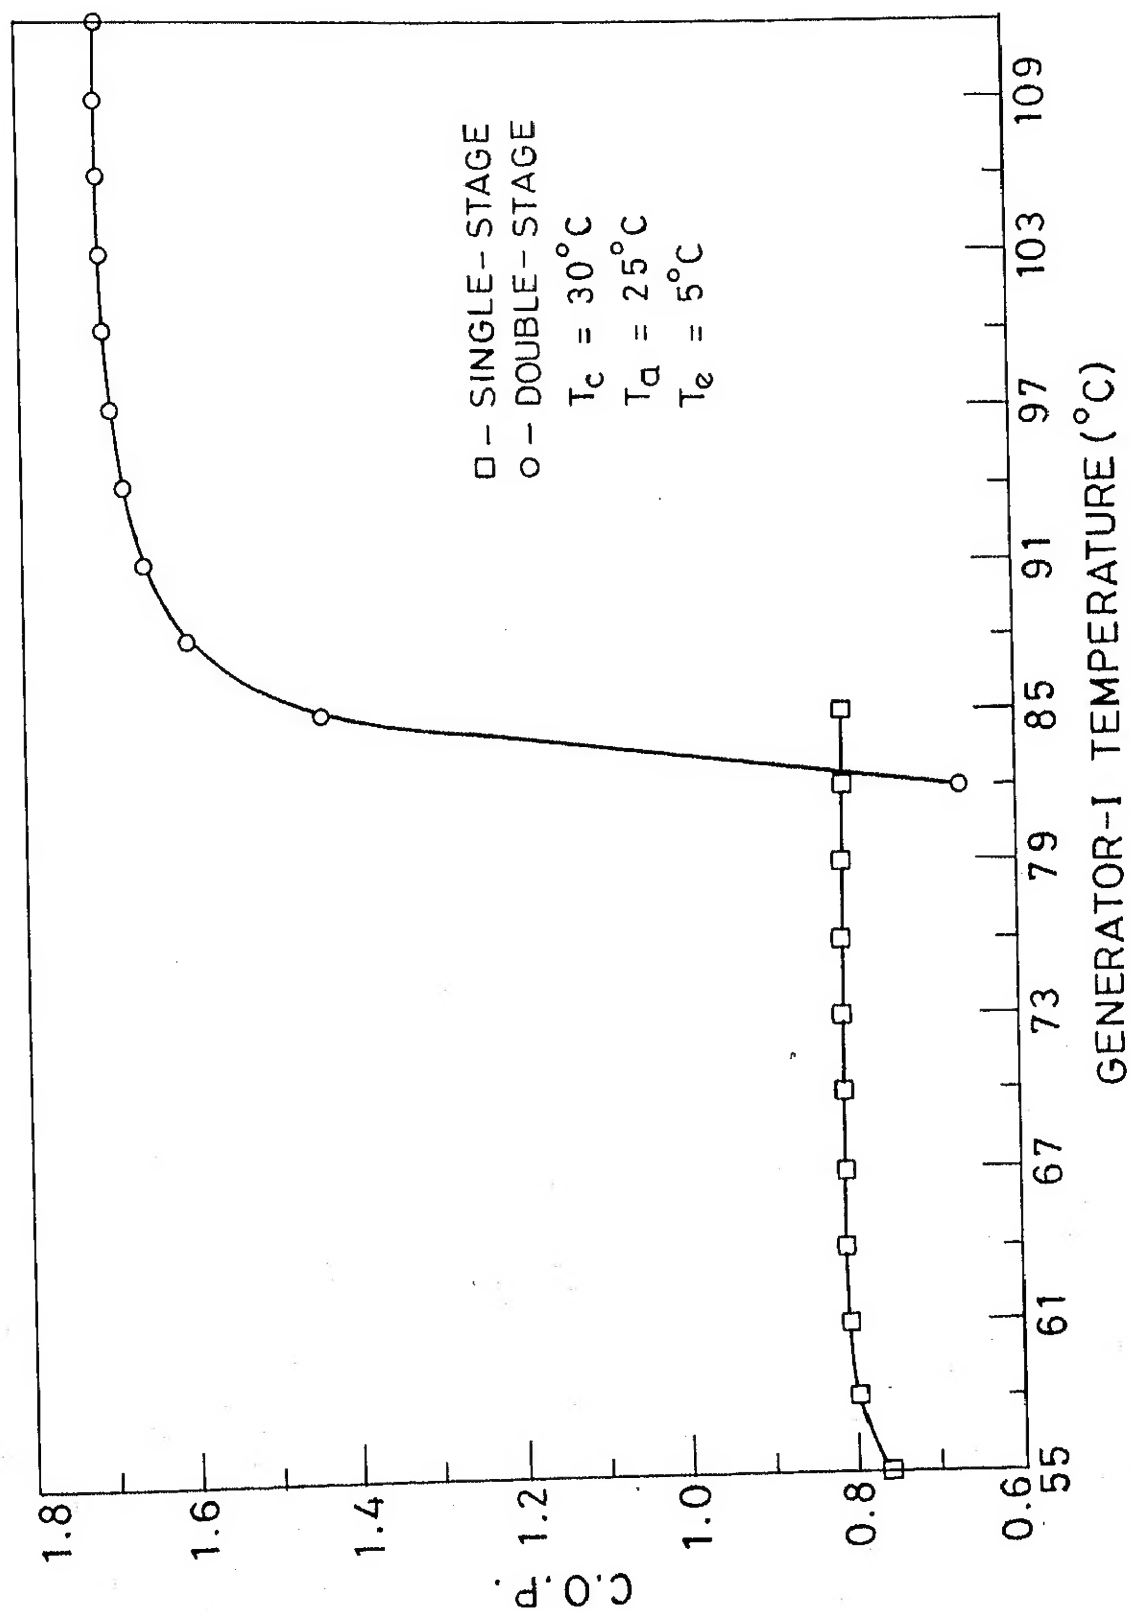


FIG.5.2 VARIATION OF C.O.P. WITH GENERATOR-I TEMPERATURE.

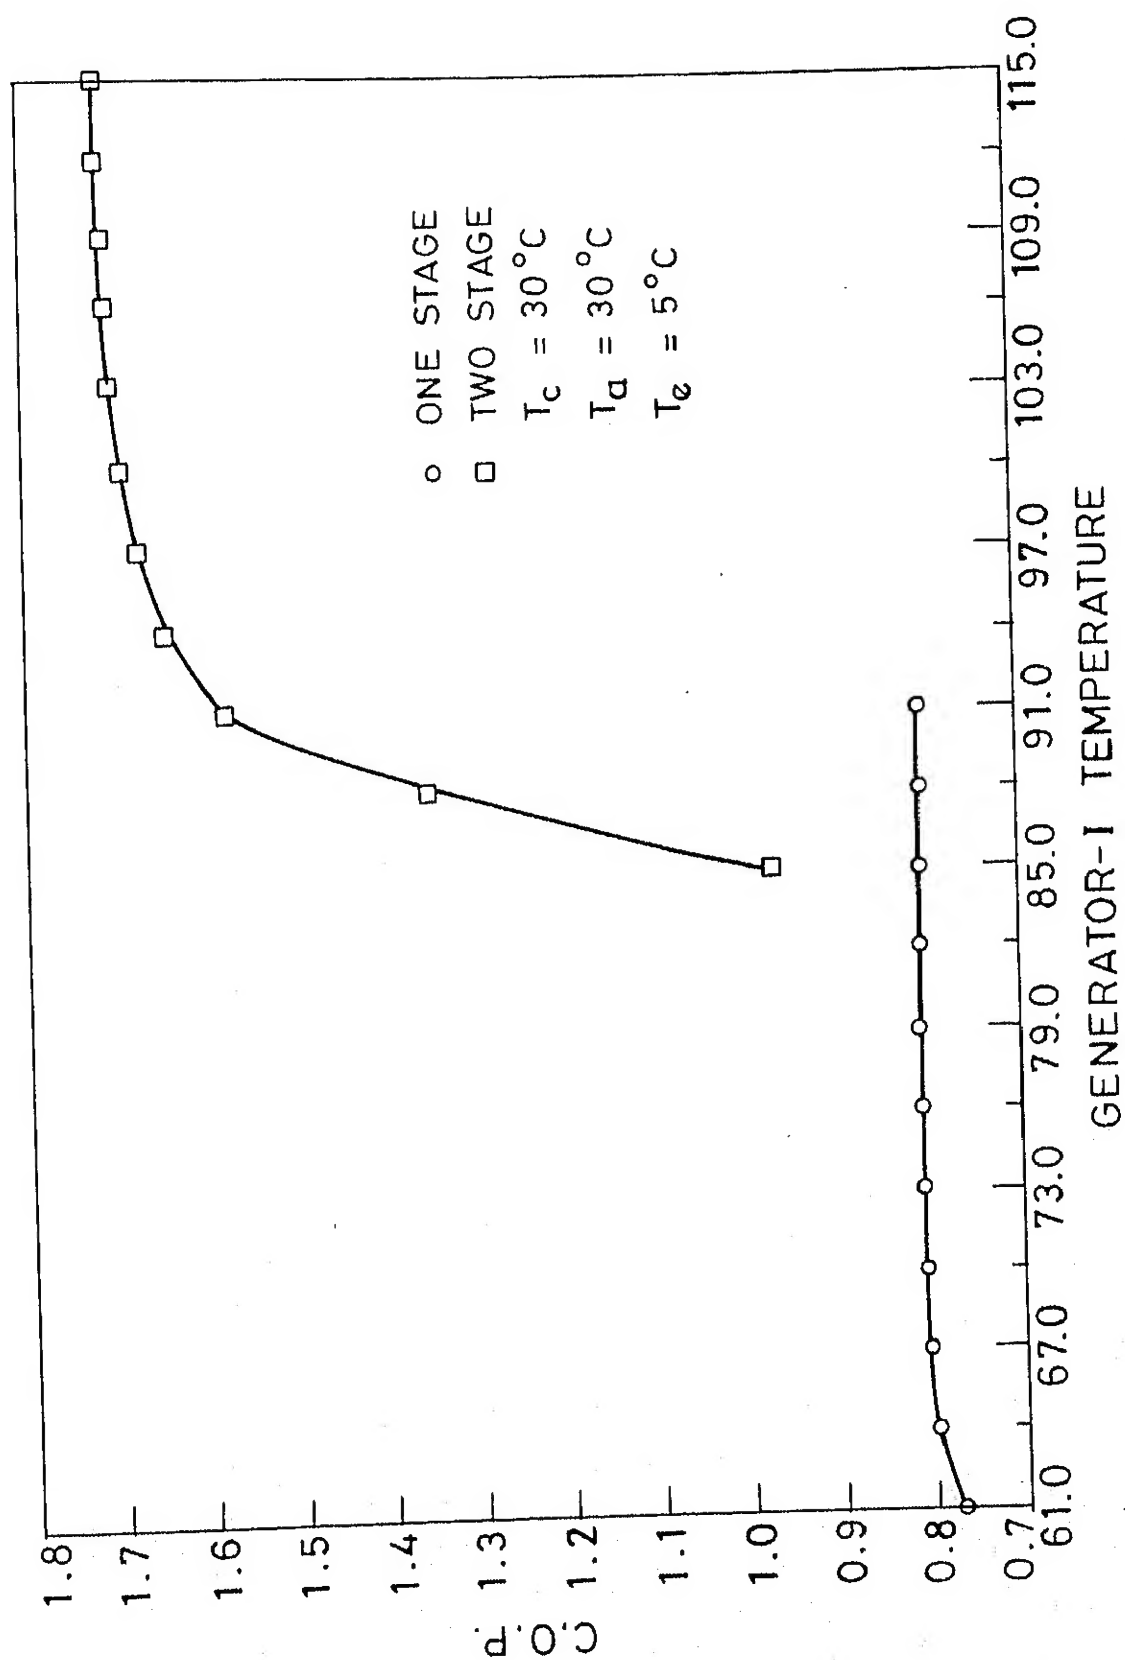


FIG. 5.3 VARIATION OF C.O.P. WITH GENERATOR-I TEMPERATURE.

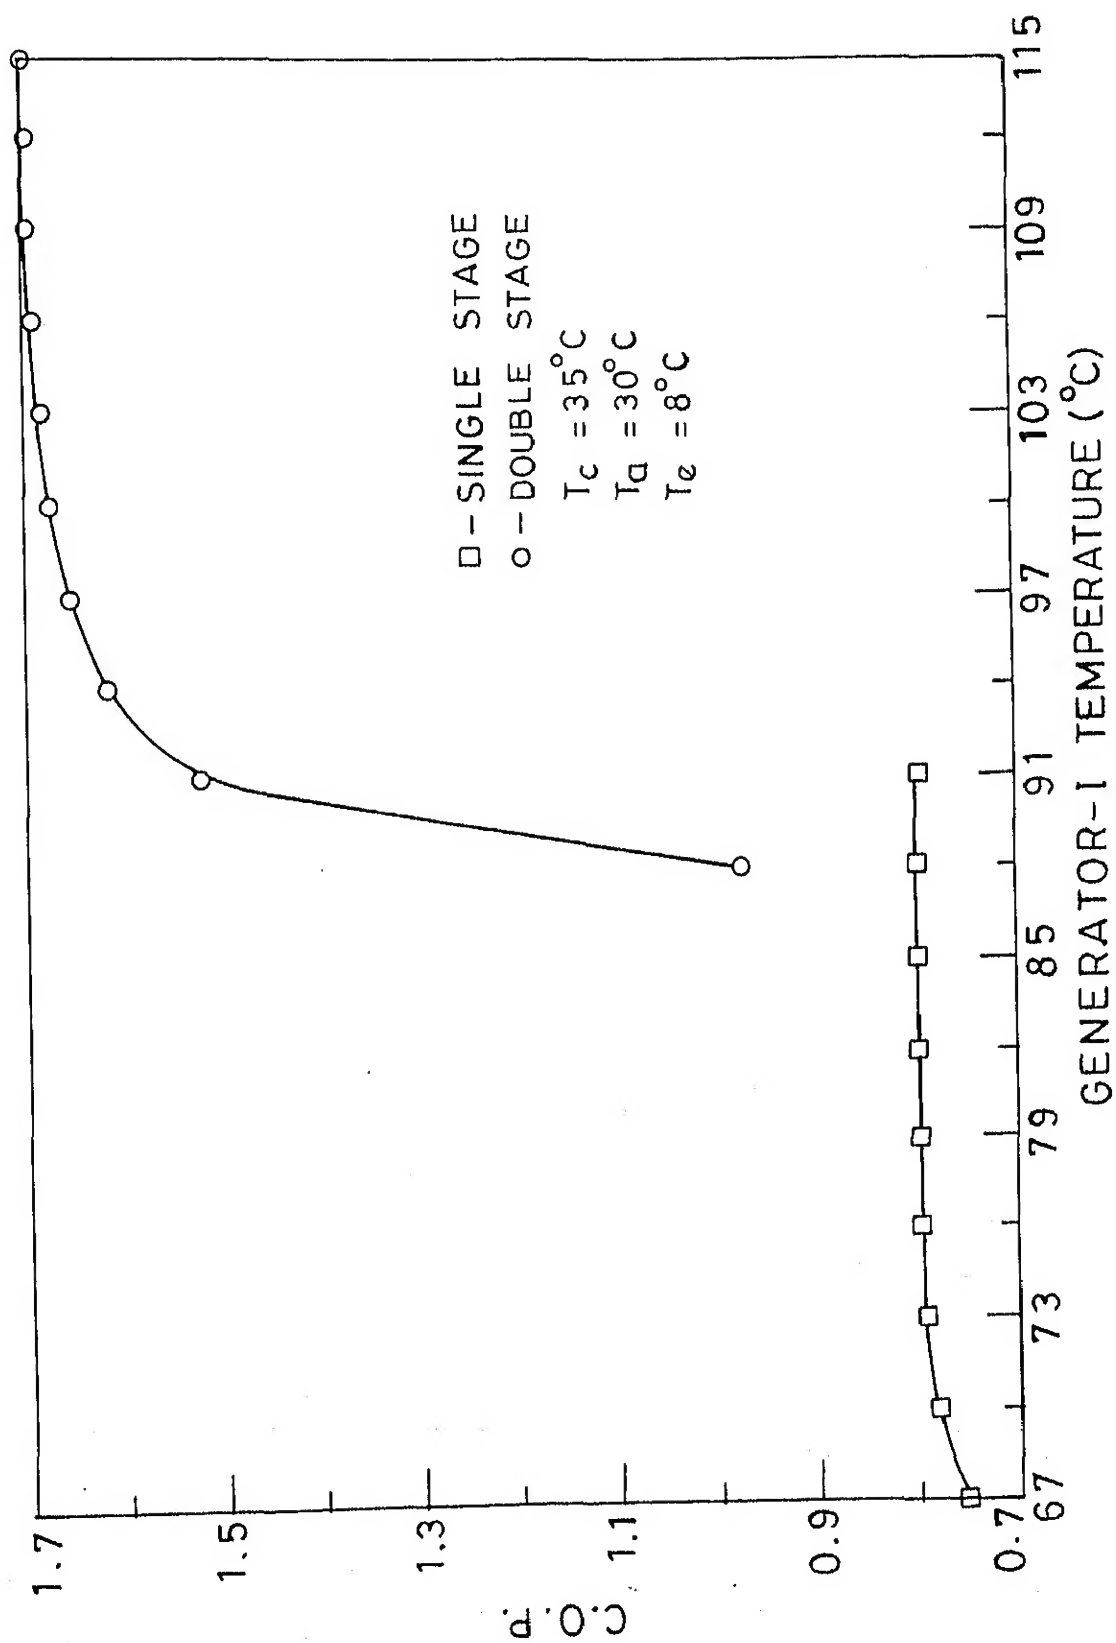


FIG.5.4 VARIATION OF C.O.P. WITH GENERATOR-I TEMPERATURE.

TABLE -5
Effect of Condenser-Temperature on C.O.P.

($T_g = 90^{\circ}\text{C}$, $T_a = 25^{\circ}\text{C}$, $T_e = 8^{\circ}\text{C}$, $\eta_1 = \eta_2 = 0.90$)						
1	$T_c (^{\circ}\text{C})$	3	4	5	6	7
1	25.0	60.73	1.758	Cry .	2.732	
2	26.0	60.91	1.753	Cry .	2.580	
3	27.0	61.29	1.745	,,	2.445	
4	28.0	61.67	1.736	,,	2.323	
5	29.0	62.05	1.727	,,	2.212	
6	30.0	62.26	1.720	,,	2.111	
7	31.0	62.65	1.709	,,	2.020	
8	32.0	63.05	1.697	Cry .	1.935	
9	33.0	63.28	1.687	.809	1.858	
10.	34.0	63.69	1.671	.807	1.787	
11	35.0	64.05	1.658	.805	1.720	

TABLE -6

Effect of Condenser-Temperature on C.O.P.($T_g = 95^\circ\text{C}$, $T_a = 25^\circ\text{C}$, $T_e = 8^\circ\text{C}$, $\eta_1 = \eta_2 = 0.90$)

1	$T_c(^{\circ}\text{C})$	3	4	5	6	7
1	25.0	63.88	1.759	Cry.	3.145	
2	26.0	64.23	1.753	,,	2.970	
3	27.0	64.58	1.745	,,	2.813	
4	28.0	64.74	1.740	,,	2.673	
5	29.0	65.10	1.733	,,	2.546	
6	30.0	65.46	1.725	,,	2.430	
7	31.0	65.83	1.717	,,	2.324	
8	32.0	66.20	1.708	,,	2.227	
9	33.0	66.39	1.702	,,	2.138	
10	34.0	66.78	1.691	,,	2.056	
11	35.0	67.05	1.681	Cry.	1.980	

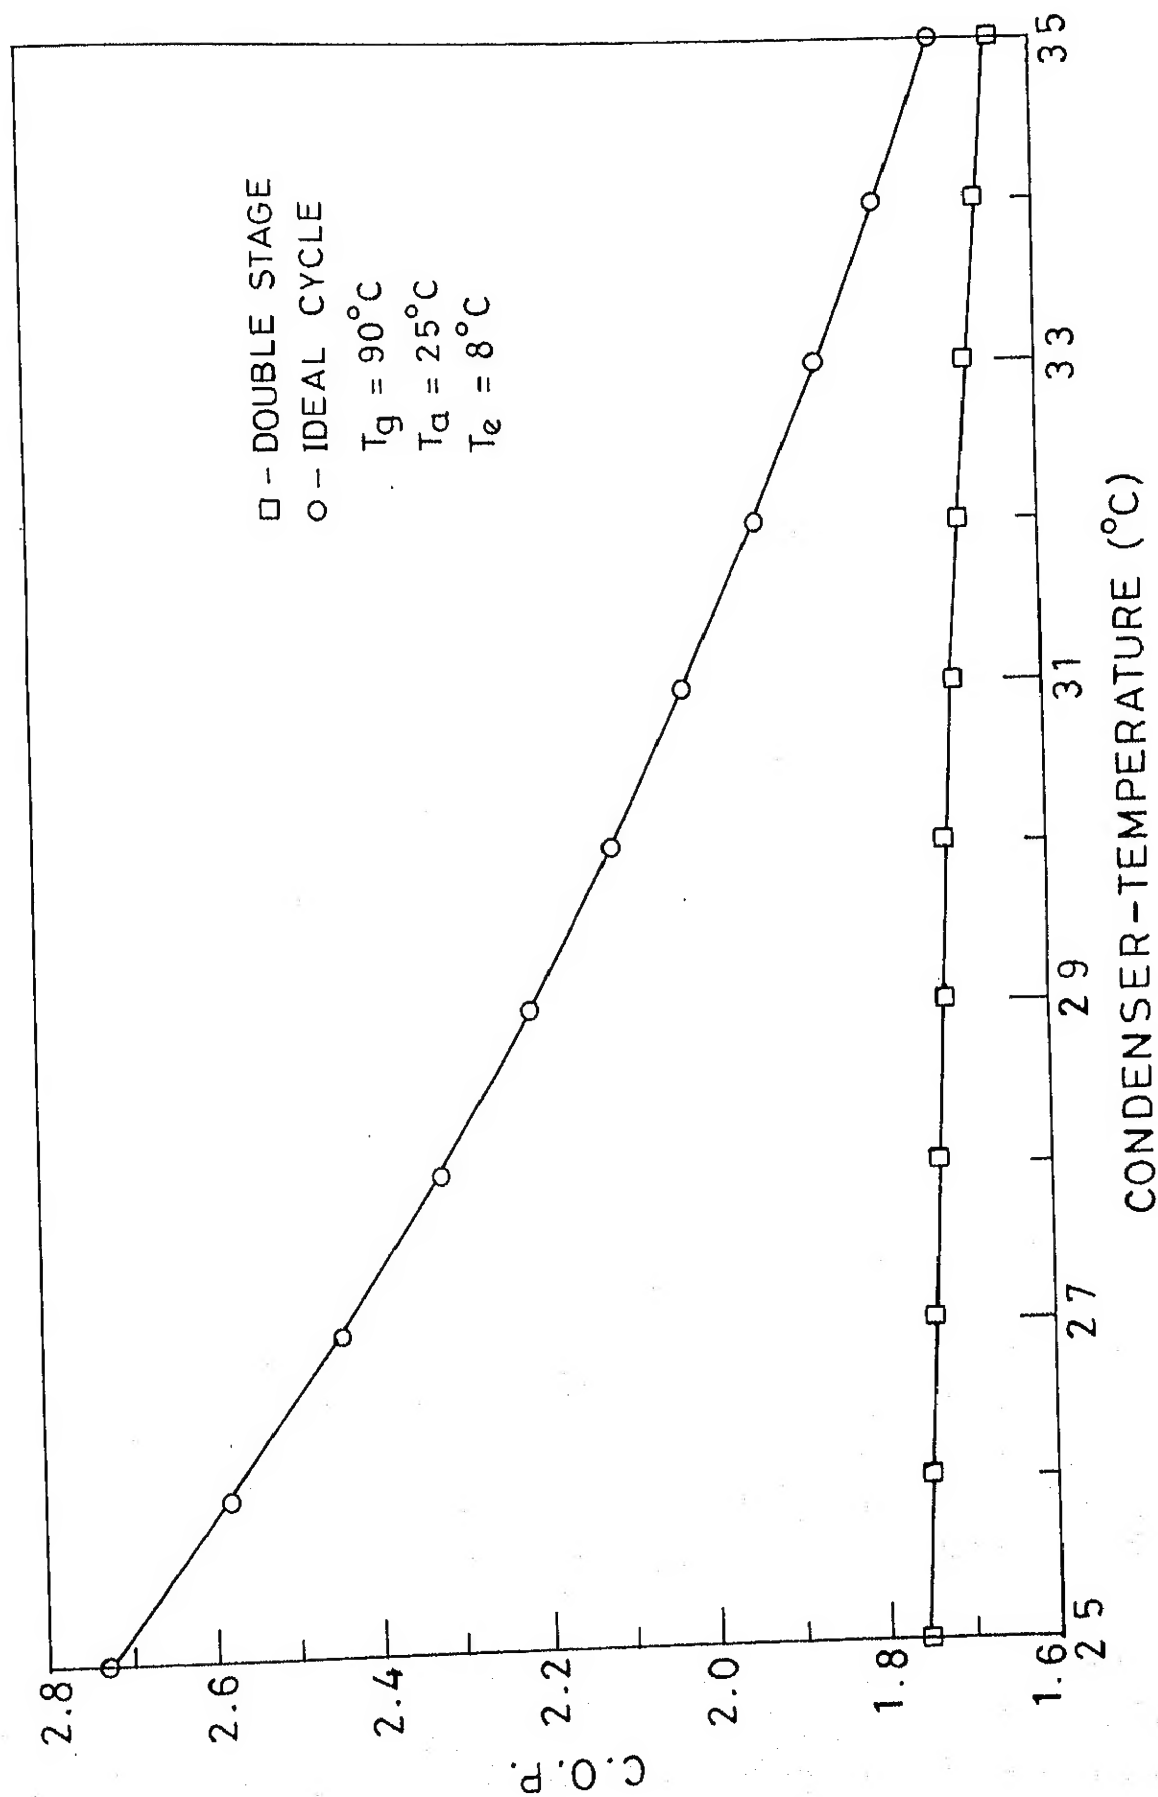


FIG. 5.5 VARIATION OF C.O.P. WITH CONDENSER-TEMPERATURE.

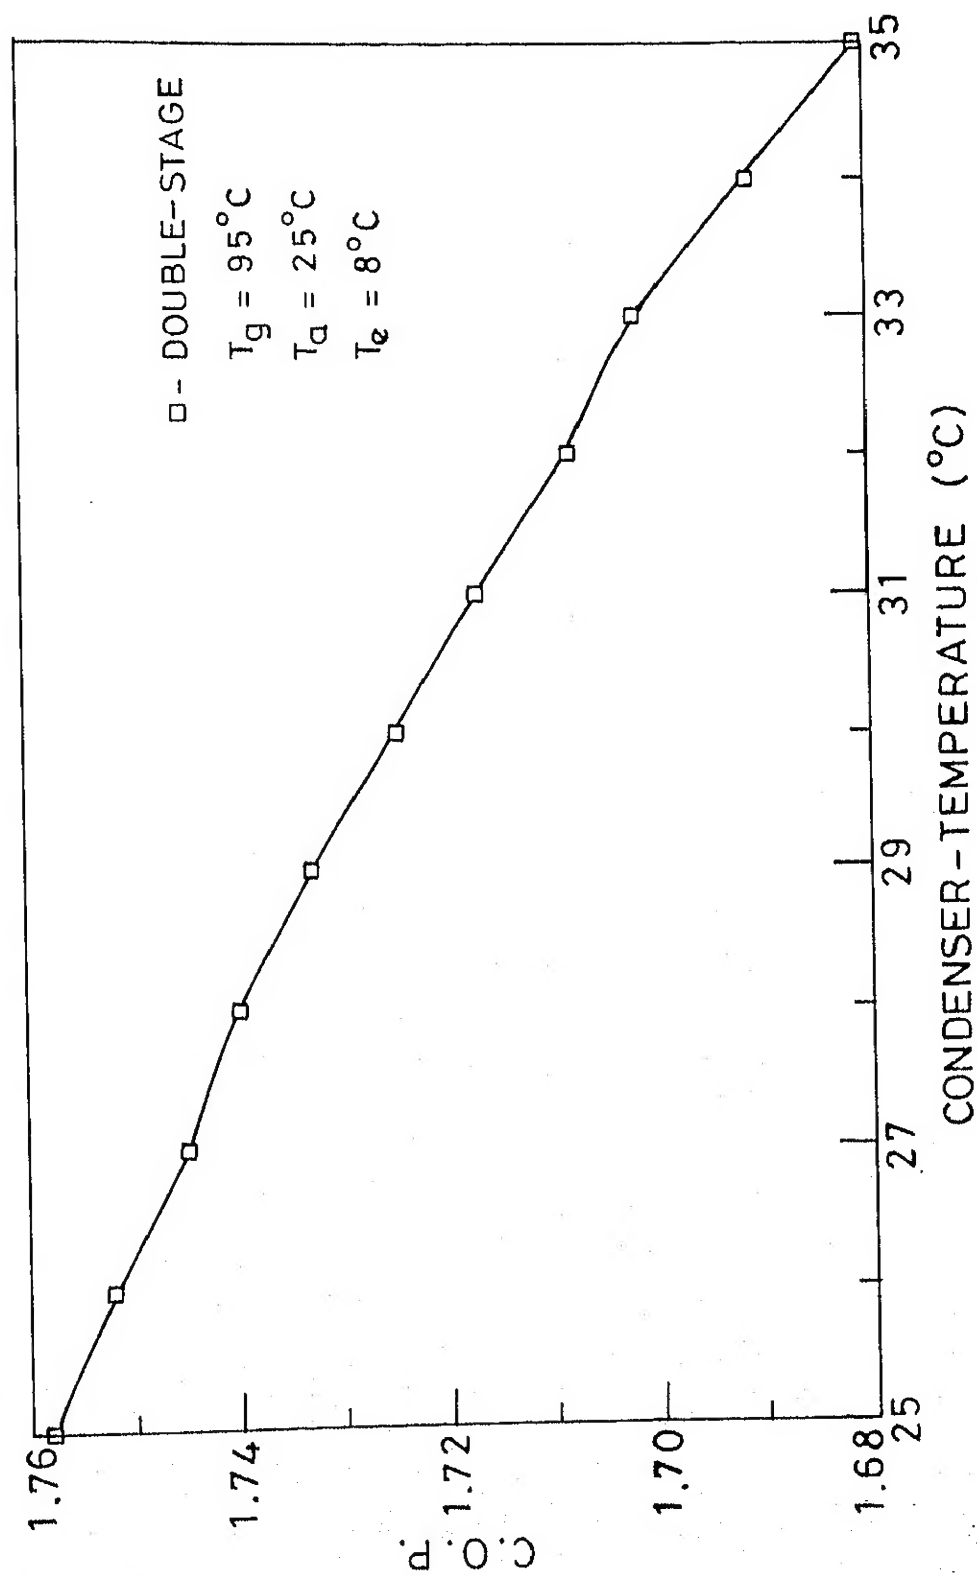


FIG.5.6 VARIATION OF C.O.P. WITH CONDENSER-TEMPERATURE.

TABLE- 7

Effect of Evaporator-Temperature on C.O.P.

(T _g =85°C , T _c = 25°C , T _a =20°C , $\eta_1=\eta_2=0.90$)						
1	T _e (°C)	3.	4	5	6	7
1	3.0	57.34	1.728	Cry.	2.278	
2	4.0	57.71	1.743	,,	2.395	
3	5.0	58.26	1.753	,,	2.524	
4	6.0	58.83	1.760	,,	2.666	
5	7.0	59.58	1.765	,,	2.825	
6	8.0	60.16	1.771	,,	3.001	
7	9.0	60.93	1.775	,,	32.00	
8	10.0	61.23	1.780	,,	3.426	

TABLE- 8

Effect of Evaporator-Temperature on C.O.P.

($T_g = 95^\circ\text{C}$, $T_c = 25^\circ\text{C}$, $T_a = 20^\circ\text{C}$, $\eta_1 = \eta_2 = 0.90$)

1	$T_e (^\circ\text{C})$	3	4	5	6	7
1	3.0	63.48	1.737	Cry.	2.557	
2	4.0	64.09	1.743	,,	2.688	
3	5.0	64.69	1.749	,,	2.833	
4	6.0	65.30	1.754	,,	2.993	
5	7.0	66.12	1.757	,,	3.171	
6	8.0	66.95	1.760	,,	3.369	
7	9.0	67.78	1.762	,,	3.592	
8	10.0	68.62	1.765	,,	3.846	

TABLE- 9

Effect of Evaporator-Temperature on C.O.P.

($T_g = 90^\circ\text{C}$, $T_c = 30^\circ\text{C}$, $T_a = 25^\circ\text{C}$, $\eta_1 = \eta_2 = 0.90$)

1	$T_e (^\circ\text{C})$	3	4	5	6	7
1	3.0	60.26	1.339	Cry	1.831	
2	4.0	60.62	1.554	,,	1.908	
3	5.0	60.98	1.635	,,	1.991	
4	6.0	61.34	1.678	,,	2.082	
5	7.0	61.89	1.700	,,	2.180	
6	8.0	62.26	1.720	,,	2.287	
7	9.0	62.81	1.732	,,	2.405	
8.	10.0	63.37	1.741	,,	2.534	

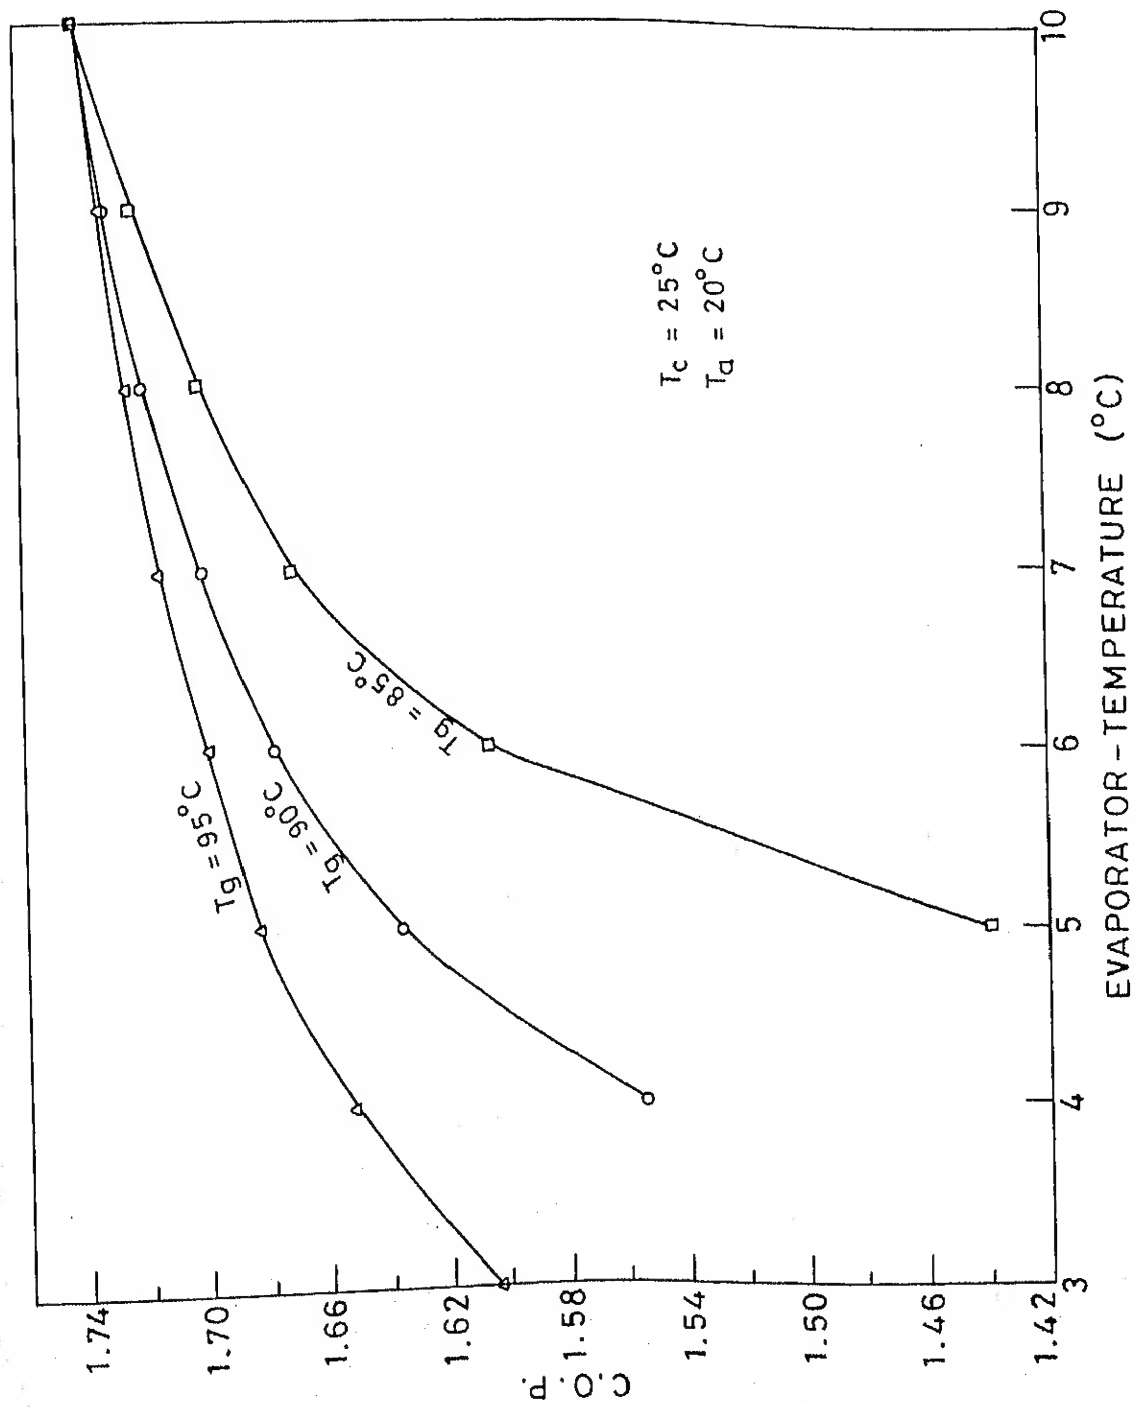


FIG. 5.7 VARIATION OF C.O.P. WITH EVAPORATOR-TEMPERATURE (DOUBLE-STAGE).

TABLE- 10

Effect of Absorber-Temperature on the C.O.P.

($T_g=90^{\circ}\text{C}$, $T_c=30^{\circ}\text{C}$, $T_e=5^{\circ}\text{C}$, $\eta_1=\eta_2=0.90$)						
1	$T_a(^{\circ}\text{C})$	3	4	5	6	7
1	20.0	63.05	1.719	Cry		2.145
2	21.0	62.63	1.711	,,		2.114
3	22.0	62.07	1.704	,,		2.083
4	23.0	61.71	1.690	,,		2.052
5	24.0	61.34	1.669	,,		2.022
6	25.0	60.98	1.635	,,		1.991
7	26.0	60.62	1.577	,,		1.960
8	27.0	60.26	1.452	,,		1.930
9	28.0	59.91	1.027	,,		1.899
10	30.0	ONP		.8072		1.869

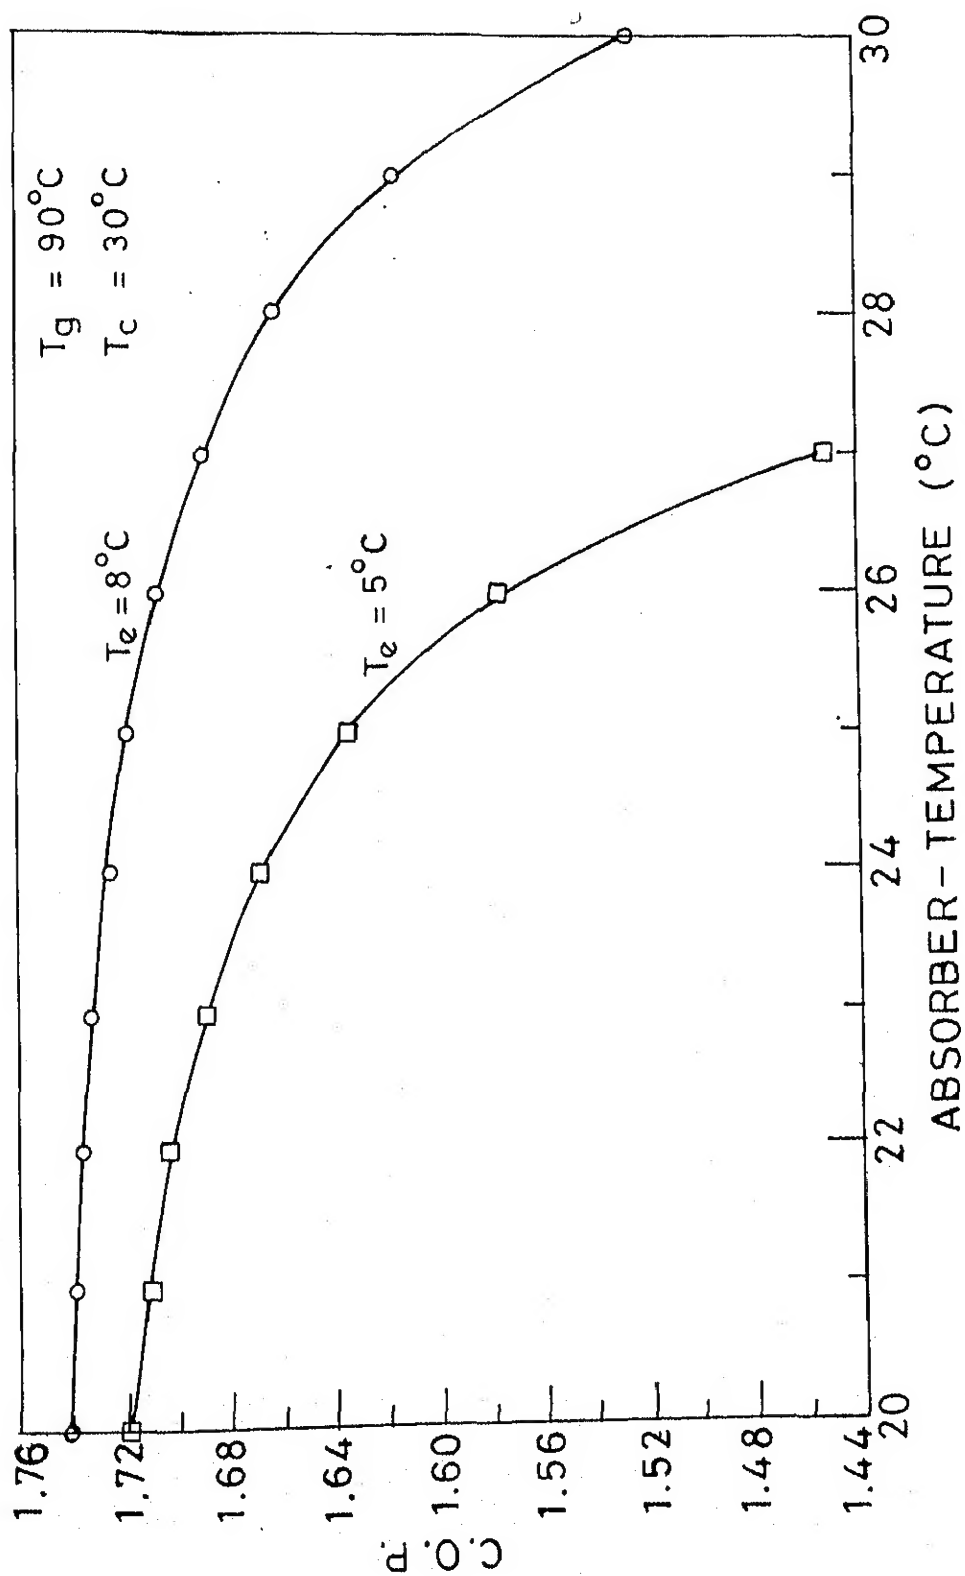


FIG.5.8 VARIATION OF C.O.P. WITH ABSORBER-TEMPERATURE (DOUBLE STAGE).

TABLE- 11

Effect of Absorber-Temperature on the C.O.P.

($T_g = 90^\circ\text{C}$, $T_c = 30^\circ\text{C}$, $T_e = 8^\circ\text{C}$, $\eta_1 = \eta_2 = 0.90$)						
1	$T_a (^\circ\text{C})$	3	4	5	6	7
1	20.0	65.24	1.744	Cry	2.518	
2	21.0	64.88	1.741	,,	2.463	
3	22.0	64.31	1.739	,,	2.428	
4	23.0	63.75	1.736	,,	2.393	
5	24.0	63.18	1.733	,,	2.358	
6	25.0	62.88	1.726	,,	2.322	
7	26.0	62.26	1.720	,,	2.287	
8	27.0	61.89	1.708	,,	2.252	
9	28.0	61.52	1.690	,,	2.217	
10	29.0	61.16	1.663	,,	2.182	
11	30.0	60.80	1.524	,,	2.111	

TABLE -12

Effect of Heat-Exchanger effectiveness on C.O.P.

($T_g = 90^\circ\text{C}$, $T_c = 25^\circ\text{C}$, $T_a = 20^\circ\text{C}$, $T_e = 5^\circ\text{C}$)			
1	η	3	4
1	0.50	61.12	1.325
2	0.55	61.12	1.392
3	0.60	61.315	1.452
4	0.65	61.315	1.507
5	0.70	61.315	1.556
6	0.75	61.315	1.598
7	0.80	61.509	1.636
8	0.85	61.509	1.668
9	0.90	61.509	1.698
10	0.95	61.509	1.726
11	1.00	61.509	1.788

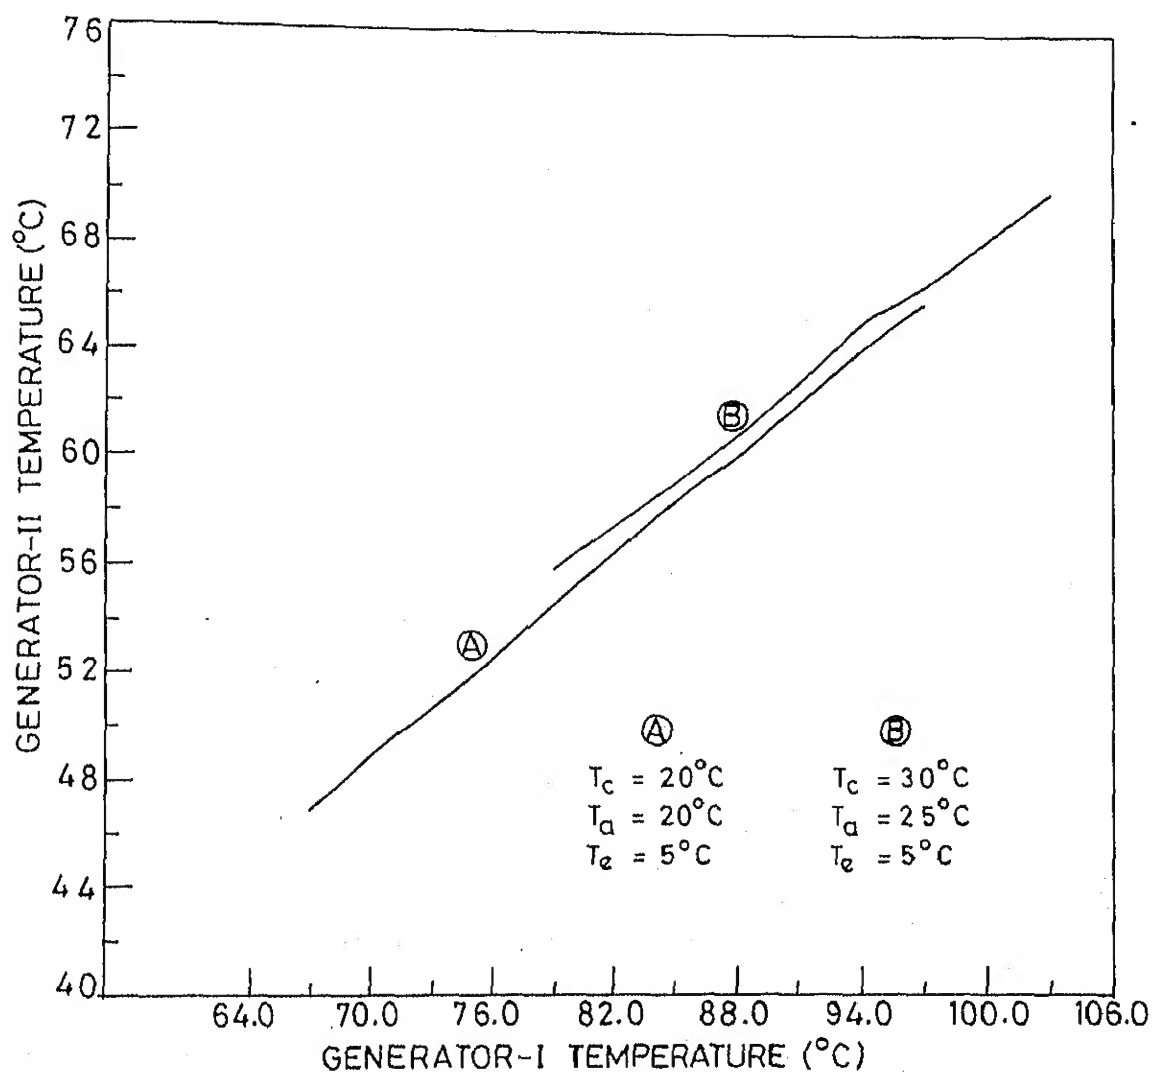


FIG. 5.9 VARIATION OF GENERATOR-II TEMPERATURE WITH GENERATOR-I TEMPERATURE.

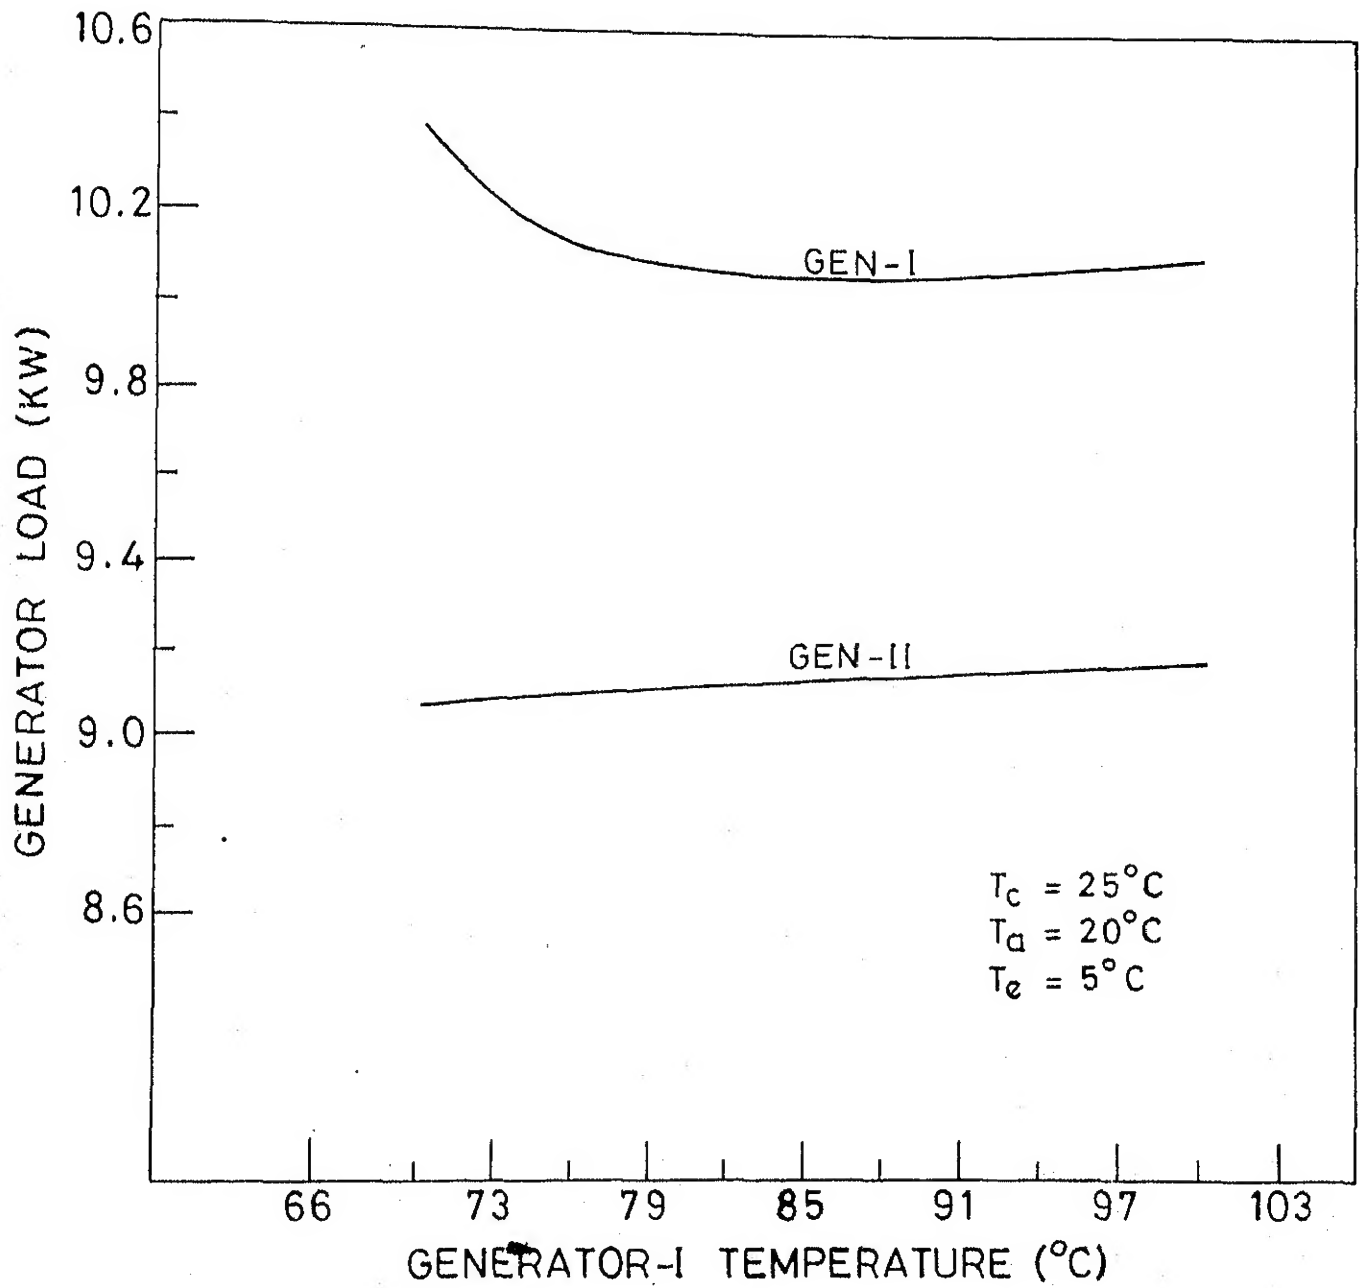


FIG.5.10 VARIATION OF GENERATOR'S LOADS WITH GENERATOR-I TEMPERATURE.

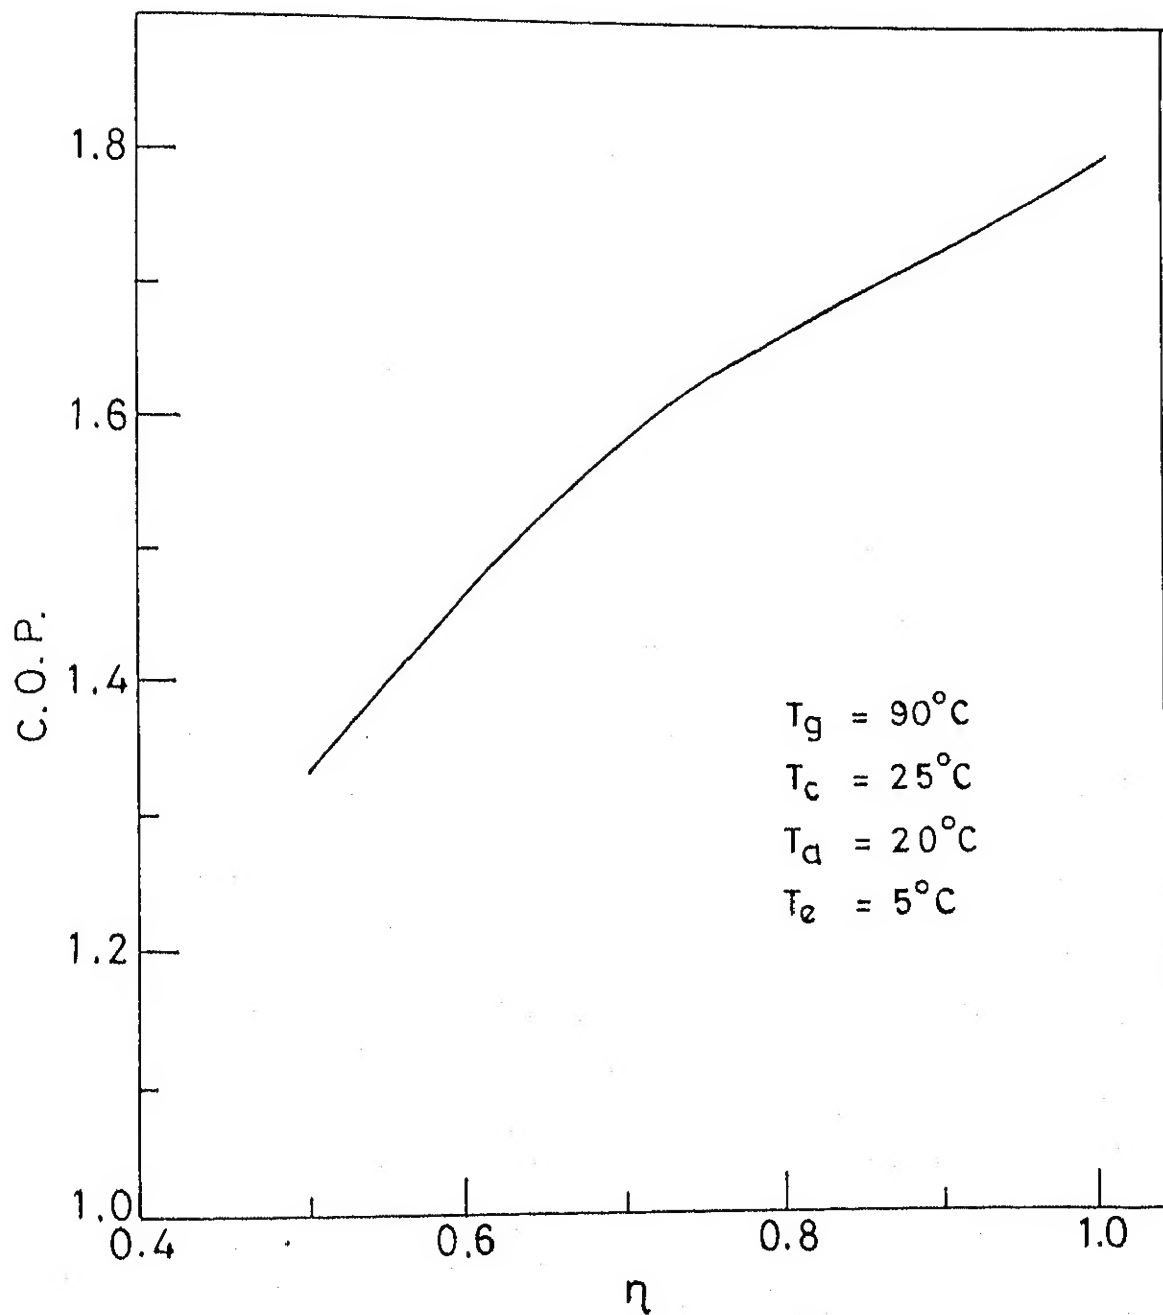


FIG.5.11 VARIATION OF C.O.P. WITH HEAT EXCHANGER EFFECTIVENESS.

CONCLUSIONS

An assessment based on steady state thermodynamic analysis of a double effect LiBr-H₂O absorption refrigeration cycle has been made, and its application to space cooling is considered as the main objective. A computer model of the system, based on the simultaneous solution of total mass, material and heat balance equations of different components in the system, has been developed. The proposed FORTRAN programme is very general in nature and simply by changing the input data, the required operational parameters can be determined quite easily.

In view of the results discussed earlier, the following conclusions may be drawn:

- (1) The C.O.P. obtained in a double stage-system is quite high (1.785 maximum) as compared to single stage (0.84 maximum). However, very high input source-temperature is required for system's operation. This criterion restricts its use to only those places, where very high-temperature steam, bio-gas, hot-water, waste-heat from flue gases and/or advanced solar collectors (evacuated tube), which could give reasonable collector efficiency at high operating

temperatures, are available. However, at locations where only/also high temperature heat sources are available and where the single-stage-system cannot work, a two-stage-system is the solution. Infact, in most of the process industries, the waste heat which is available at quite high temperature, may be successfully utilized for efficient space-cooling purposes.

(2) This system has very high values of C.O.P., almost approaching the ideal value at high condenser temperatures. The practicability of using high condenser-temperatures obviates the necessity of using a cooling tower along with the condenser and an air cooled condenser may be used for the purpose. This helps in a reduction in total cost of the system. Hence, the system would function more effectively in arid regions, where humidity remains low and the ambient temperature is high.

It may, thus, be concluded that a double-stage-vapour-absorption-system is more efficient than a vapour-compression-system in terms of the annual running cost as it does not require compressor for its operation, which consumes most of the energy required for the operation of a vapour-compression-system.

REFERENCES

1. Eisenstadt M., Flanigan F.M., Farber F.A. ; 'Tests prove feasibility of solar air conditioning ' ; Heating, piping and Air-Conditioning , vol. 32, no. 11, 1960, pp. 120.
2. Verma H.K.; 'Design of one ton solar operated LiBr-H₂O air conditioning system' , 'National Solar Energy Convection of Solar Energy Society of India ' , 'Solar Energy for Rural Development', Bhavnagar, 1978.
3. Lazzarin R., Rizzan E., Boldrin M.; Scalabrin G., 'Performance Prediction of a LiBr-H₂O absorption air conditioning utilizing solar energy' ; International Solar Energy , New Delhi, 1978.
4. Alizadeh S., Bahar F., Geoola F.; 'Design and optimization of an absorption refrigeration system operated by Solar Energy' , Solar Energy , vol. 22, No. 2, 1979, pp. 149.
5. Charters W.W.S., Chen W.D.; 'Some design aspects of air-cooled LiBr-H₂O absorption cycle air conditioning system' ; SUN-II , vol. 9, 1979, pp. 725.
6. Siddiqui A.M., Prasad M., Sahay B.; 'Economic evaluation of bio-gas for optimizing generator temperature in a vapour absorption system' ; Energy Conversion and Management , vol. 126, No. 1, 1986, pp. 83.

7. Grassie S.L., Sheridan N.R.; 'Modelling of a solar operated absorption air conditioning system with refrigerating storage' , Solar Energy, vol. 19, 1973, pp. 691.
8. Kaushik S.C., Kumar R.; 'Thermodynamic study of a two stage vapour absorption refrigeration system using NH_3 refrigerant with liquid/solid absorbents' ; Energy Conversion and Management , vol. 25, No.4, 1985. pp.427.
9. Stöcker W.F., Jones J.W.; 'Refrigeration and Air Conditioning' , McGraw Hill Book Company , 1985.
10. Wilbur P.J., Karaki S.; Solar Cooling , The Franklin Institute Press , 1977, pp. 12-13.
11. 'Handbook of Air conditioning System Design' , Carrier Air Conditioning Company , McGraw Hill Book Company .
12. 'ASHRAE Guide and Data Book', Fundamentals and Equipments , 1963.
13. Perry, Chilton ; 'Chemical Engineering Hand-Book' , McGraw-Hill Int. Book , 5th edition.
14. Duffie J.A.; 'Simulation of a solar heating and cooling system ' , Solar Energy , vol. 16, 1974, pp. 129.
15. Sheridan N.R.; 'Performance of the Brisbane solar house' , Solar Energy , vol. 12, 1975, pp. 395.

16. Chung R., ; 'A study of a solar air-conditioning';
Jn of Solar Energy Engg., vol. 85, 1963, pp. 85.
17. Colebrook C.F.; 'Turbulent flow in pipes with particular
reference to the transition region between smooth
and rough pipe flows'; Jn. Inst. Civil Engg., vol. 12,
No. 4, 1939, pp. 133-156.
18. White F.M.; 'Fluid Mechanics'; McGraw Hill Book
Company , 1986, pp. 314.
19. 'Standards of the Tubular Exchanger Manufacturers
Association', 5th edition, New York, 1970.
20. Bogart M. ; 'Absorption Refrigeration in Industrial
Processes' ; Houston Gulf Pub. Co. , 1981.
21. McAdams W.H. ; 'Heat Transmission'; McGraw Hill Book
Company , 3rd edition, New York, 1974.
22. Arora S.C. ; 'Refrigeration and Air Conditioning',
Dhanpat Rai and Sons , 1973.
23. Hutchinson F.W.; 'Design of Refrigeration System for
Air-Conditioning ' ; N.Y. Industrial Press , 1969.
24. Dossat R.J.; 'Principles of Refrigeration'; New York,
Wiley, 1968.
25. 'ASHRAE Handbook of Product Directory', 1977.
26. 'ASHRAE Handbook of Fundamentals ', 1981.

APPENDIX -1State equations for aqueous Lithium-Bromide solution

The well known state equations, relating the solution-temperature and refrigerant-pressure to the refrigerant-temperature, the solution-enthalpy to the solution-temperature, enthalpy of superheated vapour of refrigerant to the generator and condenser-temperatures and the specific heat of the solution to the solution-concentration are given as following [26_7]:

$$t_f = A t'_f + B \quad (A-1)$$

$$\text{Log}_{10} P = C + \frac{D}{(t'_f + 459.72)} + \frac{E}{(t'_f + 459.72)^2} \quad (A-2)$$

$$H_f = p+q t_f + r t_f^2 \quad (A-3)$$

$$H_g = 1.925 T_g - 0.126 T_c + 2500 \quad (A-4)$$

$$C_{PL} = 4.259 - 0.053843 x + (2.307E-4) x^2 \quad (A-5)$$

where,

$$A = -2.00755 + 0.16976 X - (3.133362 E-3) X^2 + (1.97668 E-5) X^3$$

$$B = 321.128 - 19.322 X + 0.374382 X^2 - (2.0637 E-3) X^3$$


- $C = 6.21147$
 $C_{PL} =$ Specific heat of LiBr-H₂O solution in kJ/kg.K
 $D = -2886.373$
 $E = -337269.46$
 $H_f =$ Enthalpy of solution in Btu/lb
 $H_g =$ Enthalpy of super heated vapour in kJ/kg
 $p = -1015.07 + 79.5387 X - 2.358016 X^2$
 $\quad + 0.03031583 X^3 - (1.400261 \text{ E-}4) X^4$
 $q = 4.68108 - (3.037766\text{E-}1) X + (8.44845 \text{ E-}3)$
 $\quad - (1.047721 \text{ E-}4) X^3 + (4.80097 \text{ E-}7) X^4$
 $r = -4.9107 \text{ E-}3 + (3.831841 \text{ E-}4) X - (1.07896 \text{ E-}5)$
 $\quad + (1.3152 \text{ E-}7) X^3 - (5.897 \text{ E-}10) X^4$
 $t_f =$ Solution temperature ($^{\circ}\text{F}$)
 $\quad 40 \leq t_f \leq 350 \text{ }^{\circ}\text{F}$
 $t'_f =$ Refrigerant temperature ($^{\circ}\text{F}$)
 $\quad 0 \leq t'_f \leq 230 \text{ }^{\circ}\text{F}$
 $\quad = \frac{-2E}{D + \sqrt{D^2 - 4E(C - \log_{10} P)}}^{0.5}$
 $X =$ Percentage by mass LiBr in LiBr-H₂O solution
 $\quad 45 \% \leq X \leq 70 \%$

Conversion Factors -


- (1) 1 Btu = 1.0155 kJ
- (2) 1 Ton of Refrigeration = 210 kJ/min
- (3) 1 Psia = 6.9847 k Pa
- (4) 1 Psia = 52.3893 mm of Hg
- (5) 1 Btu/lb = 2.326 kJ/kg

APPENDIX-2

Graph For concentration of LiBr, Vapour Pressure and Saturation Temperature of Pure Water with Solution-Temperature as Variable Parameter /9 7.

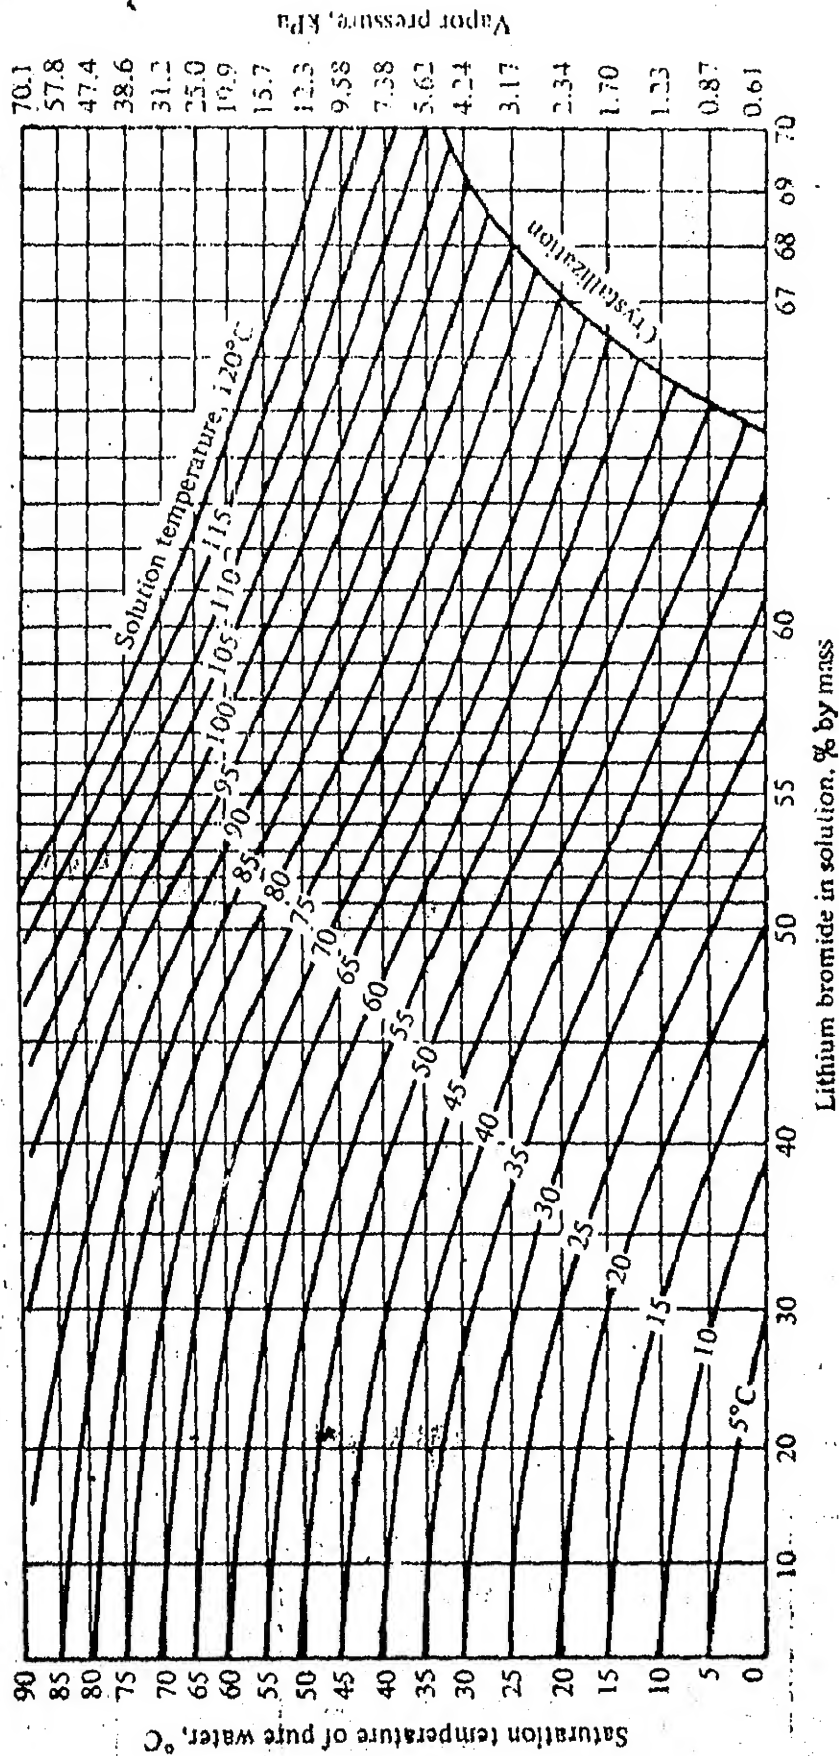

Graph for Enthalpy V/S LiBr Concentration
with Solution-Temperature on Variable
Parameter 97

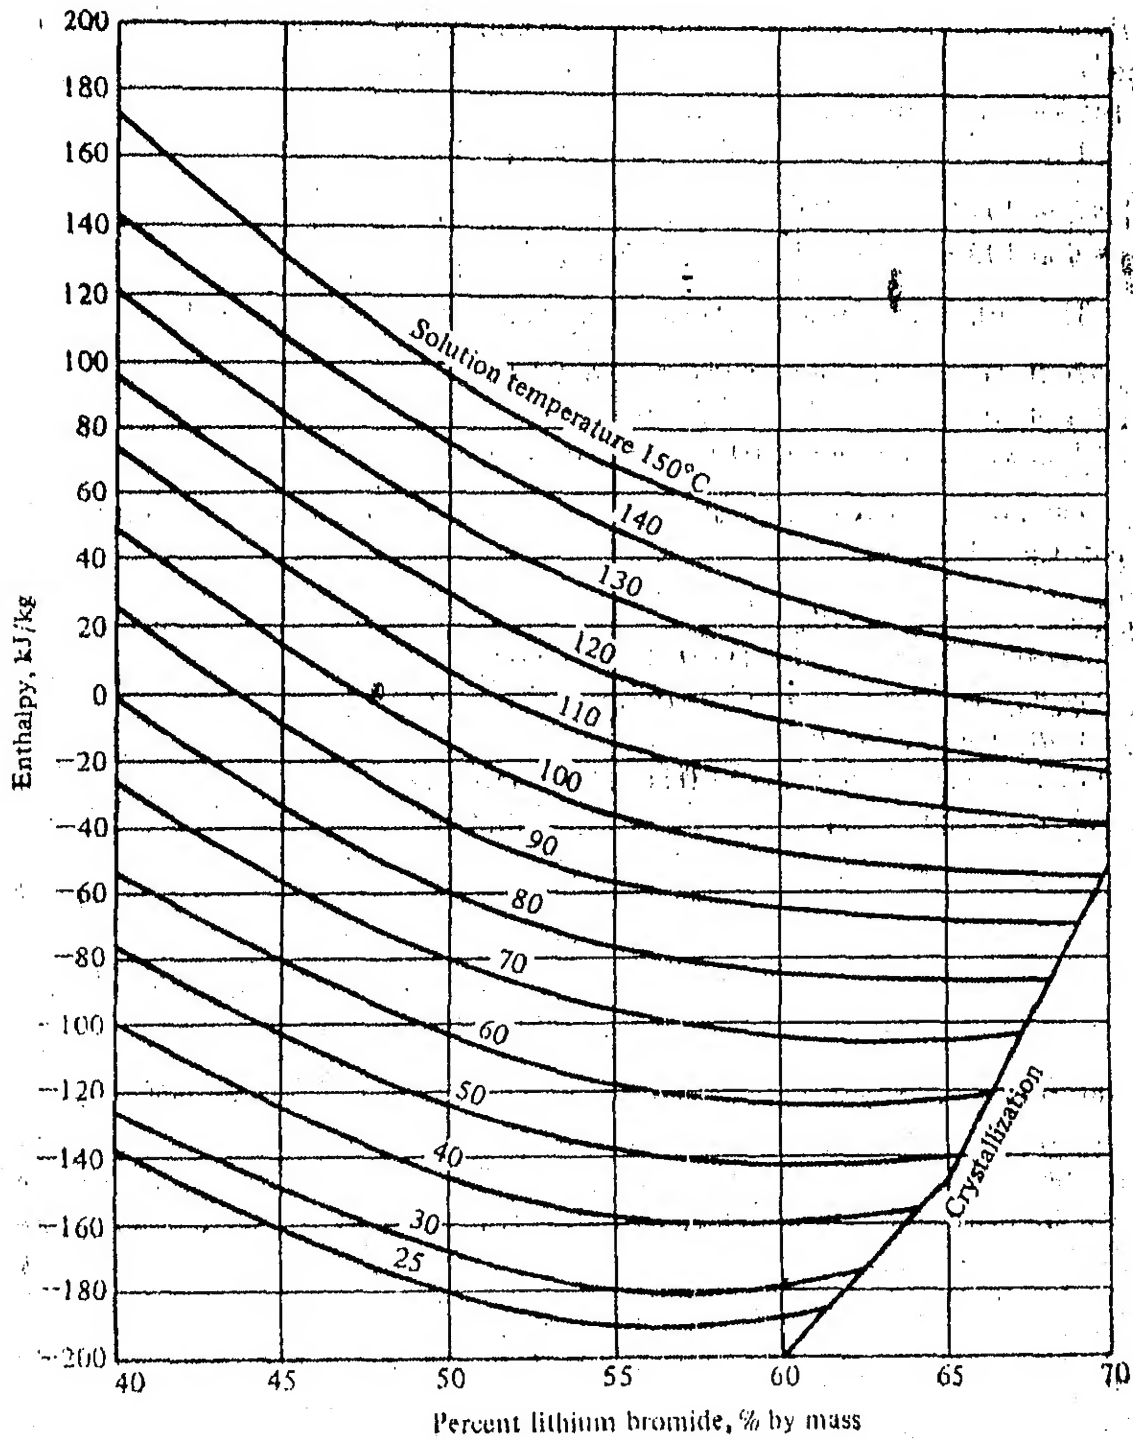

```

0001 1. TECH. (THERMAL SCIENCE & FLUID MECHANICS)
0002 1.1.1. VAPOR
0003 *****
0004 *****
0005 COMPUTER MODELLING OF 1 STAGE LBR VAPOR ABSORPTION SYSTEM
0006 FIND OUT THE COP OF THE SYSTEM
0007 REFRIGERANT TEMPERATURE IN DEGREE FERN.
0008 TS=SOLUTION TEMPERATURE IN DEGREE FERN.
0009 PR=PRESSURE IN PSIA
0010 X=CONCENTRATION OF LBR IN/LR OF SOLUTION
0011 P, R=CONSTANTS FOR FINDING ENTHALPIES
0012 TSC(1) IS THE SOLUTION TEMPERATURE LEAVING THE GENERATOR
0013 TSC(5) IS THE SOLUTION TEMPERATURE LEAVING THE ABSORBER
0014 TRC(2) IS THE CONDENSER TEMPERATURE
0015 TRC(4) IS THE REFRIGERANT TEMPERATURE IN THE EVAPORATOR
0016 TRC(10) IS THE COOLING WATER TEMPERATURE
0017 DEAT IS THE HEAT EXCHANGER EFFECTIVENESS
0018 DELTAT IS THE APPRACH TEMP IN THE CONDENSER
0019 *****
0020 DIMENSION TR(10), TS(10), PR(10), X(10), H(10), PRES(10)
0021 DIMENSION PRE(10), TRC(10), TSC(10), ENTHL(10)
0022 P(X)=-1015.07+79.5387*X-2.358016*X**2+0.03031583*
0023 1(X**3)-(1.400261E-4)*(X**4)
0024 Q(X)=4.08108-(1.037766E-1)*X+(8.44845E-3)*(X**2)-
0025 1(1.047721E-4)*(X**3)+(4.00097E-7)*(X**4)
0026 R(X)=-(4.9107E-3)+(3.831841E-4)*X-(1.07896E-5)*(X**2)
0027 1+(1.3152E-7)*(X**3)-(5.897E-10)*(X**4)
0028 *****
0029 C, D, E ARE THE CONSTANTS TO CALCULATE PRESSURE FROM TEMP
0030 *****
0031 C=0.21147
0032 D=-2886.373
0033 E=-337269.46
0034 OPEN(UNIT=22, DEVICE='DSK', FILE='RES.OUT')
0035 OPEN(UNIT=21, DEVICE='DSK', FILE='NOMEN')
0036 TSC(1)=88.0
0037 TSC(5)=30.0
0038 ETAF=.90
0039 TRC(2)=40.0
0040 TRC(10)=5.0
0041 DELTAT=5.0
0042 TRC(2)=TRC(10)+DELTAT
0043 TR(1)=TSC(1)*9.0/5.0+32.0
0044 TSC(1)=TR(1)
0045 TR(2)=TRC(2)*9.0/5.0+32.0
0046 TRC(2)=TR(2)
0047 TR(3)=TRC(3)*9.0/5.0+32.0
0048 TRC(3)=TR(3)
0049 TS(5)=TSC(5)*9.0/5.0+32.0
0050 TR(5)=TS(5)
0051 TR(1)=TR(2)
0052 DO 1 I=2, 10
0053 P(X)=0.0/(TR(I)+459.72)+E/((TR(I)+459.72)**2)
0054 PR(I)=10.**PRES(I)
0055 CONTINUE
0056 PR(1)=PR(2)
0057 PR(5)=PR(1)
0058 PR(7)=PR(3)
0059 PR(10)=PR(4)
0060 PRE(1)=PRE(5)
0061 PRE(6)=PRE(1)
0062 DO 2 I=3, 10
0063 PRE(I)=0.23*PR(I)
0064 CONTINUE
0065 ENTHL(1)=35
0066 ENTHL(2)=35
0067 ENTHL(3)=35
0068 ENTHL(4)=35
0069 ENTHL(5)=35
0070 ENTHL(6)=35
0071 ENTHL(7)=35
0072 ENTHL(8)=35
0073 ENTHL(9)=35
0074 ENTHL(10)=35
0075 ENTHL(11)=35
0076 ENTHL(12)=35
0077 ENTHL(13)=35
0078 ENTHL(14)=35
0079 ENTHL(15)=35
0080 ENTHL(16)=35
0081 ENTHL(17)=35
0082 ENTHL(18)=35
0083 ENTHL(19)=35
0084 ENTHL(20)=35
0085 ENTHL(21)=35
0086 ENTHL(22)=35
0087 ENTHL(23)=35
0088 ENTHL(24)=35
0089 ENTHL(25)=35
0090 ENTHL(26)=35
0091 ENTHL(27)=35
0092 ENTHL(28)=35
0093 ENTHL(29)=35
0094 ENTHL(30)=35
0095 ENTHL(31)=35
0096 ENTHL(32)=35
0097 ENTHL(33)=35
0098 ENTHL(34)=35
0099 ENTHL(35)=35
0100 ENTHL(36)=35
0101 ENTHL(37)=35
0102 ENTHL(38)=35
0103 ENTHL(39)=35
0104 ENTHL(40)=35
0105 ENTHL(41)=35
0106 ENTHL(42)=35
0107 ENTHL(43)=35
0108 ENTHL(44)=35
0109 ENTHL(45)=35
0110 ENTHL(46)=35
0111 ENTHL(47)=35
0112 ENTHL(48)=35
0113 ENTHL(49)=35
0114 ENTHL(50)=35
0115 ENTHL(51)=35
0116 ENTHL(52)=35
0117 ENTHL(53)=35
0118 ENTHL(54)=35
0119 ENTHL(55)=35
0120 ENTHL(56)=35
0121 ENTHL(57)=35
0122 ENTHL(58)=35
0123 ENTHL(59)=35
0124 ENTHL(60)=35
0125 ENTHL(61)=35
0126 ENTHL(62)=35
0127 ENTHL(63)=35
0128 ENTHL(64)=35
0129 ENTHL(65)=35
0130 ENTHL(66)=35
0131 ENTHL(67)=35
0132 ENTHL(68)=35
0133 ENTHL(69)=35
0134 ENTHL(70)=35
0135 ENTHL(71)=35
0136 ENTHL(72)=35
0137 ENTHL(73)=35
0138 ENTHL(74)=35
0139 ENTHL(75)=35
0140 ENTHL(76)=35
0141 ENTHL(77)=35
0142 ENTHL(78)=35
0143 ENTHL(79)=35
0144 ENTHL(80)=35
0145 ENTHL(81)=35
0146 ENTHL(82)=35
0147 ENTHL(83)=35
0148 ENTHL(84)=35
0149 ENTHL(85)=35
0150 ENTHL(86)=35
0151 ENTHL(87)=35
0152 ENTHL(88)=35
0153 ENTHL(89)=35
0154 ENTHL(90)=35
0155 ENTHL(91)=35
0156 ENTHL(92)=35
0157 ENTHL(93)=35
0158 ENTHL(94)=35
0159 ENTHL(95)=35
0160 ENTHL(96)=35
0161 ENTHL(97)=35
0162 ENTHL(98)=35
0163 ENTHL(99)=35
0164 ENTHL(100)=35
0165 ENTHL(101)=35
0166 ENTHL(102)=35
0167 ENTHL(103)=35
0168 ENTHL(104)=35
0169 ENTHL(105)=35
0170 ENTHL(106)=35
0171 ENTHL(107)=35
0172 ENTHL(108)=35
0173 ENTHL(109)=35
0174 ENTHL(110)=35
0175 ENTHL(111)=35
0176 ENTHL(112)=35
0177 ENTHL(113)=35
0178 ENTHL(114)=35
0179 ENTHL(115)=35
0180 ENTHL(116)=35
0181 ENTHL(117)=35
0182 ENTHL(118)=35
0183 ENTHL(119)=35
0184 ENTHL(120)=35
0185 ENTHL(121)=35
0186 ENTHL(122)=35
0187 ENTHL(123)=35
0188 ENTHL(124)=35
0189 ENTHL(125)=35
0190 ENTHL(126)=35
0191 ENTHL(127)=35
0192 ENTHL(128)=35
0193 ENTHL(129)=35
0194 ENTHL(130)=35
0195 ENTHL(131)=35
0196 ENTHL(132)=35
0197 ENTHL(133)=35
0198 ENTHL(134)=35
0199 ENTHL(135)=35
0200 ENTHL(136)=35
0201 ENTHL(137)=35
0202 ENTHL(138)=35
0203 ENTHL(139)=35
0204 ENTHL(140)=35
0205 ENTHL(141)=35
0206 ENTHL(142)=35
0207 ENTHL(143)=35
0208 ENTHL(144)=35
0209 ENTHL(145)=35
0210 ENTHL(146)=35
0211 ENTHL(147)=35
0212 ENTHL(148)=35
0213 ENTHL(149)=35
0214 ENTHL(150)=35
0215 ENTHL(151)=35
0216 ENTHL(152)=35
0217 ENTHL(153)=35
0218 ENTHL(154)=35
0219 ENTHL(155)=35
0220 ENTHL(156)=35
0221 ENTHL(157)=35
0222 ENTHL(158)=35
0223 ENTHL(159)=35
0224 ENTHL(160)=35
0225 ENTHL(161)=35
0226 ENTHL(162)=35
0227 ENTHL(163)=35
0228 ENTHL(164)=35
0229 ENTHL(165)=35
0230 ENTHL(166)=35
0231 ENTHL(167)=35
0232 ENTHL(168)=35
0233 ENTHL(169)=35
0234 ENTHL(170)=35
0235 ENTHL(171)=35
0236 ENTHL(172)=35
0237 ENTHL(173)=35
0238 ENTHL(174)=35
0239 ENTHL(175)=35
0240 ENTHL(176)=35
0241 ENTHL(177)=35
0242 ENTHL(178)=35
0243 ENTHL(179)=35
0244 ENTHL(180)=35
0245 ENTHL(181)=35
0246 ENTHL(182)=35
0247 ENTHL(183)=35
0248 ENTHL(184)=35
0249 ENTHL(185)=35
0250 ENTHL(186)=35
0251 ENTHL(187)=35
0252 ENTHL(188)=35
0253 ENTHL(189)=35
0254 ENTHL(190)=35
0255 ENTHL(191)=35
0256 ENTHL(192)=35
0257 ENTHL(193)=35
0258 ENTHL(194)=35
0259 ENTHL(195)=35
0260 ENTHL(196)=35
0261 ENTHL(197)=35
0262 ENTHL(198)=35
0263 ENTHL(199)=35
0264 ENTHL(200)=35
0265 ENTHL(201)=35
0266 ENTHL(202)=35
0267 ENTHL(203)=35
0268 ENTHL(204)=35
0269 ENTHL(205)=35
0270 ENTHL(206)=35
0271 ENTHL(207)=35
0272 ENTHL(208)=35
0273 ENTHL(209)=35
0274 ENTHL(210)=35
0275 ENTHL(211)=35
0276 ENTHL(212)=35
0277 ENTHL(213)=35
0278 ENTHL(214)=35
0279 ENTHL(215)=35
0280 ENTHL(216)=35
0281 ENTHL(217)=35
0282 ENTHL(218)=35
0283 ENTHL(219)=35
0284 ENTHL(220)=35
0285 ENTHL(221)=35
0286 ENTHL(222)=35
0287 ENTHL(223)=35
0288 ENTHL(224)=35
0289 ENTHL(225)=35
0290 ENTHL(226)=35
0291 ENTHL(227)=35
0292 ENTHL(228)=35
0293 ENTHL(229)=35
0294 ENTHL(230)=35
0295 ENTHL(231)=35
0296 ENTHL(232)=35
0297 ENTHL(233)=35
0298 ENTHL(234)=35
0299 ENTHL(235)=35
0300 ENTHL(236)=35
0301 ENTHL(237)=35
0302 ENTHL(238)=35
0303 ENTHL(239)=35
0304 ENTHL(240)=35
0305 ENTHL(241)=35
0306 ENTHL(242)=35
0307 ENTHL(243)=35
0308 ENTHL(244)=35
0309 ENTHL(245)=35
0310 ENTHL(246)=35
0311 ENTHL(247)=35
0312 ENTHL(248)=35
0313 ENTHL(249)=35
0314 ENTHL(250)=35
0315 ENTHL(251)=35
0316 ENTHL(252)=35
0317 ENTHL(253)=35
0318 ENTHL(254)=35
0319 ENTHL(255)=35
0320 ENTHL(256)=35
0321 ENTHL(257)=35
0322 ENTHL(258)=35
0323 ENTHL(259)=35
0324 ENTHL(260)=35
0325 ENTHL(261)=35
0326 ENTHL(262)=35
0327 ENTHL(263)=35
0328 ENTHL(264)=35
0329 ENTHL(265)=35
0330 ENTHL(266)=35
0331 ENTHL(267)=35
0332 ENTHL(268)=35
0333 ENTHL(269)=35
0334 ENTHL(270)=35
0335 ENTHL(271)=35
0336 ENTHL(272)=35
0337 ENTHL(273)=35
0338 ENTHL(274)=35
0339 ENTHL(275)=35
0340 ENTHL(276)=35
0341 ENTHL(277)=35
0342 ENTHL(278)=35
0343 ENTHL(279)=35
0344 ENTHL(280)=35
0345 ENTHL(281)=35
0346 ENTHL(282)=35
0347 ENTHL(283)=35
0348 ENTHL(284)=35
0349 ENTHL(285)=35
0350 ENTHL(286)=35
0351 ENTHL(287)=35
0352 ENTHL(288)=35
0353 ENTHL(289)=35
0354 ENTHL(290)=35
0355 ENTHL(291)=35
0356 ENTHL(292)=35
0357 ENTHL(293)=35
0358 ENTHL(294)=35
0359 ENTHL(295)=35
0360 ENTHL(296)=35
0361 ENTHL(297)=35
0362 ENTHL(298)=35
0363 ENTHL(299)=35
0364 ENTHL(300)=35
0365 ENTHL(301)=35
0366 ENTHL(302)=35
0367 ENTHL(303)=35
0368 ENTHL(304)=35
0369 ENTHL(305)=35
0370 ENTHL(306)=35
0371 ENTHL(307)=35
0372 ENTHL(308)=35
0373 ENTHL(309)=35
0374 ENTHL(310)=35
0375 ENTHL(311)=35
0376 ENTHL(312)=35
0377 ENTHL(313)=35
0378 ENTHL(314)=35
0379 ENTHL(315)=35
0380 ENTHL(316)=35
0381 ENTHL(317)=35
0382 ENTHL(318)=35
0383 ENTHL(319)=35
0384 ENTHL(320)=35
0385 ENTHL(321)=35
0386 ENTHL(322)=35
0387 ENTHL(323)=35
0388 ENTHL(324)=35
0389 ENTHL(325)=35
0390 ENTHL(326)=35
0391 ENTHL(327)=35
0392 ENTHL(328)=35
0393 ENTHL(329)=35
0394 ENTHL(330)=35
0395 ENTHL(331)=35
0396 ENTHL(332)=35
0397 ENTHL(333)=35
0398 ENTHL(334)=35
0399 ENTHL(335)=35
0400 ENTHL(336)=35
0401 ENTHL(337)=35
0402 ENTHL(338)=35
0403 ENTHL(339)=35
0404 ENTHL(340)=35
0405 ENTHL(341)=35
0406 ENTHL(342)=35
0407 ENTHL(343)=35
0408 ENTHL(344)=35
0409 ENTHL(345)=35
0410 ENTHL(346)=35
0411 ENTHL(347)=35
0412 ENTHL(348)=35
0413 ENTHL(349)=35
0414 ENTHL(350)=35
0415 ENTHL(351)=35
0416 ENTHL(352)=35
0417 ENTHL(353)=35
0418 ENTHL(354)=35
0419 ENTHL(355)=35
0420 ENTHL(356)=35
0421 ENTHL(357)=35
0422 ENTHL(358)=35
0423 ENTHL(359)=35
0424 ENTHL(360)=35
0425 ENTHL(361)=35
0426 ENTHL(362)=35
0427 ENTHL(363)=35
0428 ENTHL(364)=35
0429 ENTHL(365)=35
0430 ENTHL(366)=35
0431 ENTHL(367)=35
0432 ENTHL(368)=35
0433 ENTHL(369)=35
0434 ENTHL(370)=35
0435 ENTHL(371)=35
0436 ENTHL(372)=35
0437 ENTHL(373)=35
0438 ENTHL(374)=35
0439 ENTHL(375)=35
0440 ENTHL(376)=35
0441 ENTHL(377)=35
0442 ENTHL(378)=35
0443 ENTHL(379)=35
0444 ENTHL(380)=35
0445 ENTHL(381)=35
0446 ENTHL(382)=35
0447 ENTHL(383)=35
0448 ENTHL(384)=35
0449 ENTHL(385)=35
0450 ENTHL(386)=35
0451 ENTHL(387)=35
0452 ENTHL(388)=35
0453 ENTHL(389)=35
0454 ENTHL(390)=35
0455 ENTHL(391)=35
0456 ENTHL(392)=35
0457 ENTHL(393)=35
0458 ENTHL(394)=35
0459 ENTHL(395)=35
0460 ENTHL(396)=35
0461 ENTHL(397)=35
0462 ENTHL(398)=35
0463 ENTHL(399)=35
0464 ENTHL(400)=35
0465 ENTHL(401)=35
0466 ENTHL(402)=35
0467 ENTHL(403)=35
0468 ENTHL(404)=35
0469 ENTHL(405)=35
0470 ENTHL(406)=35
0471 ENTHL(407)=35
0472 ENTHL(408)=35
0473 ENTHL(409)=35
0474 ENTHL(410)=35
0475 ENTHL(411)=35
0476 ENTHL(412)=35
0477 ENTHL(413)=35
0478 ENTHL(414)=35
0479 ENTHL(415)=35
0480 ENTHL(416)=35
0481 ENTHL(417)=35
0482 ENTHL(418)=35
0483 ENTHL(419)=35
0484 ENTHL(420)=35
0485 ENTHL(421)=35
0486 ENTHL(422)=35
0487 ENTHL(423)=35
0488 ENTHL(424)=35
0489 ENTHL(425)=35
0490 ENTHL(426)=35
0491 ENTHL(427)=35
0492 ENTHL(428)=35
0493 ENTHL(429)=35
0494 ENTHL(430)=35
0495 ENTHL(431)=35
0496 ENTHL(432)=35
0497 ENTHL(433)=35
0498 ENTHL(434)=35
0499 ENTHL(435)=35
0500 ENTHL(436)=35
0501 ENTHL(437)=35
0502 ENTHL(438)=35
0503 ENTHL(439)=35
0504 ENTHL(440)=35
0505 ENTHL(441)=35
0506 ENTHL(442)=35
0507 ENTHL(443)=35
0508 ENTHL(444)=35
0509 ENTHL(445)=35
0510 ENTHL(446)=35
0511 ENTHL(447)=35
0512 ENTHL(448)=35
0513 ENTHL(449)=35
0514 ENTHL(450)=35
0515 ENTHL(451)=35
0516 ENTHL(452)=35
0517 ENTHL(453)=35
0518 ENTHL(454)=35
0519 ENTHL(455)=35
0520 ENTHL(456)=35
0521 ENTHL(457)=35
0522 ENTHL(458)=35
0523 ENTHL(459)=35
0524 ENTHL(460)=35
0525 ENTHL(461)=35
0526 ENTHL(462)=35
0527 ENTHL(463)=35
0528 ENTHL(464)=35
0529 ENTHL(465)=35
0530 ENTHL(466)=35
0531 ENTHL(467)=35
0532 ENTHL(468)=35
0533 ENTHL(469)=35
0534 ENTHL(470)=35
0535 ENTHL(471)=35
0536 ENTHL(472)=35
0537 ENTHL(473)=35
0538 ENTHL(474)=35
0539 ENTHL(475)=35
0540 ENTHL(476)=35
0541 ENTHL(477)=35
0542 ENTHL(478)=35
0543 ENTHL(479)=35
0544 ENTHL(480)=35
0545 ENTHL(481)=35
0546 ENTHL(482)=35
0547 ENTHL(483)=35
0548 ENTHL(484)=35
0549 ENTHL(485)=35
0550 ENTHL(486)=35
0551 ENTHL(487)=35
0552 ENTHL(488)=35
0553 ENTHL(489)=35
0554 ENTHL(490)=35
0555 ENTHL(491)=35
0556 ENTHL(492)=35
0557 ENTHL(493)=35
0558 ENTHL(494)=35
0559 ENTHL(495)=35
0560 ENTHL(496)=35
0561 ENTHL(497)=35
0562 ENTHL(498)=35
0563 ENTHL(499)=35
0564 ENTHL(500)=35
0565 ENTHL(501)=35
0566 ENTHL(502)=35
0567 ENTHL(503)=35
0568 ENTHL(504)=35
0569 ENTHL(505)=35
0570 ENTHL(506)=35
0571 ENTHL(507)=35
0572 ENTHL(508)=35
0573 ENTHL(509)=35
0574 ENTHL(510)=35
0575 ENTHL(511)=35
0576 ENTHL(512)=35
0577 ENTHL(513)=35
0578 ENTHL(514)=35
0579 ENTHL(515)=35
0580 ENTHL(516)=35
0581 ENTHL(517)=35
0582 ENTHL(518)=35
0583 ENTHL(519)=35
0584 ENTHL(520)=35
0585 ENTHL(521)=35
0586 ENTHL(522)=35
0587 ENTHL(523)=35
0588 ENTHL(524)=35
0589 ENTHL(525)=35
0590 ENTHL(526)=35
0591 ENTHL(527)=35
0592 ENTHL(528)=35
0593 ENTHL(529)=35
0594 ENTHL(530)=35
0595 ENTHL(531)=35
0596 ENTHL(532)=35
0597 ENTHL(533)=35
0598 ENTHL(534)=35
0599 ENTHL(535)=35
0600 ENTHL(536)=35
0601 ENTHL(537)=35
0602 ENTHL(538)=35
0603 ENTHL(539)=35
0604 ENTHL(540)=35
0605 ENTHL(541)=35
0606 ENTHL(542)=35
0607 ENTHL(543)=35
0608 ENTHL(544)=35
0609 ENTHL(545)=35
0610 ENTHL(546)=35
0611 ENTHL(547)=35
0612 ENTHL(548)=35
0613 ENTHL(549)=35
0614 ENTHL(550)=35
0615 ENTHL(551)=35
0616 ENTHL(552)=35
0617 ENTHL(553)=35
0618 ENTHL(554)=35
0619 ENTHL(555)=35
0620 ENTHL(556)=35
0621 ENTHL(557)=35
0622 ENTHL(558)=35
0623 ENTHL(559)=35
0624 ENTHL(560)=35
0625 ENTHL(561)=35
0626 ENTHL(562)=35
0627 ENTHL(563)=35
0628 ENTHL(564)=35
0629 ENTHL(565)=35
0630 ENTHL(566)=35
0631 ENTHL(567)=35
0632 ENTHL(568)=35
0633 ENTHL(569)=35
0634 ENTHL(570)=35
0635 ENTHL(571)=35
0636 ENTHL(572)=35
0637 ENTHL(573)=35
0638 ENTHL(574)=35
0639 ENTHL(575)=35
0640 ENTHL(576)=35
0641 ENTHL(577)=35
0642 ENTHL(578)=35
0643 ENTHL(579)=35
0644 ENTHL(580)=35
0645 ENTHL(581)=35
0646 ENTHL(582)=35
0647 ENTHL(583)=35
0648 ENTHL(584)=35
0649 ENTHL(585)=35
0650 ENTHL(586)=35
0651 ENTHL(587)=35
0652 ENTHL(588)=35
0653 ENTHL(589)=35
0654 ENTHL(590)=35
0655 ENTHL(591)=35
0656 ENTHL(592)=35
0657 ENTHL(593)=35
0658 ENTHL(594)=35
0659 ENTHL(595)=35
0660 ENTHL(596)=35
0661 ENTHL(597)=35
0662 ENTHL(598)=35
0663 ENTHL(599)=35
0664 ENTHL(600)=35
0665 ENTHL(601)=35
0666 ENTHL(602)=35
0667 ENTHL(603)=35
0668 ENTHL(604)=35
0669 ENTHL(605)=35
0670 ENTHL(606)=35
0671 ENTHL(607)=35
0672 ENTHL(608)=35
0673 ENTHL(609)=35
0674 ENTHL(610)=35
0675 ENTHL(611)=35
0676 ENTHL(612)=35
0677 ENTHL(613)=35
0678 ENTHL(614)=35
0679 ENTHL(615)=35
0680 ENTHL(616)=35
0681 ENTHL(617)=35
0682 ENTHL(618)=35
0683 ENTHL(619)=35
0684 ENTHL(620)=35
0685 ENTHL(621)=35
0686 ENTHL(622)=35
0687 ENTHL(623)=35
0688 ENTHL(624)=35
0689 ENTHL(625)=35
0690 ENTHL(626)=35
0691 ENTHL(627)=35
0692 ENTHL(628)=35
0693 ENTHL(629)=35
0694 ENTHL(630)=35
0695 ENTHL(631)=35
0696 ENTHL(632)=35
0697 ENTHL(633)=35
0698 ENTHL(634)=35
0699 ENTHL(635)=35
0700 ENTHL(636)=35
0701 ENTHL(637)=35
0702 ENTHL(638)=35
0703 ENTHL(639)=35
0704 ENTHL(640)=35
0705 ENTHL(641)=35
0706 ENTHL(642)=35
0707 ENTHL(643)=35
0708 ENTHL(644)=35
0709 ENTHL(645)=35
0710 ENTHL(646)=35
0711 ENTHL(647)=35
0712 ENTHL(648)=35
0713 ENTHL(649)=35
0714 ENTHL(650)=35
0715 ENTHL(651)=35
0716 ENTHL(652)=35
0717 ENTHL(653)=35
0718 ENTHL(654)=35
0719 ENTHL(655)=35
0720 ENTHL(656)=35
0721 ENTHL(657)=35
0722 ENTHL(658)=35
0723 ENTHL(659)=35
0724 ENTHL(660)=35
0725 ENTHL(661)=35
0726 ENTHL(662)=35
0727 ENTHL(663)=35
0728 ENTHL(664)=35
0729 ENTHL(665)=35
0730 ENTHL(666)=35
0731 ENTHL(667)=35
0732 ENTHL(668)=35
0733 ENTHL(669)=35
0734 ENTHL(670)=35
0735 ENTHL(671)=35
0736 ENTHL(672)=35
0737 ENTHL(673)=35
0738 ENTHL(674)=35
0739 ENTHL(675)=35
0740 ENTHL(676)=35
0741 ENTHL(677)=35
0742 ENTHL(678)=35
0743 ENTHL(679)=35
0744 ENTHL(680)=35
0745 ENTHL(681)=35
0746 ENTHL(682)=35
0747 ENTHL(683)=35
0748 ENTHL(684)=35
0749 ENTHL(685)=35
0750 ENTHL(686)=35
0751 ENTHL(687)=35
0752 ENTHL(688)=35
0753 ENTHL(689)=35
0754 ENTHL(690)=35
0755 ENTHL(691)=35
0756 ENTHL(692)=35
0757 ENTHL(693)=35
0758 ENTHL(694)=35
0759 ENTHL(695)=35
0760 ENTHL(696)=35
0761 ENTHL(697)=35
0762 ENTHL(698)=35
0763 ENTHL(699)=35
0764 ENTHL(700)=35
0765 ENTHL(701)=35
0766 ENTHL(702)=35
0767 ENTHL(703)=35
0768 ENTHL(704)=35
0769 ENTHL(705)=35
0770 ENTHL(706)=35
0771 ENTHL(707)=35
0772 ENTHL(708)=35
0773 ENTHL(709)=35
0774 ENTHL(710)=35
0775 ENTHL(711)=35
0776 ENTHL(712)=35
0777 ENTHL(713)=35
0778 ENTHL(714)=35
0779 ENTHL(715)=35
0780 ENTHL(716)=35
0781 ENTHL(717)=35
0782 ENTHL(718)=35
0783 ENTHL(719)=35
0784 ENTHL(720)=35
0785 ENTHL(721)=35
0786 ENTHL(722)=35
0787 ENTHL(723)=35
0788 ENTHL(724)=35
0789 ENTHL(725)=35
0790 ENTHL(726)=35
0791 ENTHL(727)=35
0792 ENTHL(728)=35
0793 ENTHL(729)=35
0794 ENTHL(730)=35
0795 ENTHL(731)=35
0796 ENTHL(732)=35
0797 ENTHL(733)=35
0798 ENTHL(734)=35
0799 ENTHL(735)=35
0800 ENTHL(736)=35
0801 ENTHL(737)=35
0802 ENTHL(738)=35
0803 ENTHL(739)=35
0804 ENTHL(740)=35
0805 ENTHL(741)=35
0806 ENTHL(742)=35
0807 ENTHL(743)=35
0808 ENTHL(744)=35
0809 ENTHL(745)=35
0810 ENTHL(746)=35
0811 ENTHL(747)=35
0812 ENTHL(748)=35
0813 ENTHL(749)=35
0814 ENTHL(750)=35
0815 ENTHL(7
```



```

COP=1.0/1.05, PWR, PA)
WRITE(22,10)DA
X(5)=XA
X(6)=X(5)
9  FORMAT(77,5X,'CONCENTRATION OF SOL LEAVING THE ABSORBER=',F6.3)
   DTS=TS(7)
   DTR=TR(7)
   CALL CONC(DTS,DTR,DA)
10  WRITE(22,10)DA
   FORMAT(77,5X,'CONCENTRATION OF SOL LEAVING GENERATOR=',F6.3)
   X(7)=GX
   *****
   ARRS=17/M1=ABSORBER RECIRCULATION RATIO
   GRR7=16/M1=GENERATOR RECIRCULATION RATIO
   M1=1.0
   *****
   ARRS=X(6)/(X(7)-X(6))
   GRR7=ARRS+1
   WRITE(22,37) ARRS,GRR7
87  FORMAT(77,5X,'ARRS=',F8.4,5X,'GRR7=',F8.4)
   *****
   TO DETERMINE THE HEAT LOADS ON THE VARIOUS COMPONENTS
   TIME MUST NEXT CALCULATE THE ENTHALPIES OF THE FLUIDS
   AT VARIOUS STATES.
   *****
   H(1)=TR(1)*.43+1067.0
   H(2)=TRC(2)*4.184/2.326
   H(3)=H(2)
   H(4)=TR(4)*.43+1067.0
   *****
   ENTHALPY OF THE SOLUTION IS THE FUNCTION OF TEMPERATURE AND
   CONCENTRATION
   *****
   H(5)=P(X(5))+Q(X(5))*TS(5)+R(X(5))*(TS(5)**2)
   H(7)=P(X(7))+Q(X(7))*TS(7)+R(X(7))*(TS(7)**2)
   H(8)=H(7)-ETA1*(H(7)-H(5))
   X(8)=X(7)
   *****
   DX=X(8)
   DH=H(8)
   CALL SOLTEM(DX,DH,DTS)
   TS(8)=DTS
   TSC(8)=(TS(8)-32.0)*5.0/9.0
   *****
   H5=(H(5)-H(8))/M7*(H(7)-H(8))
   *****
   H(6)=ARRS/GRR7*(H(7)-H(8))+H(5)
   X(6)=X(5)
   DX=X(6)
   DH=H(6)
   CALL SOLTEM(DX,DH,DTS)
   TS(6)=DTS
   TSC(6)=(TS(6)-32.0)*5.0/9.0
55  WRITE(22,55) TSC(6),TSC(1),TSC(8)
   FORMAT(77,5X,'SOL TEMP LEAVING HEAT EXCHANGER FOR GENERATOR
1= ',F7.3,/,5X,'STRONG SOL TEMP LEAVING GENERATOR TO ABSORBER
1= ',F7.3,/,5X,'STRONG SOL TEMP AFTER HEAT EXCHANGER TO ABSORBER
1= ',F7.3)
   CF=2.126/60.0
   HEATEV=(H(4)-H(3))*CF
   HEATGH=(ARRS*H(7)+H(4)-GRR7*H(6))*CF
   HEATBN=(ARRS*H(8)+H(4)-GRR7*H(5))*CF
   HEATCP=(H(1)-H(2))*CF
   HEATIN=HEATGH+HEATEV
   HEATOUT=HEATBN+HEATCP
   DIFF=1.05*(HEATIN-HEATOUT)
   WRITE(22,52)
52  FORMAT(77,5X,'ENTHALPY IN BTU/LB',7X,'ENTHALPY IN KJ/KG')
   DO 10 I=1,8
   ENTH(I)=2.126*H(I)
   WRITE(22,54) I,H(I),ENTH(I)
54  FORMAT(77,1X,12,16X,F8.3,17X,F8.3)
56  CONTINUE
   HEATEV=0.9*HEATEV
   WRITE(22,10) HEATEV,HEATBN,HEATIN,HEATOUT
   WRITE(22,12) HEATIN,HEATOUT,DIFF
46  FORMAT(77,5X,'HEATEV IN KW=',F8.3,5X,'HEATBN IN KW=',F8.3,/,
1X,'HEATCONDENSUR IN KW=',F8.3,4X,'HEATABSORBER IN KW=',F8.3)
12  FORMAT(77,5X,'TOTAL HEAT INPUT IN KW=',F8.3,/,5X,'TOTAL HEAT
1X,'INPUT IN KW=',F8.3,/,5X,'DIFFERENCE IN HEAT LOADS IN KW='
1X,F7.1)
   COP=HEATEV/HEATBN
   COPID=(TSC(1)+273.15)*(TRC(2)
1X,TSC(1))
   WRITE(22,100) COP,COPID
100  FORMAT(77,5X,'COEFFICIENT OF PERFORMANCE=',F7.4,/,5X,'COP
1X,HEAT= ',F7.1)
   WRITE(22,100) COP,COPID

```

```

10  C(1)=C(2)+D(1)*DA
    F(5)=DA
    X(5)=X(1)
    FORMAT(//,5X,'CONCENTRATION OF SOL LEAVING THE ABSORBER=',F6.3)
    PRT=TS(7)
    DHE=TR(7)
    CALL CONC(DTS,DTR,DA)
    WRITE(22,10)DA
    FORMAT(//,5X,'CONCENTRATION OF SOL LEAVING GENERATOR=',F6.3)
    X(7)=DX
    *****
    ARR5=1/M1=ABSORBER RECIRCULATION RATIO
    GRR7=46/M1=GENERATOR RECIRCULATION RATIO
    M1=1.0
    *****
    ARR5=X(6)/(X(7)-X(6))
    GRR7=ARR5+1.
    WRITE(22,87) ARR5,GRR7
    FORMAT(//,5X,'ARR5=',F8.4,5X,'GRR7=',F8.4)
    *****
    TO DETERMINE THE HEAT LOADS ON THE VARIOUS COMPONENTS
    THE FIRST NEXT CALCULATE THE ENTHALPIES OF THE FLUIDS
    AT VARIOUS STATES.
    *****
    H(1)=TH(1)*.43+1067.0
    H(2)=TNC(2)*4.184/2.326
    H(3)=H(2)
    H(4)=TR(4)*.43+1067.0
    *****
    ENTHALPY OF THE SOLUTION IS THE FUNCTION OF TEMPERATURE AND
    CONCENTRATION
    *****
    H(5)=P(X(5))+Q(X(5))*TS(5)+R(X(5))*(TS(5)**2)
    H(7)=P(X(7))+Q(X(7))*TS(7)+R(X(7))*(TS(7)**2)
    H(8)=H(7)-ETA1*(H(7)-H(5))
    X(8)=X(7)
    *****
    DX=X(8)
    DH=H(8)
    CALL SOLTEM(DX,DH,DTS)
    TS(8)=DTS
    TSC(8)=(TS(8)-32.0)*5.0/9.0
    *****
    M5=(H(6)-H(5))*M7*(H(7)-H(8))
    *****
    H(6)=ARR5/GRR7*(H(7)-H(8))+H(5)
    X(6)=X(5)
    DX=X(6)
    DH=H(6)
    CALL SOLTEM(DX,DH,DTS)
    TS(6)=DTS
    TSC(6)=(TS(6)-32.0)*5.0/9.0
    WRITE(22,55) TSC(6),TSC(1),TSC(8)
    FORMAT(//,5X,'SOL TEMP LEAVING HEAT EXCHANGER FOR GENERATOR
    1=',F7.3,/,5X,'STRONG SOL TEMP LEAVING GENERATOR TO ABSORBER
    1=',F7.3,/,5X,'STRONG SOL TEMP AFTER HEAT EXCHANGER TO ABSORBER
    1=',F7.3)
    CF=2.326/60.0
    HEATEV=(H(4)-H(3))*CF
    HEATG=(ARR5*(H(7)-H(1))-GRR7*(H(6)-H(5)))*CF
    HEATA=(ARR5*(H(8)-H(4))-GRR7*(H(5)-H(6)))*CF
    HEATC=(H(1)-H(2))*CF
    HEATL=HEATG+HEATEV
    HEATD=HEATA+HEATC
    DIFF=H5*(HEATL-HEATD)
    WRITE(22,52)
    FORMAT(//,5X,'ENTHALPY IN DTGZD',7X,'ENTHALPY IN KJ/EG')
    DTS=131.8
    F(TH(1))=2.326*(H(1))
    WRITE(22,54) 1,H(1),ENTH(1)
    FORMAT(//,1X,12,10X,F8.3,17X,F6.3)
    CONTINUE
    HEATEV=.5*HEATEV
    WRITE(22,46) HEATEV,HEATC,HEATL,HEATD
    WRITE(22,46) HEATEV,HEATC,HEATL,DIFF
    FORMAT(//,5X,'HEATEV IN KW=',F8.3,5X,'HEATC IN KW=',F8.3,/,
    1X,'HEATG IN KW=',F8.3,/,5X,'HEATA IN KW=',F8.3,/,
    1X,'HEATL IN KW=',F8.3,/,5X,'HEATD IN KW=',F8.3,/,
    1X,'TOTAL HEAT INPUT IN KW=',F8.3,/,5X,'TOTAL HEAT
    12 10 INPUT IN KW=',F8.3,/,5X,'DIFFERENCE IN HEAT LOADS IN KW='
    1X,F7.4)
    CUP=1000*DIFF/HEATG
    PRT=(TSC(3)+273.15)*(TSC(1)-TSC(5))/(TSC(1)+273.15)*(TSC(2)-
    1X,TSC(3))
    WRITE(22,100) CUP,CUP10
    FORMAT(//,5X,'COEFFICIENT OF PERFORMANCE=',F7.4,/,5X,'COP
    100 100LAV=',F7.4)
    CUPD=TSC(1),CUP,CUP10

```


[illegible]

[illegible]


```

000000 37 FORMAT(//,5X,'TEMP IN DEGR FORTHINITE',5X,'TEMP. IN DEGR CENTI')
000000 DO J=1,5
000000 TRC(J)=(TR(J)-32.0)*5.0/9.0
000000 TRIC(24,13)=J,TR(J),TRC(J)
000000 13 FORMAT(//,3X,12,7X,F8.3,15X,F7.3)
000000 47 CONTINUE
000000 DO K=10,13
000000 TSC(K)=(TS(K)-32.0)*5.0/9.0
000000 WRITE(24,29) 1,TS(K),TSC(K)
000000 29 FORMAT(//,3X,12,7X,F8.3,15X,F7.3)
000000 53 CONTINUE
000000 TRC(9)=(TR(9)-32.0)*5.0/9.0
000000 TRITL(24,38)=1,TR(9),TRC(9)
000000 38 FORMAT(//,3X,12,7X,F8.3,15X,F7.3)
000000 DO K=10,13
000000 TSC(K)=(TS(K)-32.0)*5.0/9.0
000000 WRITE(24,41) K,TS(K),TSC(K)
000000 41 FORMAT(//,3X,12,7X,F8.3,15X,F7.3)
000000 63 CONTINUE
000000 WRITE(24,59)
000000 59 FORMAT(//,5X,'INPUT TEMPERATURES')
000000 TRITL(24,64)=TSC(1),TRC(3),TSC(6),TRC(4)
000000 64 FORMAT(//,5X,'SOLUTION TEMP=',F7.3,5X,'CONDENSER TEMP=',F7.3,/,
000000 15X,'ABSORBER TEMP=',F7.3,5X,'EVAPORATOR TEMP=',F7.3)
000000 WRITE(24,78)
000000 78 FORMAT(//,5X,'ENTHALPY IN BTU/LB',5X,'ENTHALPY IN KJ/KG')
000000 DO I=1,13
000000 ENTH(I)=2.326*H(I)
000000 WRITE(24,74) 1,H(I),ENTH(I)
000000 74 FORMAT(//,3X,12,8X,F6.3,12X,F8.3)
000000 72 CONTINUE
000000 C *****
000000 C ALOAD IS THE EVAPORATOR LOAD IN TONS
000000 C REFMAS IS THE REFRIGERANT(WATER) MASS FLOW RATE THROUGH EVAPORTR
000000 C REM1 IS THE REFRIGERANT MASS THROUGH GEN1 KG/MIN
000000 C REM2 IS THE REFRIGERANT MASS THROUGH GEN2 IN KG/MIN
000000 C *****
000000 WRITE(24,81)
000000 81 FORMAT(//,5X,'MASS OF REF FROM GEN1',5X,'MASS OF REF FROM GEN2')
000000 WRITE(24,83) RM1,RM9
000000 83 FORMAT(//,10X,F6.4,20X,F6.4)
000000 ALOAD=500.0
000000 REFMAS=500.0*210.0/(ENTH(5)-ENTH(4))
000000 CAP=REM1/22.78838
000000 REM1=REFMAS*RM1
000000 REM2=REFMAS*RM9
000000 TYPE *,REFMAS,REM1
000000 WRITE(24,84) REFMAS,REM1,REM2
000000 84 FORMAT(//,5X,'MASS FLOW RATE THRU EVAPORATOR IN KG/MIN=',F6.3,
000000 1/,5X,'MASS FLOW RATE THRU GEN1 IN KG/MIN=',F8.3,/,5X,
000000 1'MASS FLOW RATE THRU GEN2 IN KG/MIN=',F8.3)
000000 WRITE(24,88) ARR1,ARR2,ARR2N
000000 88 FORMAT(//,5X,'ABSORBER RECIRCULATION RATIO(M10/M1)=' ,F6.3,/,/,
000000 15X,'ABSORBER RECIRCULATION RATIO(M12/M9)=' ,F6.3,/,/,15X,'ARR2N
000000 1=1,F6.3)
000000 WRITE(24,93) QCDN,QABS,QE,QG
000000 93 FORMAT(//,5X,'QCONDENSER IN KW=' ,F7.3,5X,'QABSORBER IN KW=' ,
000000 1F7.3,/,5X,'QEVAPOATOR IN KW=' ,F7.3,5X,'QGEN IN KW=' ,F7.3)
000000 WRITE(24,96) H1,H0
000000 96 FORMAT(//,5X,'HEAT GIVEN BY REFRIGERANT IN GEN2 IN KW=' ,F7.3,/,/,
000000 15X,'HEAT TAKEN BY LIQR SOL IN GEN2 IN KW=' ,F7.3)
000000 FORMAT(//,5X,'CONCENTRATION OF SOL FROM ABSORBER=' ,F6.3,/,/,
000000 15X,'CONCENTRATION OF SOLUTION FROM GENERATOR1=' ,F6.3,/,/,
000000 15X,'CONCENTRATION OF SOLUTION FROM GENERATOR2=' ,F6.3)
000000 COP=QD/QG
000000 WRITE(24,100)
000000 100 FORMAT(//,10X,'COEFFICIENT OF PERFORMANCE')
000000 WRITE(24,150) COP
000000 150 FORMAT(//,10X,'COP=' ,F7.4)
000000 WRITE(24,175) ISC(10),TRC(2),COP
000000 175 FORMAT(//,10X,'GEN1 TEMP=' ,F7.3,10X,'GEN2 TEMP=' ,F7.3,10X,'COP=' ,F
000000 17.3)
000000 TRC(10)=TRC(10)+1.0
000000 IF(TRC(10)-77.0) 131,131,136
000000 136 STOP
000000 END
000000 C *****
000000 C SUBROUTINE FOR PRESSURE WHEN REFRIGERANT TEMPERATURE IS KNOWN
000000 C *****
000000 C SUBROUTINE PRESER(PTR,DPRIS,DPR)
000000 C D=2.326
000000 P=2.326*PTR
000000 D=337.20+49.72
000000 DPRIS=D*(DTR+459.72)+E/CODTR+459.72)*KX1
000000 DPR=DPRIS

```



```

3100 C *****
3110 C SUBROUTINE FOR CALCULATING CONCENTRATION WHEN REFRIGERANT
3120 C TEMPERATURE AND SOLUTION TEMPERATURE ARE KNOWN
3130 C *****
3140 C SUBROUTINE CONC(DTS,DTR,DX)
3150 C
3160 10 DX=DX
3170 A=(321.124-2.00755*DTR-DTS)+(0.16976*DTR)-19.322)*DX+
3180 1+(0.374382-(DTR*3.133362E-3))*(DX**2)+(DTR*1.97668E-5-2.0637
3190 1E-3)*(DX**3)
3200 DAF=(0.16976*DTR)-19.322)+2.0*(0.374382-(DTR*3.133362E-3))*DX
3210 1+3.0*(DTR*1.97668E-5-2.0637E-3)*(DX**2)
3220 DX=DX-DAF/DAF
3230 IF(ABS(DX-DX).GT.0.00001) GO TO 10
3240 DX=DX
3250 RETURN
3260 END
3270 C *****
3280 C SUBROUTINE FOR CONCENTRATION WHEN SOLUTION TEMPERATURE AND
3290 C PRESSURE ARE KNOWN
3300 C *****
3310 C SUBROUTINE GIBFCU(DTS,DPR,DTR,DX)
3320 C
3330 C=6.21147
3340 D=-2886.373
3350 E=-337269.46
3360 DPRS=ALOG10(DPR)
3370 DTR=-2.0*(D+SQRT(D**2-((4.0*E)*(C-DPRS))))-459.72
3380 DXN=69.0
3390 15 DX=DXN
3400 AFF=(321.128-2.00755*DTR-DTS)+(0.16976*DTR)-19.322)*DX
3410 1+(0.374382-(DTR*3.133362E-3))*(DX**2)+(DTR*1.97668E-5-2.0637
3420 1E-3)*(DX**3)
3430 DAF=(0.16976*DTR)-19.322)+2.0*(0.374382-(DTR*3.133362E-3))*DX
3440 1+3.0*(DTR*1.97668E-5-2.0637E-3)*(DX**2)
3450 DXN=DX-AFF/DAF
3460 IF(ABS(DXN-DX).GT.0.001) GO TO 15
3470 DX=DXN
3480 RETURN
3490 END
3500 C *****
3510 C SUBROUTINE WHEN PRESSURE AND CONCENTRATION ARE KNOWN. SOLUTION
3520 C TEMPERATURE IS TO CALCULATE WHICH ENABLES US TO FIND HIGH
3530 C TEMPERATURE OF GENERATOR
3540 C *****
3550 C SUBROUTINE HIGHPR(DXX,DPRR,DTRR,DTS,DTSS,DPRH)
3560 A=-2.00755+0.16976*DXX-(3.133362E-3)*(DXX**2)+(1.97668E-5)
3570 1*(DXX**3)
3580 B=321.128-19.322*DXX+0.374382*(DXX**2)-(2.0637E-3)*(DXX**3)
3590 DPRS=ALOG10(DPRR)
3600 C=6.21147
3610 D=-2886.373
3620 E=-337269.46
3630 DTRR=-2.0*(D+SQRT((D**2)-((4.0*E)*(C-DPRS))))-459.72
3640 DTS=A*DTRR+B+6.0
3650 PRLOG=C+D*(DTS+459.72)+E/((DTS+459.72)**2)
3660 DPRH=10.0**PRLOG
3670 RETURN
3680 END
3690 C *****
3700 C SUBROUTINE FOR FINDING THE SOLUTION TEMPERATURE WHEN ENTHALPY
3710 C AND CONCENTRATION OF SOLUTION ARE KNOWN
3720 C *****
3730 C SUBROUTINE SOLTER(X,H,TS)
3740 A=-1.1507+79.5387*A+(2.358016)*(X**2)+0.03031583*(X**3)-
3750 2(1.400261E-4)*(X**4)
3760 B=4.04103-(3.03709E-1)*X+(0.44845E-4)*(X**2)-(1.047721E-4)*
3770 1*(X**3)+(4.00097E-7)*(X**4)
3780 C=19.9107E-1)+(3.4184E-4)*X-(1.074963E-5)*(X**2)+(1.3154E-7)
3790 1*(X**3)-(5.447E-10)*(X**4)
3800 TS=40.0
3810 19 TS=TS
3820 F=(C*(X**2)+B)*TS+H
3830 D1=2.0*(C*(X**2)+B)
3840 TS1=TS-F/D1
3850 IF(ABS(TS1-TS).GT.0.1) GO TO 19
3860 TS=TS1
3870 RETURN
3880 END
3890 C *****

```

APPENDIX - 6

Condenser Data for Vapour Compression System
(For Refrigerant-Freon 22), taken from the
Central Air Conditioning Unit, I.I.T. Kanpur.

(1)	Refrigerant Pressure	230 psig
(2)	Water Pressure	Inlet 40 psig Outlet 30 psig
(3)	Water temperature	Inlet 70°F Outlet 85°F
(4)	Pipe size of condenser	ID=5/8 dia(16mm) OD= 18 mm Length=10,126 tubes
(5)	Pipe material	Cu tubes, steel shell
(6)	No. of working hours	24
(7)	No. of condensing units	9
(8)	Compressors	7 Nos. -90 h.p. 2 Nos. -100 h.p.
(9)	Condenser Pumps	3 Nos. - 30 h.p. 1 No. - 25 h.p.
(10)	Full Load	720 tons
(11)	Operating Load (Month-May)	550 tons.

APPENDIX-7

Average Roughness of Commercial Pipes [18.7]

Material (New)	ϵ in mm
Riveted Steel	0.9-9.0
Concrete	0.3-3.0
Wood Stave	0.18-0.9
Cast Iron	0.26
Galvanized Iron	0.15
Commercial Steel	0.046
Drawn Tubing	0.0015

[illegible]

50

```

COST1=0.05
COST2=0.11
CALL FRIC(DELPI,DDIA,FRIFA)
F7=FRIFA
DELPI=0.00001*1.5*1.5*990.0/(2.0*0.014)
DELPI=0.0005*WFLNG/(990.0*1000.0)
COST3=0.00001*1.0
COST4=0.00001*0.001*21.0
CALL WAFR(DELPI,DDIA,FRIFA)
F7=FRIFA
DELPI=0.00001*1.5*1.5*990.0*1000.0/(2.0*0.0*25.4)
POWER7=DELPI*WFLNG/(990.0*1000.0)
POWER7=POWER7*0.65*25.0
CYCL*, COST1,COST2,COST3,COST4,COST5,COST6,COST7
TCCOAB=COST1+COST2+COST3+COST4+COST5+COST6
DAISA=TCCOAB*ECCOAB
TECO1=1.00001*365.0
TECO2=TCCOAB*365.0
SAVING=TECO1-TECO2
WRITE(21,29) TECO1,TECO2,DAISA,SAVING
FORMAT(10X,'YEARLY OPER. COST VAR. COMP. SYSTEM=',F8.1,///,10X,
1,'YEARLY OPER. COST FOR VAR. ABS. SYST=',F8.1,///,24X,'DAILY
2SAVING IN RS=',F8.2,///,24X,'YEARLY SAVING IN RS=',F8.1)
STOP
END
*****
SUBROUTINE FOR FINDING OUT FRICTIONAL FACTOR WITH SOLUTION
SUBROUTINE FRIC(EPIS,DIA,FRFACT)
A=DIA/EPIS
DEN=1650.0
VEL=2.0
VIS=1.054*0.01*0.1
REYNO=DEN*VEL*DIA/VIS
B=REYNO/A
FRFACT=0.01
FUN=-SQRT(FRFACT)+1.0/(1.14+2.0*ALOG10(A)-2.0*ALOG10(1.0+9.3/
1*(B*SQRT(FRFACT))))
DFUN=-0.5*1.0/SQRT(FRFACT)+((1.0/(1.14+2.0*ALOG10(A)-2.0*ALOG10
1(1.0+9.3/(B*SQRT(FRFACT))))**2)*(2.0/(1.0+9.3/(B*SQRT(FRFACT))
2*(-0.5)*9.3/(B*FRFACT*SQRT(FRFACT))))
FRNEW=FRFACT-FUN/DFUN
IF(ABS(FRNEW-FRFACT).LE.0.0000001) GO TO 10
FRFACT=FRNEW
GO TO 8
FRFACT=FRNEW
RETURN
END
*****
SUBROUTINE FOR FRICTION FACTOR WHEN WATER IS FLOWING
SUBROUTINE WAFR(DELPI,DDIA,FRIFA)
DEN=990.0
VIS=0.000773
VEL=1.5
A=DDIA/DELPI
REYNO=DEN*VEL*DDIA/VIS
B=REYNO/A
FRIFA=0.01
FUNCT=-SQRT(FRIFA)+1.0/(1.14+2.0*ALOG10(A)-2.0*ALOG10(1.0+9.3/
3*(B*SQRT(FRIFA))))
DFUNCT=-0.5*1.0/SQRT(FRIFA)+((1.0/(1.14+2.0*ALOG10(A)-2.0*ALOG
4(1.0+9.3/(B*SQRT(FRIFA))))**2)*(2.0/(1.0+9.3/(B*SQRT(FRIFA))
5*(-0.5)*9.3/(B*FRIFA*SQRT(FRIFA))))
FRIFA=FRIFA-FUNCT/DFUNCT
IF(ABS(FRIFA-FRIFA).LE.0.000001) GO TO 50
FRIFA=FRIFA
GO TO 10
FRIFA=FRIFA
RETURN
END

```

A 97962

CHE-1907-M-MEH-COM